

NextEra Energy Transmission New York, Inc.

(NEETNY)

Empire State Line

Case 18-T-0499

Appendix X

EMF Analysis

September 2020





EMPIRE STATE LINE 345 kV TRANSMISSION LINE ELECTRIC AND MAGNETIC FIELD (EMF) CALCULATION

Revision D

PRELIMINARY – NOT FOR CONSTRUCTION

Project No.: 13666-003

55 East Monroe Street
Chicago, IL 60603-5780 USA
312-269-2000
www.sargentlundy.com



ISSUE SUMMARY AND APPROVAL PAGE

This is to certify that this Electric and Magnetic Field (EMF) Calculation has been prepared, reviewed and approved in accordance with Sargent & Lundy's Standard Operating Procedure SOP-0405, which is based on ANSI/ISO/ASSQC Q9001 Quality Management Systems.

CONTRIBUTORS

Prepared by:

_____	08/28/2020
Justin Stiener	Date
Associate	

Reviewed by:

_____	08/28/2020
Kunhal Parikh	Date
Project Manager	

Approved by:

_____	08/28/2020
Kunhal Parikh	Date
Project Manager	



TABLE OF CONTENTS

EXECUTIVE SUMMARY	1
1.0 PURPOSE AND SCOPE	2
2.0 DESIGN INPUTS	3
3.0 METHODOLOGY	9
4.0 RESULTS	21
5.0 REFERENCES	40
6.0 ATTACHMENTS.....	41

LIST OF TABLES

TABLE 1 - PROPOSED LINE CABLE PROPERTIES	3
TABLE 2 - PROPOSED LINE RATING OUTPUT SUMMARY	3
TABLE 3 - EXISTING LINES - AMPACITIES	5
TABLE 4 - EMF RESULTS.....	21

LIST OF FIGURES

FIGURE 1 - EXISTING NYSEG (L#38 & L#39) CONFIG	6
FIGURE 2 - EXISTING ROBINSON – STOLLE RD. (L#65) CONFIG	6
FIGURE 3 - EXISTING STOLLE RD. TO ROLL RD. (L#928) CONFIG.....	7
FIGURE 4 - EXISTING STOLLE RD. - PAVEMENT RD. (L#926) CONFIG	8
FIGURE 5 - EXISTING NYSEG (L#525) CONFIG	8
FIGURE 6 - EXISTING & PROPOSED CROSS SECTION 1	10
FIGURE 7 - EXISTING & PROPOSED CROSS SECTION 2	11
FIGURE 8 - EXISTING & PROPOSED CROSS SECTION 3	12
FIGURE 9 - EXISTING & PROPOSED CROSS SECTION 4	13
FIGURE 10 - EXISTING & PROPOSED CROSS SECTION 5	14

FIGURE 11 - EXISTING & PROPOSED CROSS SECTION 6	15
FIGURE 12 - EXISTING & PROPOSED CROSS SECTION 7	16
FIGURE 13 - EXISTING & PROPOSED CROSS SECTION 8	17
FIGURE 14 - EXISTING & PROPOSED CROSS SECTION 9	18
FIGURE 15 - EXISTING & PROPOSED CROSS SECTION 10	19
FIGURE 16 - EXISTING & PROPOSED CROSS SECTION 11	20
FIGURE 17 - PROPOSED CROSS SECTION 1 EMF RESULTS	24
FIGURE 18 - PROPOSED CROSS SECTION 2 EMF RESULTS	25
FIGURE 19 - PROPOSED CROSS SECTION 3 EMF RESULTS	27
FIGURE 20 - PROPOSED CROSS SECTION 4 EMF RESULTS	28
FIGURE 21 - PROPOSED CROSS SECTION 5 EMF RESULTS	30
FIGURE 22 - PROPOSED CROSS SECTION 6 EMF RESULTS	31
FIGURE 23 - PROPOSED CROSS SECTION 7 EMF RESULTS	33
FIGURE 24 - PROPOSED CROSS SECTION 8 EMF RESULTS	34
FIGURE 25 - PROPOSED CROSS SECTION 9 EMF RESULTS	36
FIGURE 26 - PROPOSED CROSS SECTION 10 EMF RESULTS	37
FIGURE 27 - PROPOSED CROSS SECTION 11 EMF RESULTS	39

EXECUTIVE SUMMARY

NextEra Energy Transmission New York, INC (Owner) has requested Sargent & Lundy, L.L.C. (S&L) to provide engineering services for a 345kV transmission line, which interconnects the proposed Dysinger 345 kV Switchyard with the proposed East Stolle Rd 345kV Switchyard. The project is located in Erie and Niagara counties, New York; the line is approximately twenty (20) miles. The 345kV Transmission line has eleven (11) distinct segments.

As part of the deliverables, S&L will determine the electric and magnetic fields (EMF) for the Winter Normal ratings per the New York Independent System Operator (NYISO) Tie-line Rating Report. The calculation will be used to determine the maximum electric field (kV/m) and magnetic field (mG) within and at the edge of the right-of-way (ROW) for all eleven (11) unique segments.

1.0 PURPOSE AND SCOPE

1.1 DESCRIPTION

The purpose of this calculation is to determine the electric and magnetic fields (EMF) for the Winter Normal ratings per the New York Independent System Operator (NYISO) Tie-line Rating Report.

1.2 ELECTRIC AND MAGNETIC FIELD GUIDELINES

New York State Public Service Commission (NYPSC) set forth in Opinion and Order Determining Health and Safety Issues, Imposing Operating Conditions, and Authorizing, in Case 26520, Operation Pursuant to those Conditions No. 78-13 and Statement of Interim Policy on Magnetic Fields of Major Electric Transmission Facilities, NYPSC Cases 26529 and 26559, sets the guidance for electric and magnetic fields, respectively.

These opinions and cases set forth the requirement of the minimum electric and magnetic fields at the edge of the ROW. For electric fields determined by the proposed transmission line will not be greater than 1.6 kV/m at the edge of the ROW and measured, one meter (3.28 ft) above ground level, with the line at the rated voltage. The magnetic field strength by the proposed transmission line will not be greater than 200 mG at the edge of the ROW, measured at one meter (3.28 ft) above grade. The determination of the phase currents will be based on the Winter Normal rating from the NYISO Tie-line Rating Report. Finally, the conductor height will be calculated under normal conductor temperature (95°C).

2.0 DESIGN INPUTS

2.1 VERIFIED INPUTS

Table 1 - PROPOSED LINE CABLE PROPERTIES

Properties	Conductor	Underground Cable	OPGW	OHSW
Type	ACSR	XLPE	SFPOC	EHS STEEL
Size	795 kcmil	5000 kcmil	N/A	3/8"
Stranding	26/7	N/A	48 SMF	7-Strand
Diameter (in)	1.107	5.45	0.530	.36
Conductor Cross Sectional Area (in ²)	0.7263	N/A	N/A	N/A
Weight (lbs/ft)	1.093	23.6	0.365	0.273
Rated Tensile Strength (lbs)	31,500	N/A	18,800	15,400
Sub-conductor Horizontal Spacing (in)	18	N/A	N/A	N/A
Resistance, DC, 20°C (Ω /1000 ft)	.0214	N/A	N/A	N/A
Resistance, AC, 75°C (Ω /1000 ft)	.0263	N/A	N/A	N/A

* Properties from General Cable

Table 2 - PROPOSED LINE RATING OUTPUT SUMMARY

Case	Rating Condition	Thermal Rating (Amperes)	Apparent Power " S_{MVA} " (MVA)	Real Power " P_{MW} " (MW)
1	NYISO – Winter – Normal	1348.7	1611.85	1531.26

* Real power considers a power factor of 0.95

2.2 UNVERIFIED INPUTS AND ASSUMPTIONS

Soil Conditions:

The soil resistivity value was calculated by taking an average of the resistivity values provided in geotechnical evaluation reports based on various locations along the Empire State Transmission Line. The soil resistivity value was assumed to be $137.5 \Omega \cdot m$. The noted ground resistivity was then converted into the required ground conductivity input value as follows:

The inputs to the BPA program require the ground conductivity to be entered (mmhos/m = mS/m). Therefore, the reciprocal of the ground resistivity of $137 \Omega \cdot m$ = the ground conductivity of 7.30 mS/m

Electric Field Shielding

Shield from objects was not considered as part of this calculation.

Conductor Phasing

Conductor Phasing for the typical steel monopole tangent structure, conductors A, B, and C are assumed to be on the top arm, middle arm, and lower arm, respectively.

Conductor Phasing on adjacent lines were not provided. It is assumed that phasing on the adjacent transmission lines will produce the highest electric and magnetic fields.

Conductor Midspan Height

For proposed lines, the conductor midspan height was assumed to be at worst case sag with conductor at a temperature of 203°F (95°C). For existing lines, the conductor midspan height was assumed to be at a minimum NESC clearance to ground.

SW Midspan Height

Shield wire midspan height was assumed to be at 75% of the conductor sag at average ambient temperature (49°F).

Ground elevation

The ground elevation is less than 1000' and will be inputted as 0' based on the recommendation of the BPA program.

Existing Transmission Line Ampacities

Table 3 - EXISTING LINES - AMPACITIES

Item #	Line Name	kV	Conductor	OHW	Amps	# Circuits
1	Lines # L38 & L39	345	2-1192 Bunting ACSR	3/8" EHS	3000	2
2	Line # L65	230	1192.5 Bunting ACSR	3/8" EHS	1690	1
3	Line # L928	115	1033.5 Bluebell AAC	3/8" EHS	732	1
4	Line # L926	115	1033.5 Ortolan ACSR	3/8" EHS	834	1
5	Line # L525	34.5	477 Cosmos AAC	3/8" EHS	946	1
6	Niagara-Rochester/ Niagara-Dysinger	345	2-795 Drake ACSR	3/8" EHS	2662	2
7	Stolle – Homer City	345	2-1033.5 Ortolan ACSR	3/8" EHS	1200	1
8	Somerset-Dysinger	345	2-1192 Bunting ACSR	3/8" EHS	3000	2

Above Winter Normal Ratings are based on the NYISO Gold Book. Shield wire is assumed to be 3/8" EHS.

Existing Conductor configuration

The existing NYSEG 345 kV transmission line (L#38 & 39) phase to phase separation is 27 ft. The shield wire is located approximately 14' on either side of the center of the wood h-frame. The minimum clearance to ground for the 345 kV transmission line is 25.1' with a 10% overvoltage. (See Figure 1)

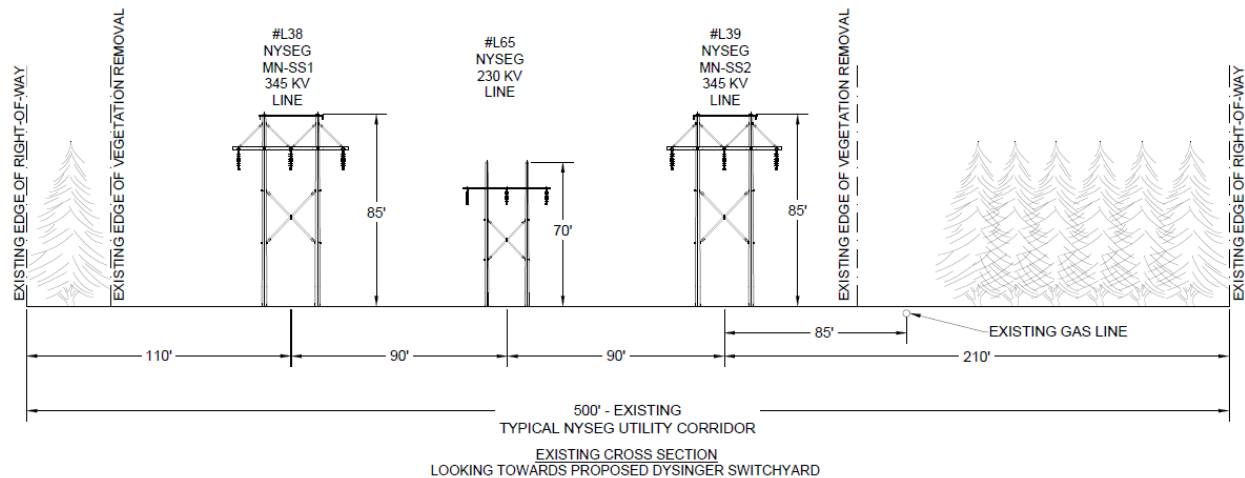


Figure 1 - EXISTING NYSEG (L#38 & L#39) CONFIGURATION

The existing Robinson – Stolle Rd. 230 kV transmission line (L#65) phase to phase separation is 20 ft. The shield wire is located approximately 10.5' on either side of the center of the wood h-frame. The minimum clearance to ground for the 230 kV transmission line is 22.5' with a 5% overvoltage. (See Figure 2)

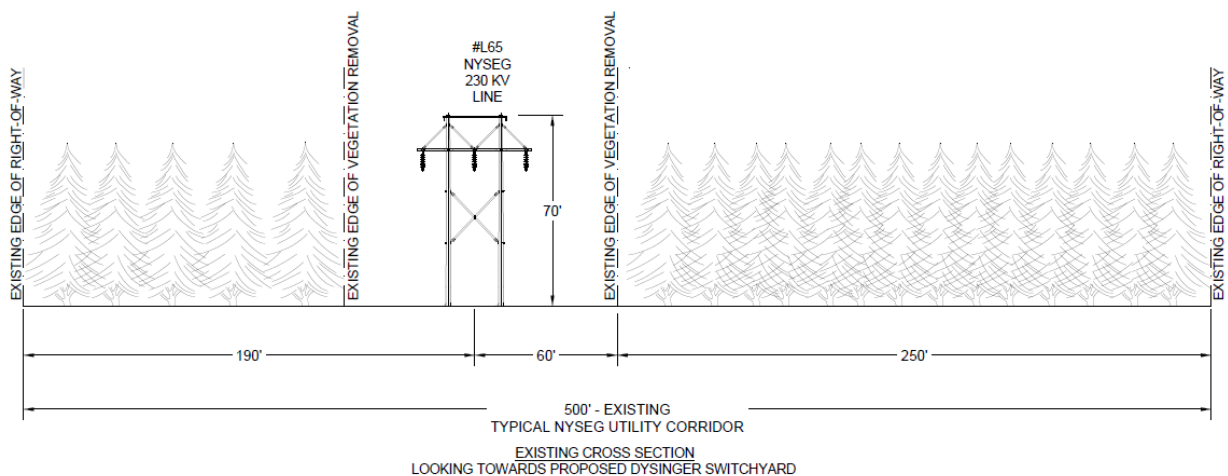


Figure 2 - EXISTING ROBINSON – STOLLE RD. (L#65) CONFIGURATION

The existing Stolle Rd. to Roll Rd. 115 kV transmission line (L#928) phase to phase separation is 12 ft. The shield wire is located approximately 6.5' on either side of the center of the wood h-frame. The minimum clearance to ground for the 115 kV transmission line is 20.1' with a 5% overvoltage. (See Figure 3)

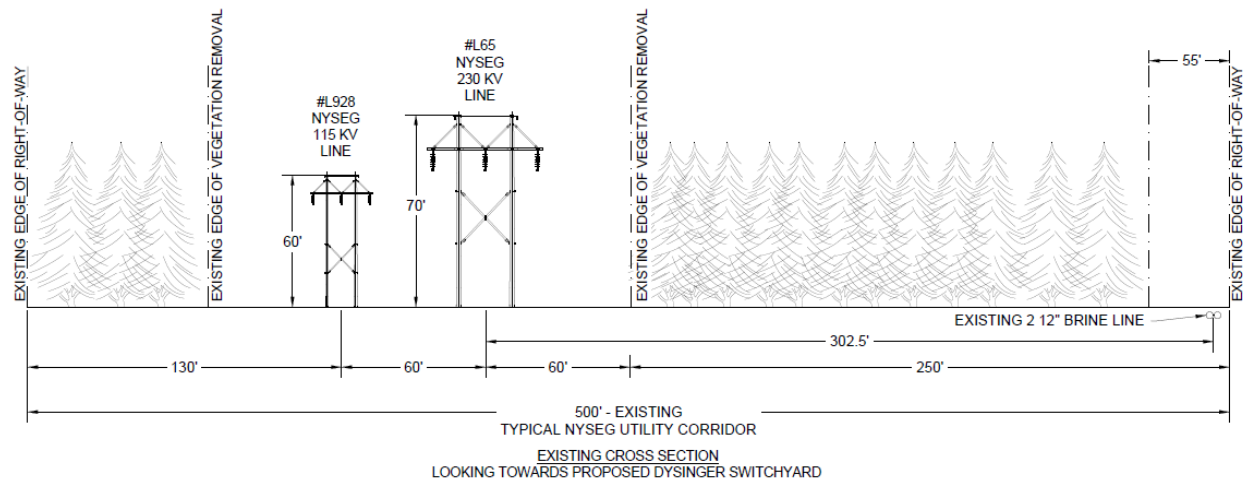


Figure 3 - EXISTING STOLLE RD. TO ROLL RD. (L#928) CONFIGURATION

The existing Stolle Rd. to Pavement Rd. 115 kV transmission line (L#926) phase to phase separation is 12 ft. The shield wire is located approximately 6.5' on either side of the center of the wood h-frame. The minimum clearance to ground for the 115 kV transmission line is 20.1' with a 5% overvoltage. (See Figure 4)

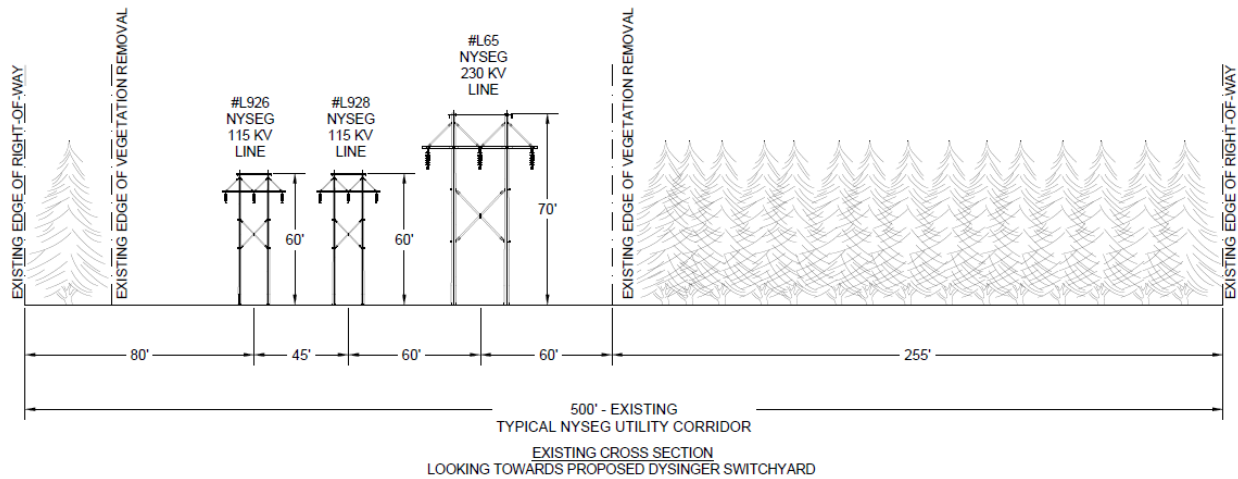


Figure 4 - EXISTING STOLLE RD. - PAVEMENT RD. (L#926) CONFIGURATION

The existing 34.5kV transmission line (L#525) phase to phase separation is 9 ft for the lower arm and 7ft for the upper arm. The shield wire is located at the pole top approximately 7' from top conductor arm. The minimum clearance to ground for the 34.5 kV transmission line is 18.5' with a 5% overvoltage. (See Figure 5)

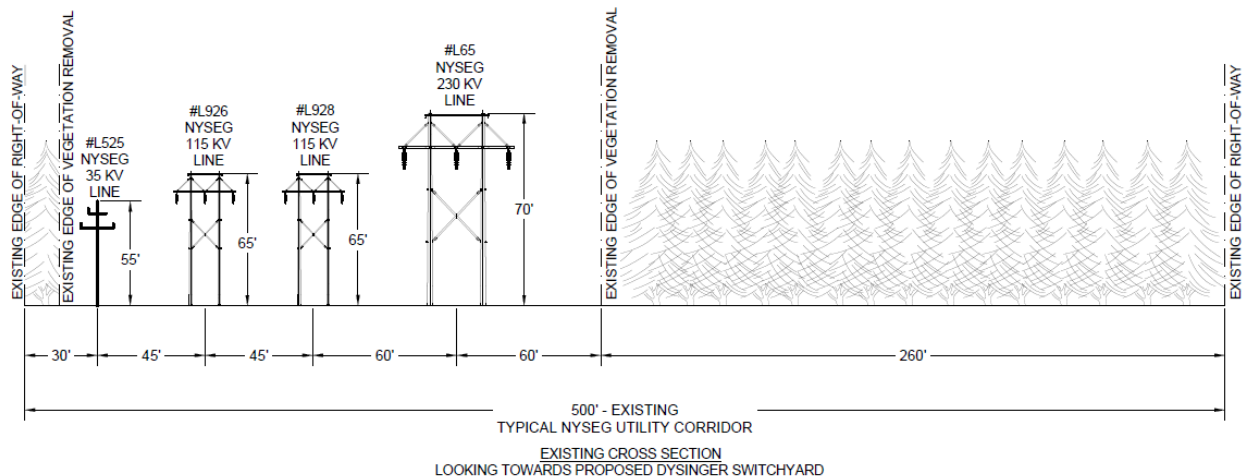


Figure 5 - EXISTING NYSEG (L#525) CONFIGURATION

3.0 METHODOLOGY

3.1 COMPUTER PROGRAMS USED

1. Local Computer: PL12209
2. Bonneville Power Administrative (BPA) Corona and Field Effects Program (Version 3.1)
3. nextera_empire_state_line_7-31-20.xyz (PLS CADD model file)
4. PLS CADD v.16.04 (V&V # 03.7.893-16.04)
5. AutoCAD v2018 (V&V # 03.2.085-2018)
6. MS Office (V&V # 03.2.435-16.0)
7. CYMCAP v7.2.2 (V&V #03.7.919-7.2.2)

3.2 CROSS SECTION STUDY AREA

Eleven (11) ROW segments with unique electric and magnetic field (EMF) characteristics were identified in the EMF study off the entire transmission line corridor for the proposed project. These ROW segments have unique EMF characteristics due to the type and average height of structures, corridor widths, and/or co-location of other transmission facilities in the corridor.

Cross Section 1

The proposed cross section consists of three overhead 345kV transmission lines with steel monopoles spanning from Dysinger Take-Off to mile 0.134. The NEETNY ROW width is 410ft.

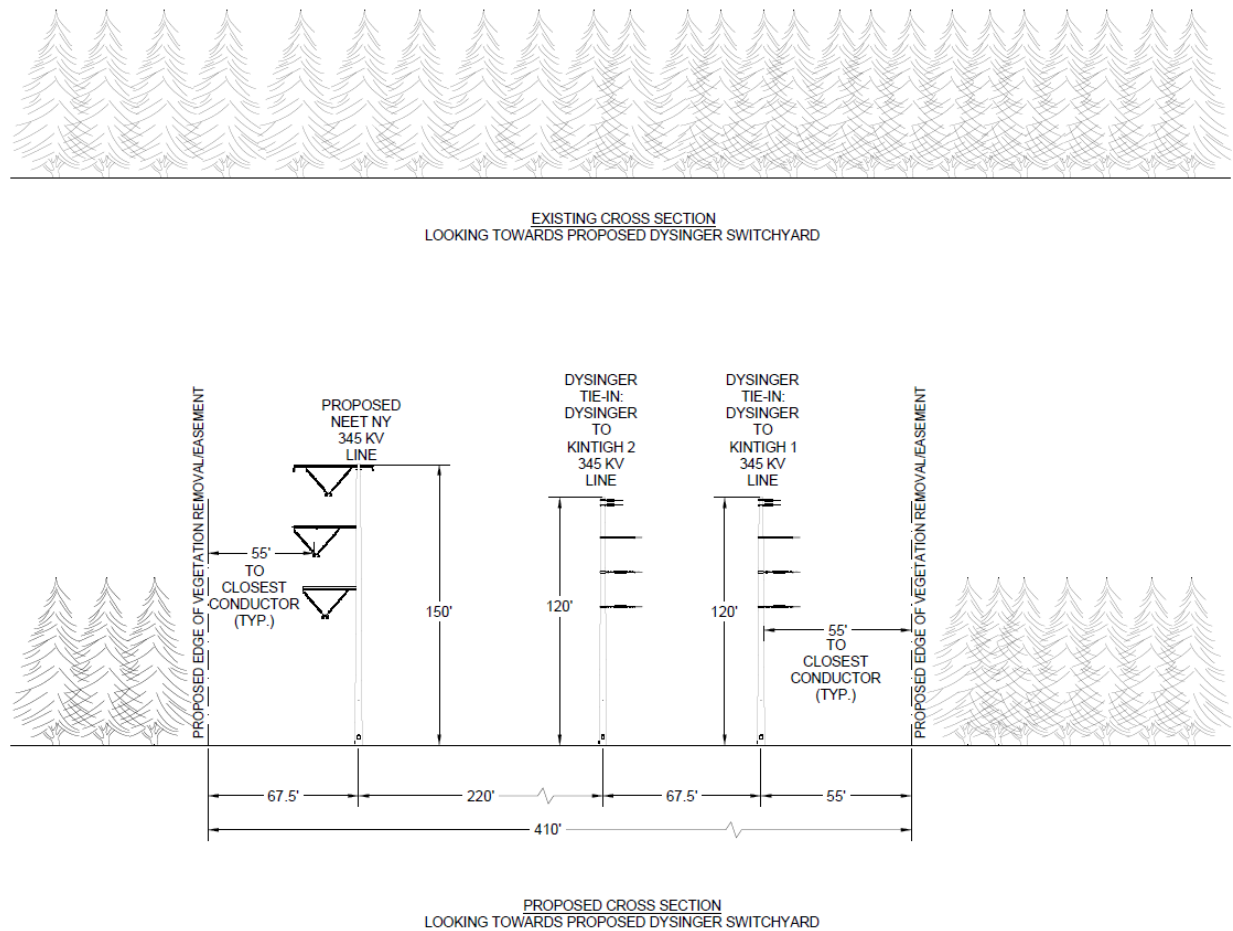


Figure 6 - EXISTING & PROPOSED CROSS SECTION 1

Cross Section 2

The proposed cross section consists of one overhead 345kV transmission line with steel monopoles and adjacent 230kV transmission line spanning from mile 0.134 to mile 0.724. The two 345kV tie lines are to be removed. The NEETNY ROW width is 130ft.

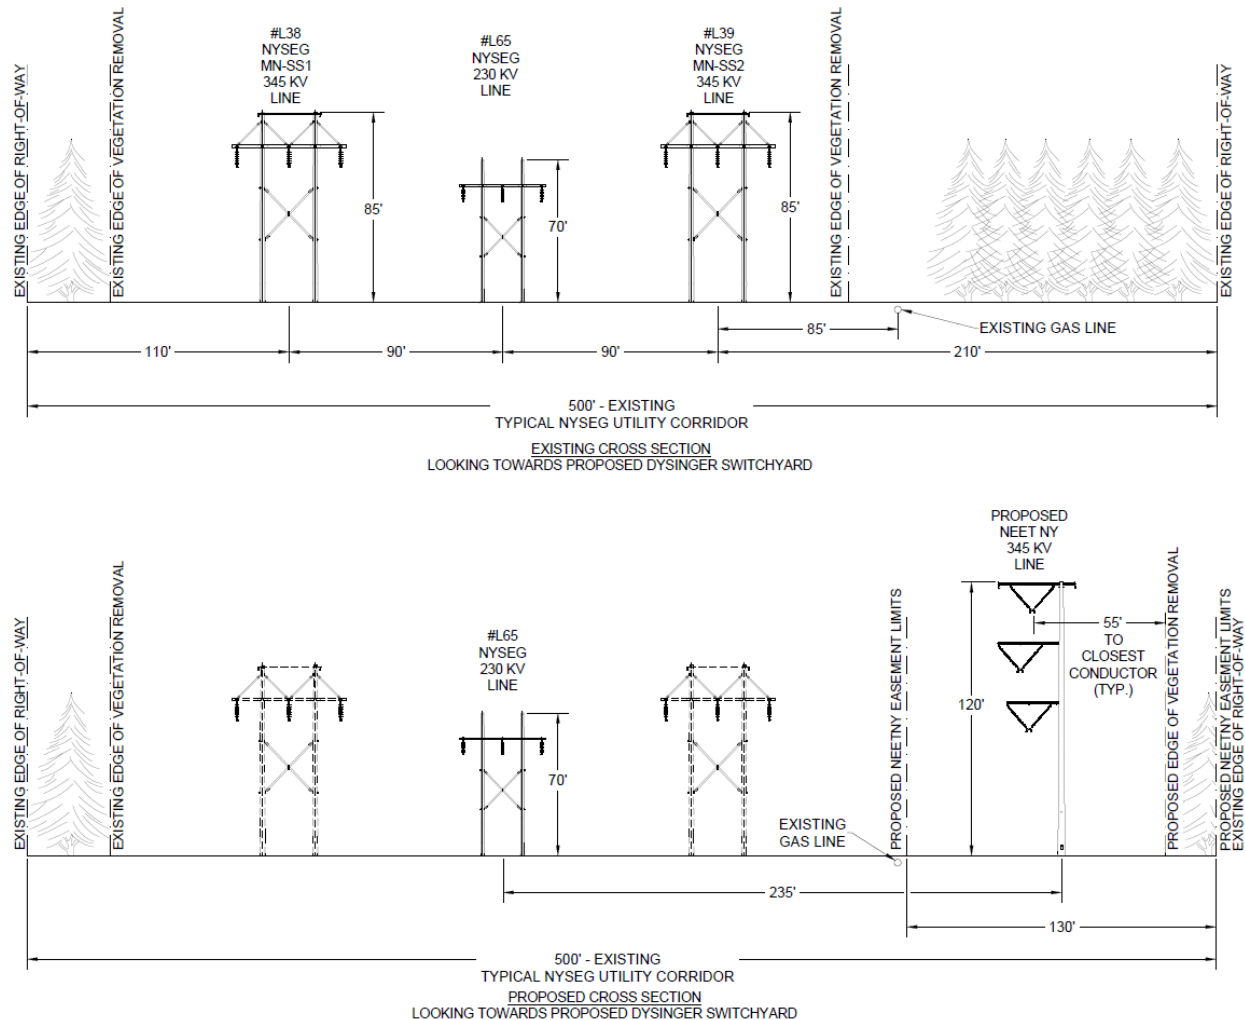


Figure 7 - EXISTING & PROPOSED CROSS SECTION 2

Cross Section 3

The proposed cross section consists of one overhead 345kV transmission line with steel monopole and adjacent 230kV transmission line spanning from mile 0.724 to mile 7.374. The NEETNY ROW width is 130ft.

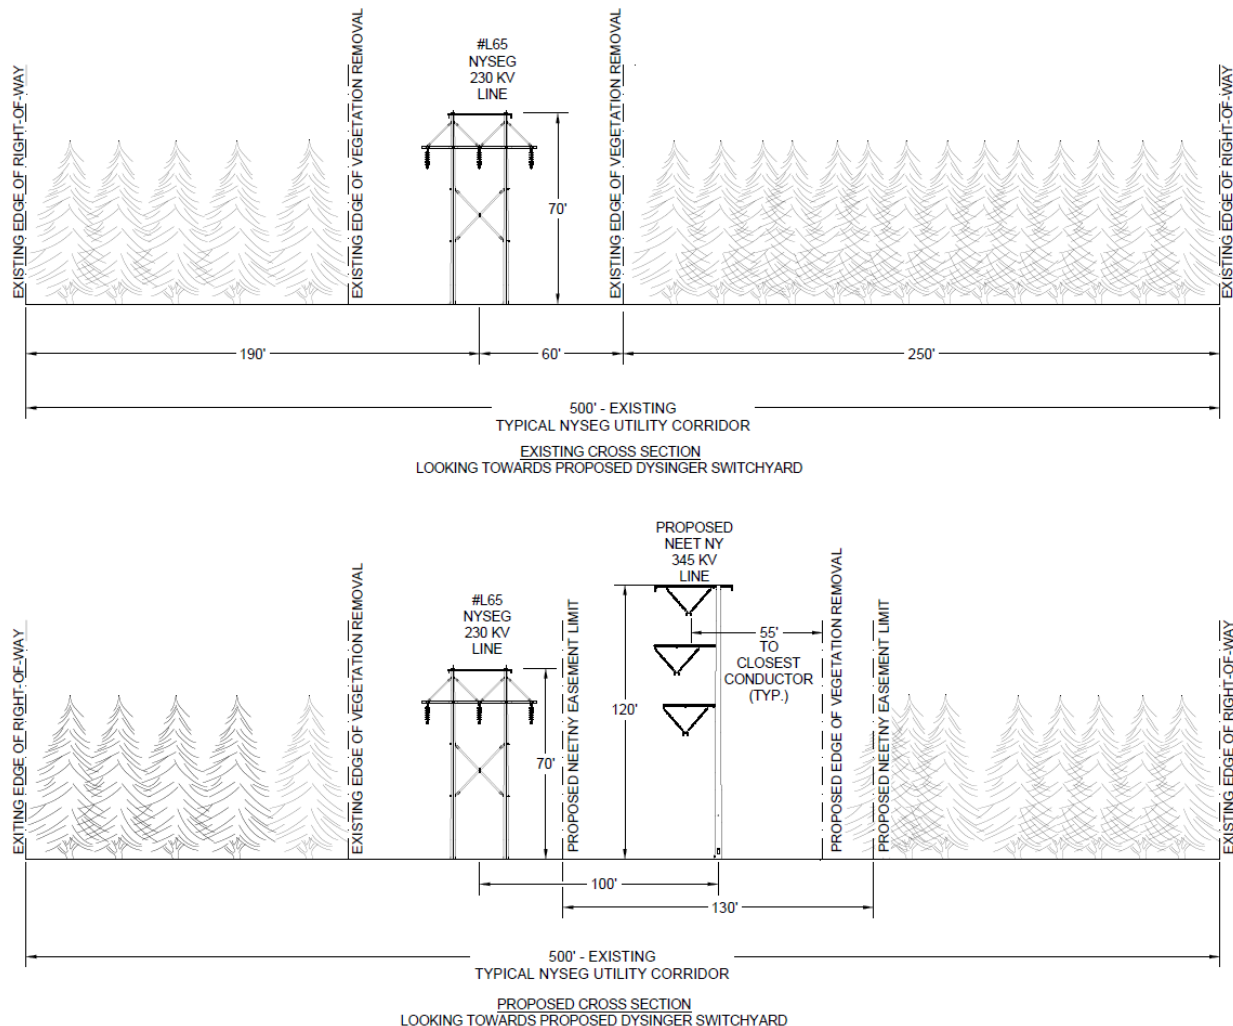


Figure 8 - EXISTING & PROPOSED CROSS SECTION 3

Cross Section 4

The proposed cross section consists of one overhead 345kV transmission line with steel monopoles and adjacent 230kV & 115kV transmission lines and 2 12" Brine Lines spanning from mile 7.374 to mile 8.764. The NEETNY ROW width is 130ft.

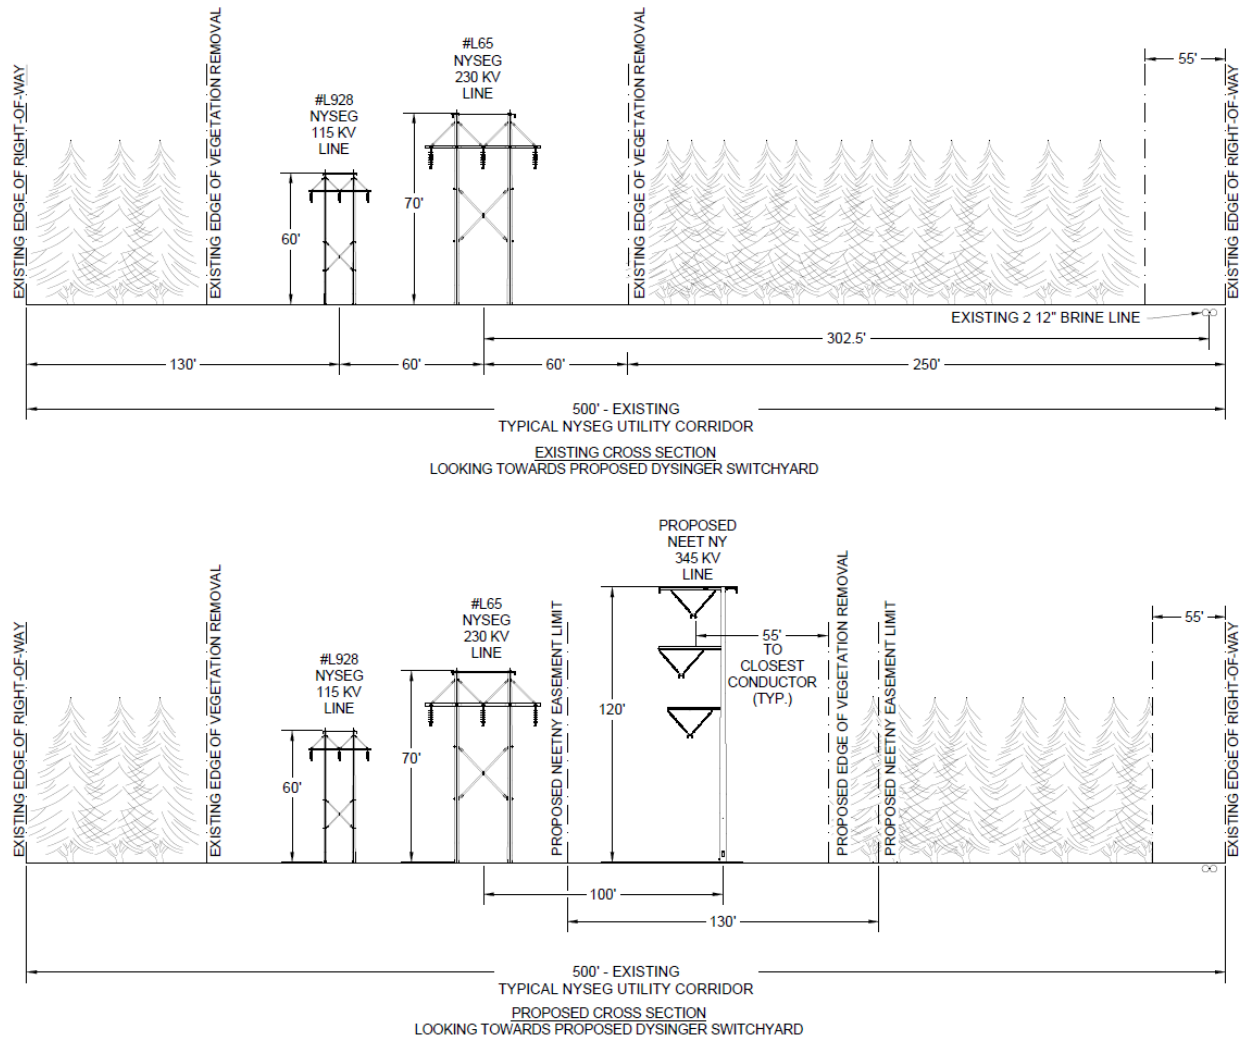


Figure 9 - EXISTING & PROPOSED CROSS SECTION 4

Cross Section 5

The proposed cross section consists of one overhead 345kV transmission line with steel monopoles and adjacent 230kV & 115kV transmission lines spanning from mile 7.374 to mile 13.164. The NEETNY ROW width is 130 ft.

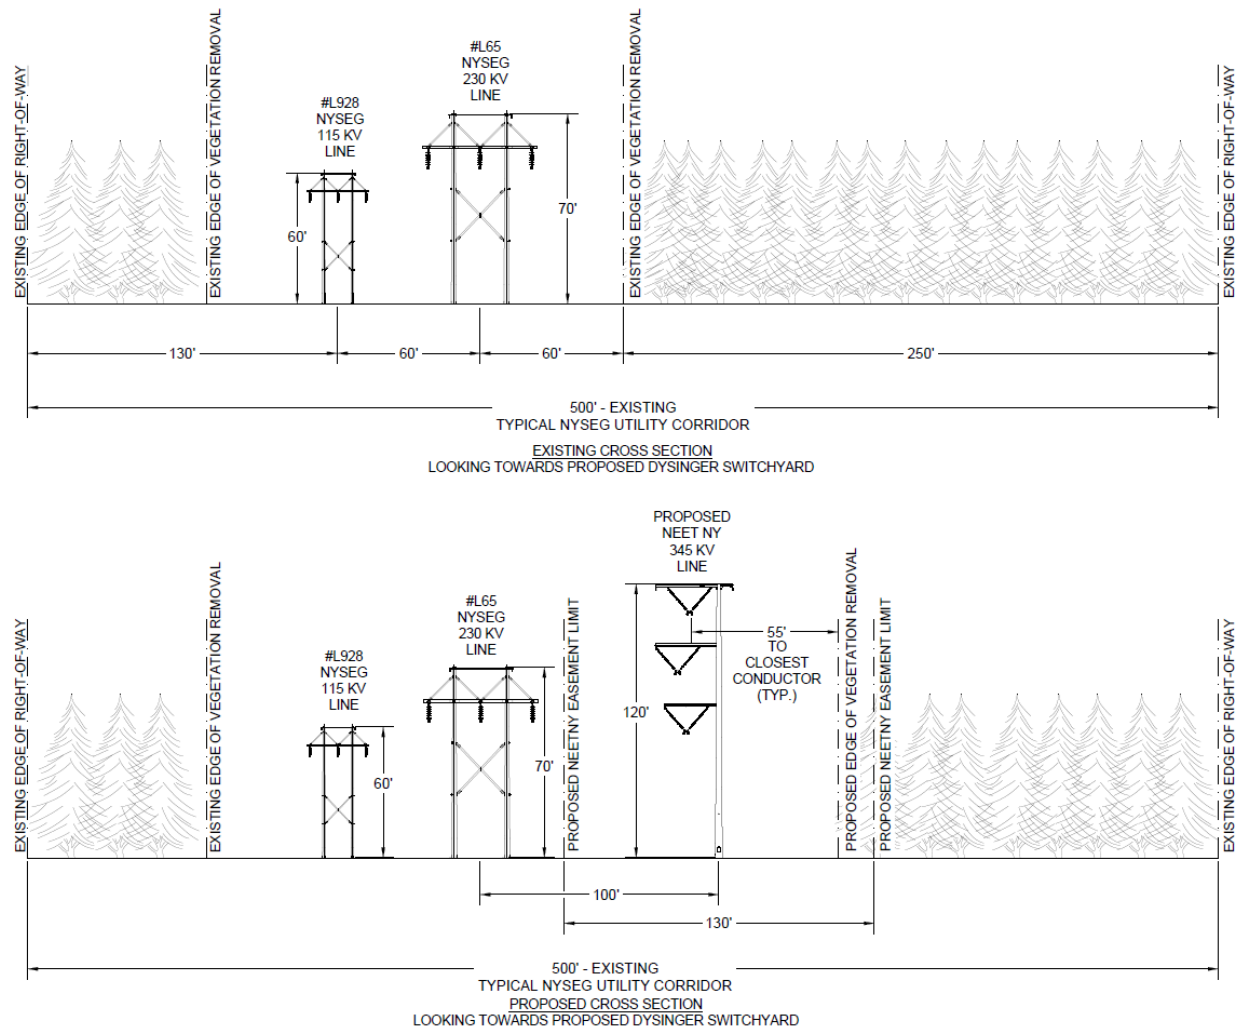


Figure 10 - EXISTING & PROPOSED CROSS SECTION 5

Cross Section 6

The proposed cross section consists of one overhead 345kV transmission line with steel monopoles and adjacent 230kV, 115kV & 34.5kV transmission lines spanning from mile 13.164 to mile 14.694. The NEETNY ROW width is 130 ft.

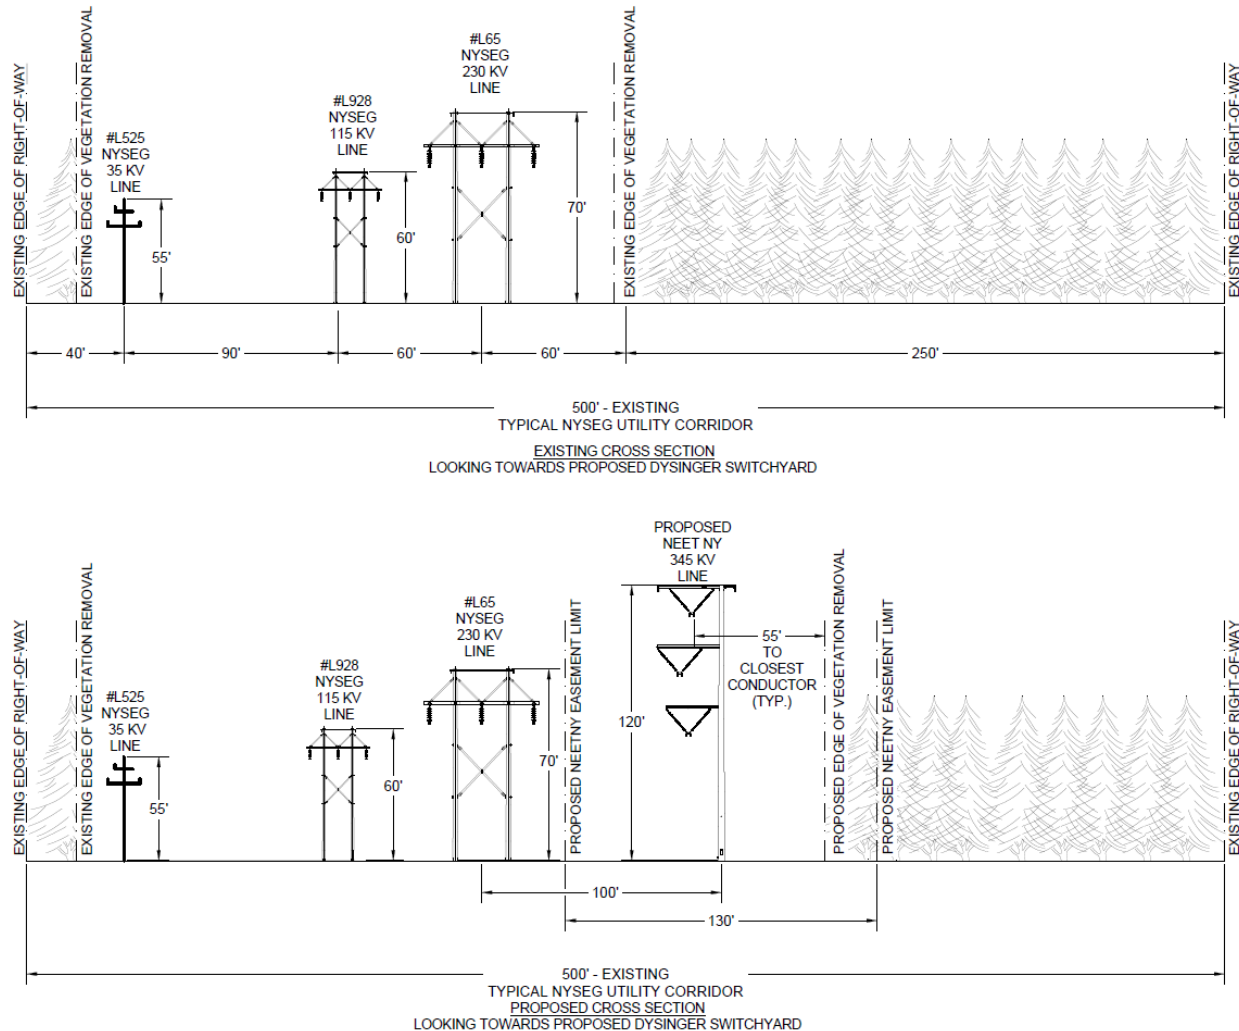


Figure 11 - EXISTING & PROPOSED CROSS SECTION 6

Cross Section 7

The proposed cross section consists of one overhead 345kV transmission line with steel monopoles and adjacent 230kV, 115kV, 115kV & 34.5kV transmission lines spanning from mile 14.694 to mile 15.324. The NEETNY ROW width is 130ft.

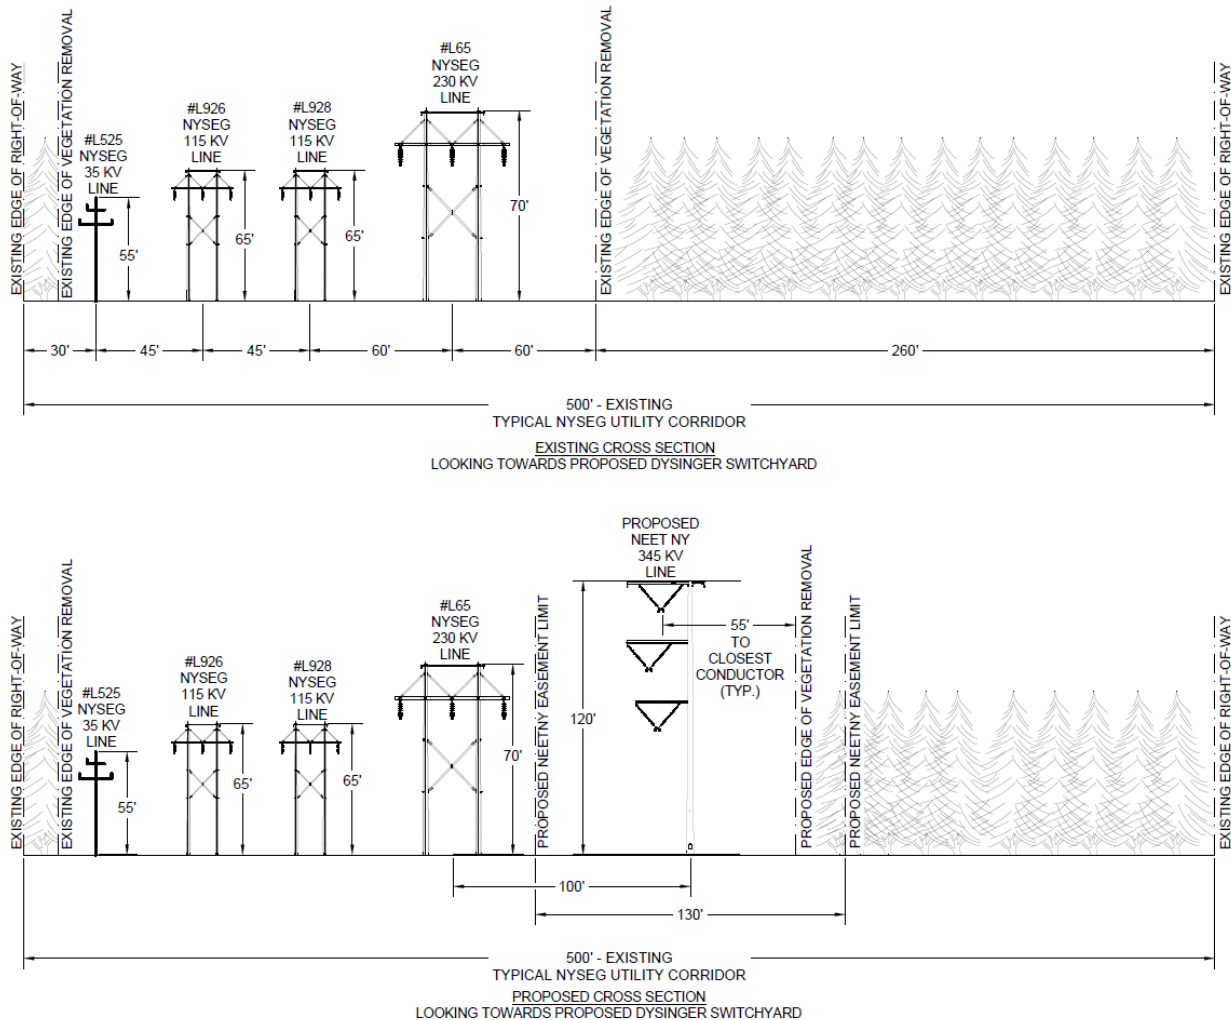


Figure 12 - EXISTING & PROPOSED CROSS SECTION 7

Cross Section 8

The proposed cross section consists of one overhead 345kV transmission line with steel monopoles and adjacent 230kV, 115kV, and 115kV transmission lines spanning from mile 15.324 to mile 20.544. The NEETNY ROW width is 130ft.

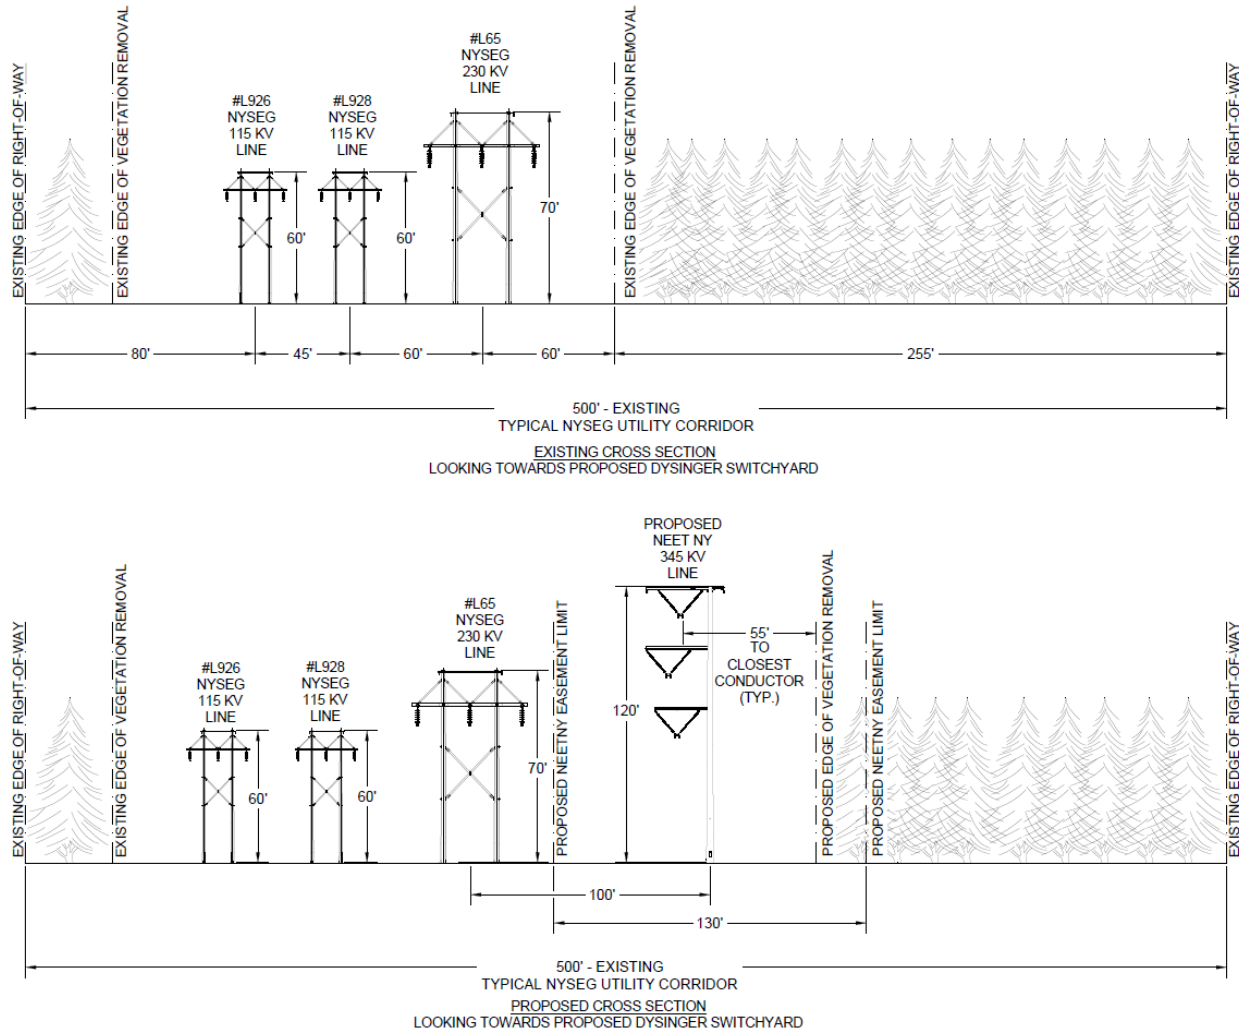


Figure 13 - EXISTING & PROPOSED CROSS SECTION 8

Cross Section 9

The proposed cross section consists of two double circuit overhead 345kV transmission lines with steel monopoles (Cut in from NYPA lines) spanning from NYPA Tap to Dysinger. The NYPA easement width is 368ft.

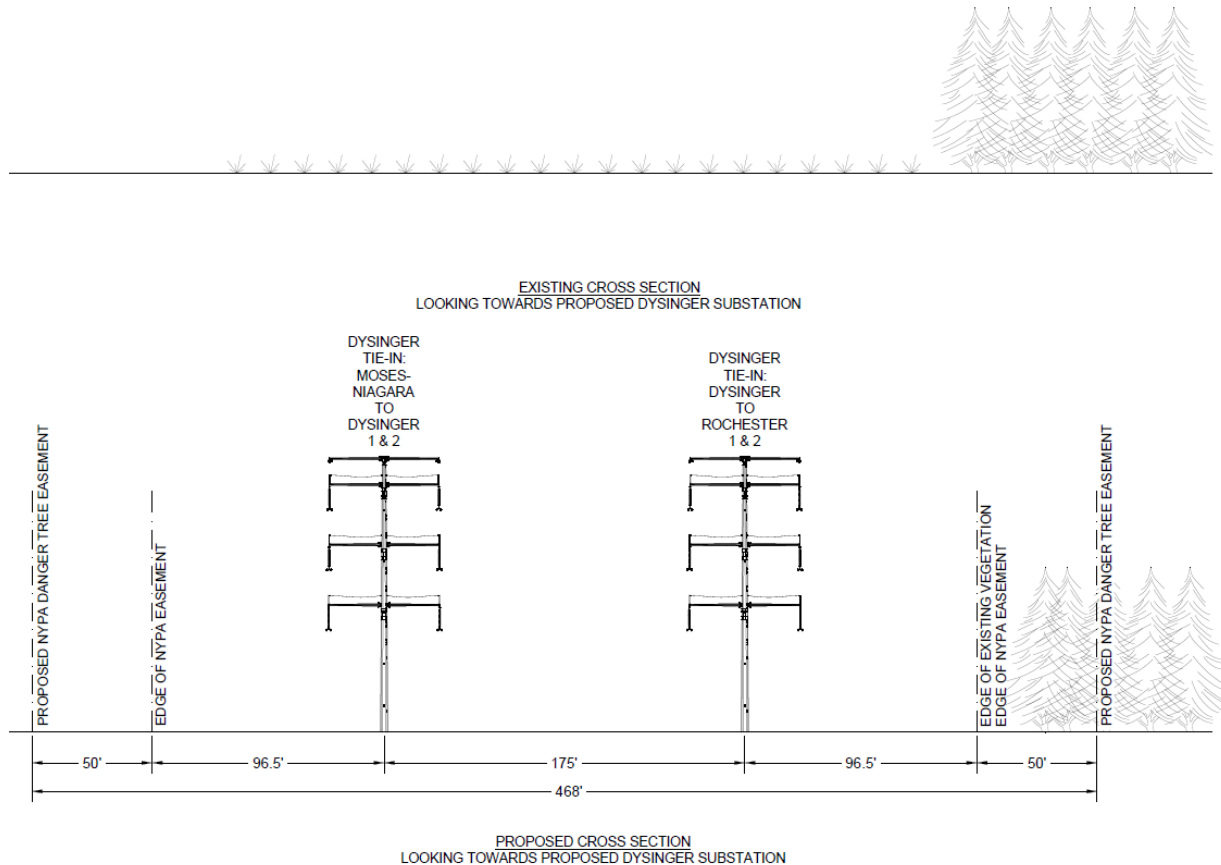


Figure 14 - EXISTING & PROPOSED CROSS SECTION 9

Cross Section 10

The proposed cross section consists of one double circuit overhead 345kV transmission line with steel monopoles spanning from East Stolle to Stolle Rd. The NYSEG ROW width is 825ft.

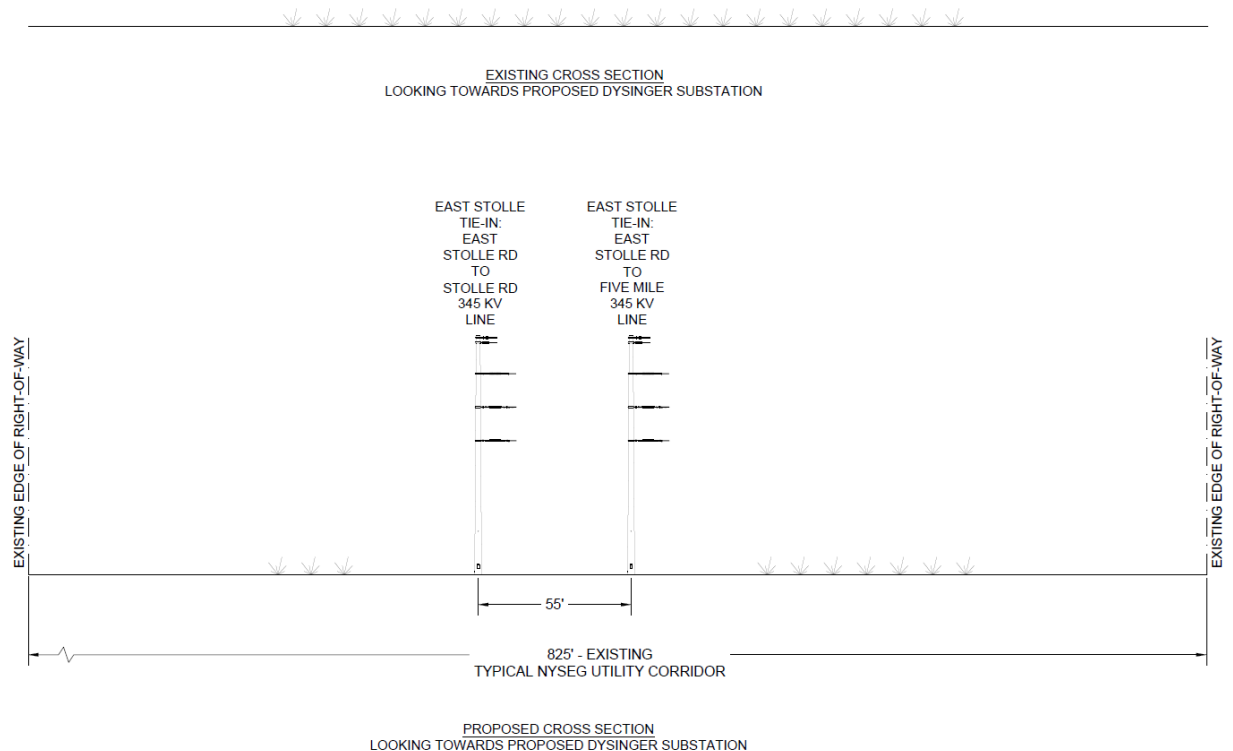


Figure 15 - EXISTING & PROPOSED CROSS SECTION 10

Cross Section 11

The proposed cross section consists of a 345kV underground transmission line and adjacent 230kV and 115kV transmission lines spanning from mile 10.17 to mile 10.568. The NEET ROW width is 130ft.

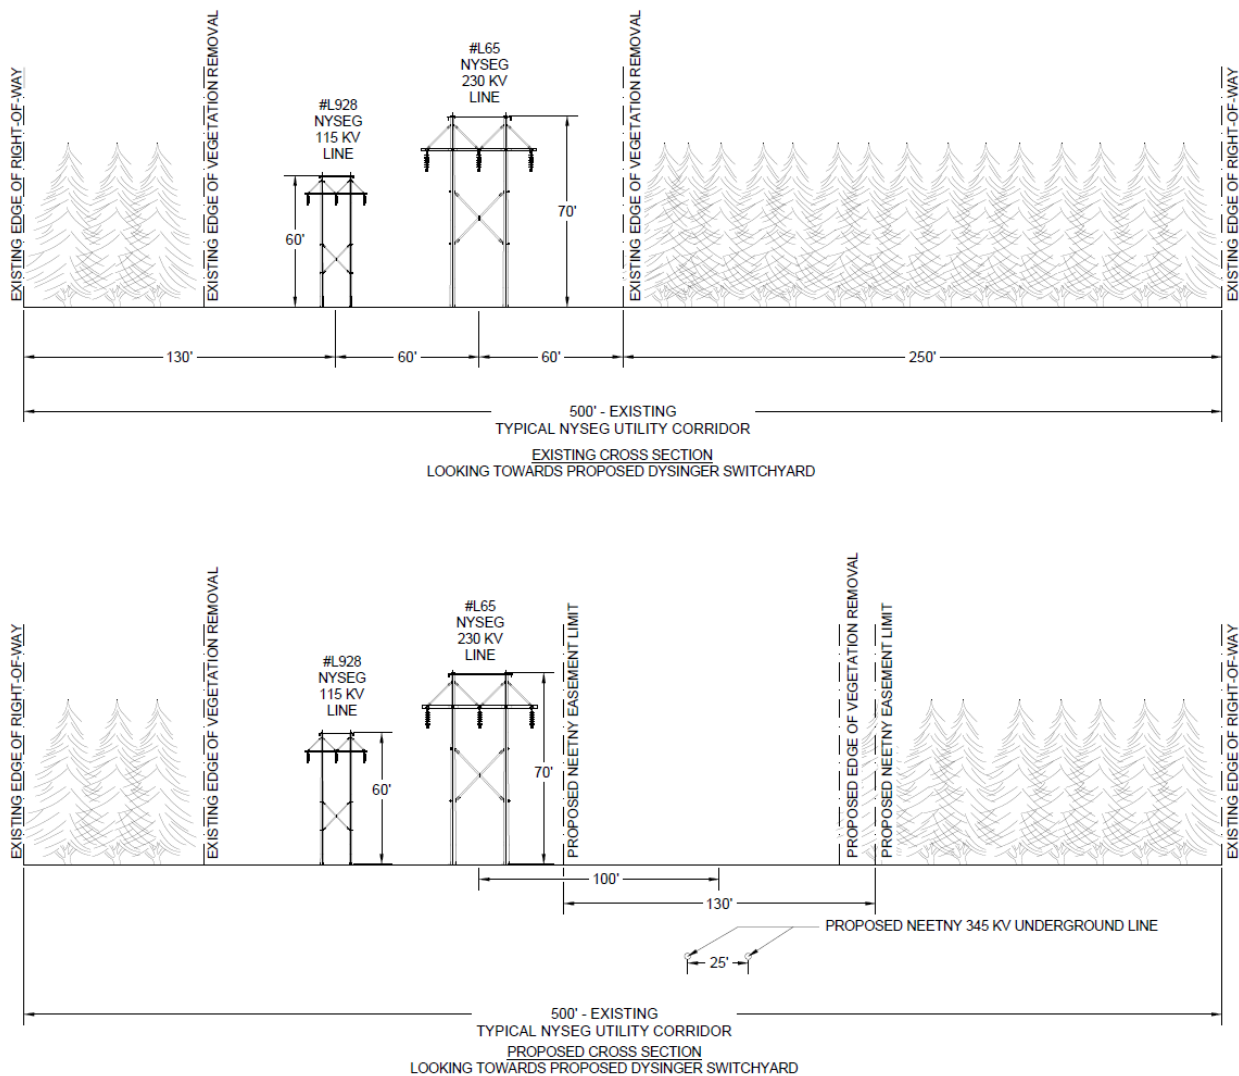


Figure 16 - EXISTING & PROPOSED CROSS SECTION 11

4.0 RESULTS

4.1 EMF RESULTS TABLE

The EMF results shown are for the available 500' ROW owned by NYSEG and the edge of the proposed ROW.

Table 4 - EMF RESULTS

Case Designation	Edge of NYSEG 500' Utility Corridor	Edge of Proposed ROW	Within ROW Maximum EMF	NYPSC Criteria at Edge of ROW
Electric Field (kV/m)				
Existing ROW Segment 1	n/a	n/a	n/a	1.6 kV/m
Proposed ROW Segment 1	n/a	.73	5.79	1.6 kV/m
Existing ROW Segment 2	.77	n/a	7.07	1.6 kV/m
Proposed ROW Segment 2	.19	.19	4.50	1.6 kV/m
Existing ROW Segment 3	.03	n/a	4.47	1.6 kV/m
Proposed ROW Segment 3	.11	.21	8.95	1.6 kV/m
Existing ROW Segment 4	.04	n/a	4.52	1.6 kV/m
Proposed ROW Segment 4	.10	.12	8.96	1.6 kV/m
Existing ROW Segment 5	.04	n/a	4.52	1.6 kV/m
Proposed ROW Segment 5	.10	.20	8.96	1.6 kV/m
Existing ROW Segment 6	.10	n/a	4.51	1.6 kV/m
Proposed ROW Segment 6	.14	.10	7.38	1.6 kV/m
Existing ROW Segment 7	.20	n/a	4.52	1.6 kV/m
Proposed ROW Segment 7	.21	.06	6.46	1.6 kV/m
Existing ROW Segment 8	.10	n/a	4.52	1.6 kV/m
Proposed ROW Segment 8	.19	.18	8.48	1.6 kV/m
Existing ROW Segment 9	n/a	n/a	n/a	1.6 kV/m
Proposed ROW Segment 9*	n/a	.36	8.72	1.6 kV/m
Existing ROW Segment 10	n/a	n/a	n/a	1.6 kV/m
Proposed ROW Segment 10	n/a	.07	5.19	1.6 kV/m
Existing ROW Segment 11	.04	n/a	4.52	1.6 kV/m
Proposed ROW Segment 11	.10	.20	8.96	1.6 kV/m
Magnetic Field (mG)				
Existing ROW Segment 1	n/a	n/a	n/a	200 mG
Proposed ROW Segment 1	n/a	85.09	168.43	200 mG
Existing ROW Segment 2	61.27	n/a	439.60	200 mG
Proposed ROW Segment 2	45.54	45.54	521.41	200 mG
Existing ROW Segment 3	10.67	n/a	516.29	200 mG
Proposed ROW Segment 3	11.07	55.88	545.38	200 mG

Table 4 - EMF RESULTS



Case Designation	Edge of NYSEG 500' Utility Corridor	Edge of Proposed ROW	Within ROW Maximum EMF	NYPSC Criteria at Edge of ROW
Existing ROW Segment 4	16.53	n/a	504.12	200 mG
Proposed ROW Segment 4	16.65	86.01	528.72	200 mG
Existing ROW Segment 5	16.53	n/a	504.12	200 mG
Proposed ROW Segment 5	16.65	57.58	528.72	200 mG
Existing ROW Segment 6	36.90	n/a	501.98	200 mG
Proposed ROW Segment 6	39.38	57.10	528.09	200 mG
Existing ROW Segment 7	64.66	n/a	495.76	200 mG
Proposed ROW Segment 7	67.39	57.71	522.41	200 mG
Existing ROW Segment 8	34.84	n/a	497.90	200 mG
Proposed ROW Segment 8	35.03	58.71	522.56	200 mG
Existing ROW Segment 9	n/a	n/a	n/a	200 mG
Proposed ROW Segment 9*	n/a	86.20	243.70	200 mG
Existing ROW Segment 10	n/a	n/a	n/a	200 mG
Proposed ROW Segment 10	n/a	4.21	127.6	200 mG
Existing ROW Segment 11	16.53	n/a	504.12	200 mG
Proposed ROW Segment 11	16.99	65.04	530.99	200 mG

In conclusion, the results of the study show that the calculated electric and magnetic fields are acceptable when compared to the electric fields requirement of 1.6 kV/m, one meter (3.28 ft.) above ground level, and the magnetic field strength requirement is 200 mG, measured at one meter (3.28 ft.) above grade, at the existing NYSEG and proposed edge of ROW.

See Appendix A for the inputs and results of the Bonneville Power Administration (BPA) Corona and Field Effects and CYMCAP (©CYME International) computer programs.

4.2 EMF PLOTS

Cross Section 1

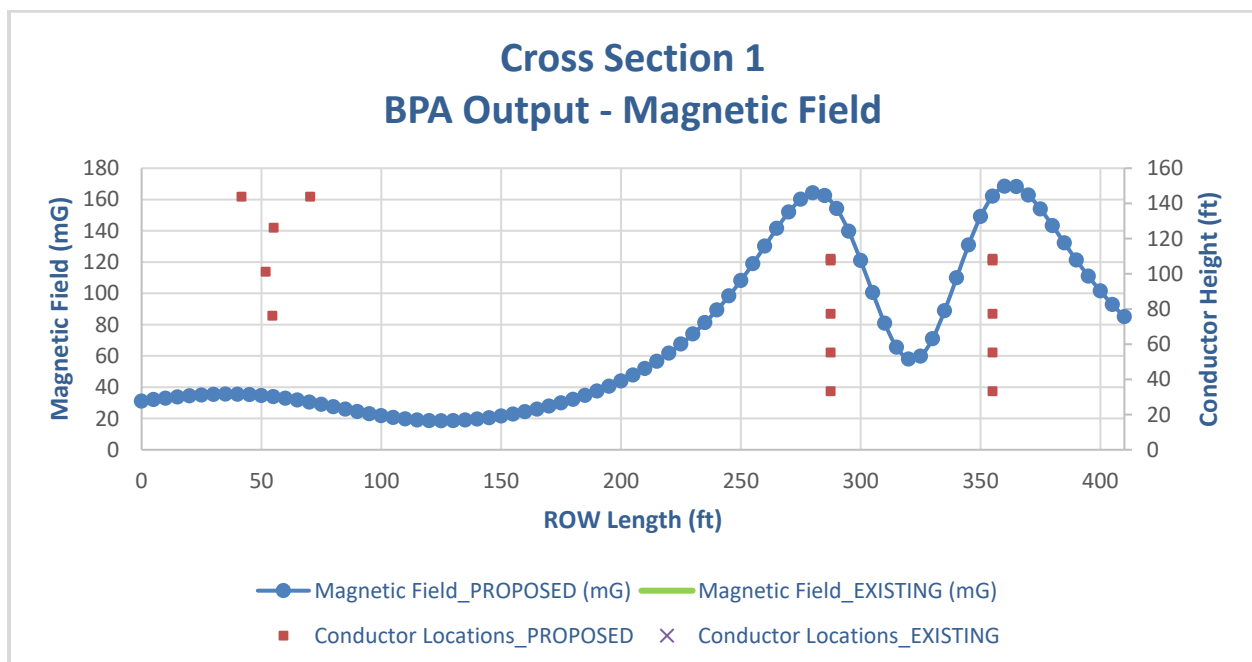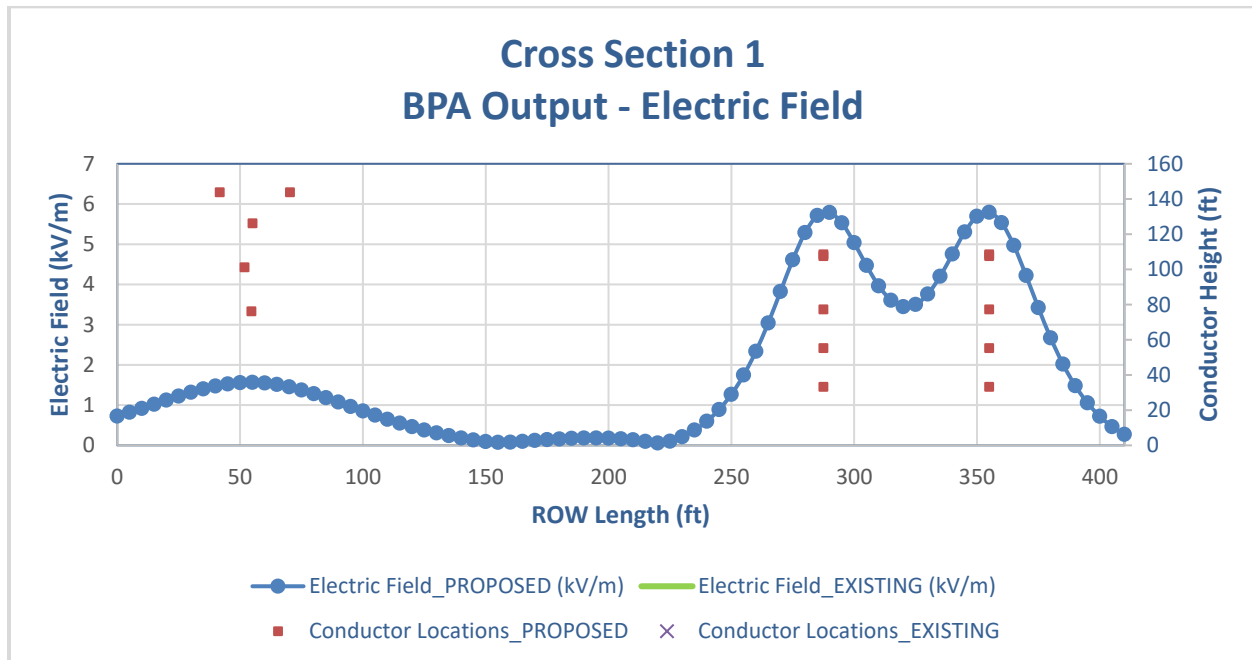

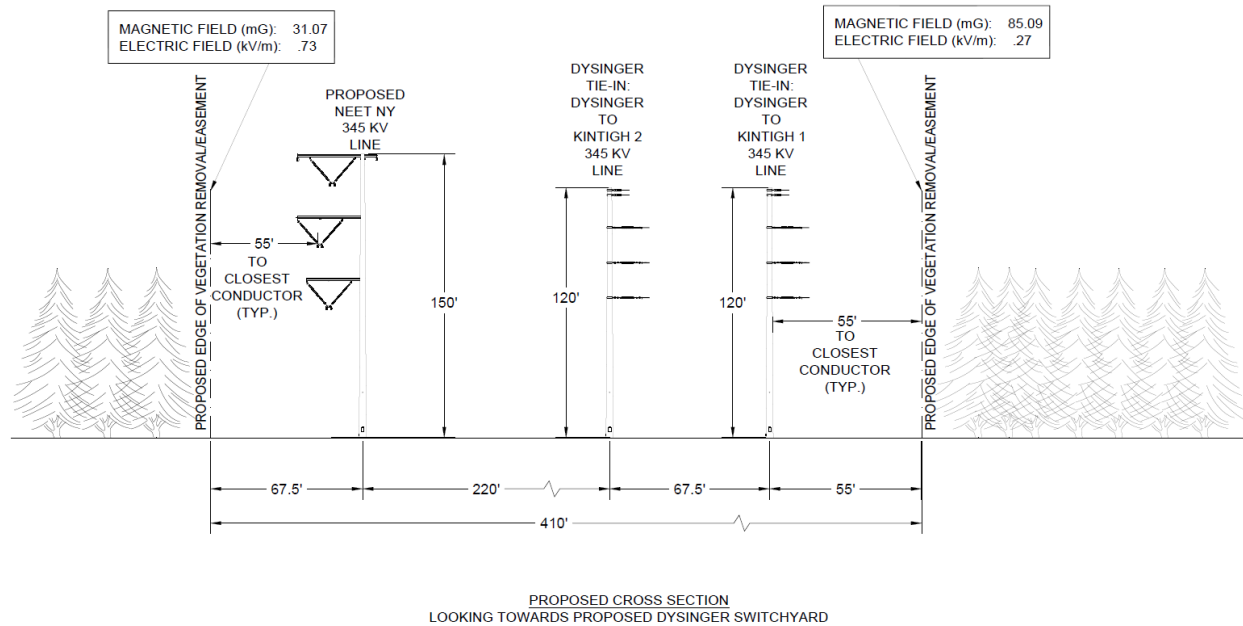
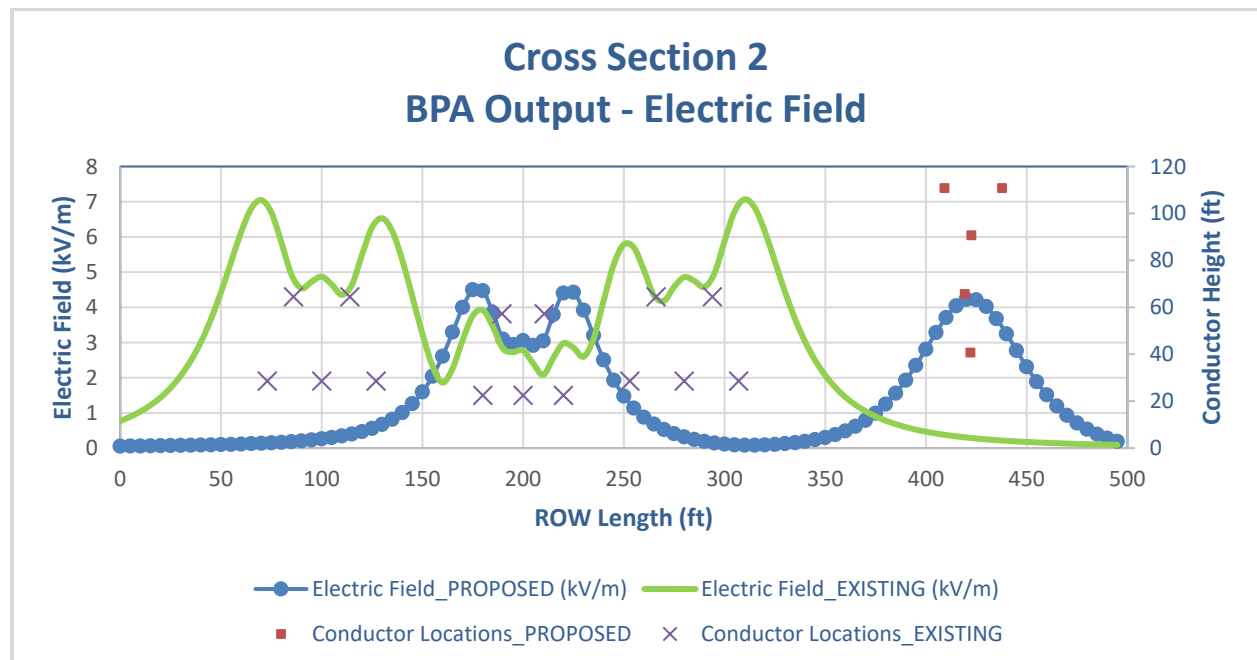


Figure 17 - PROPOSED CROSS SECTION 1 EMF RESULTS

Cross Section 2



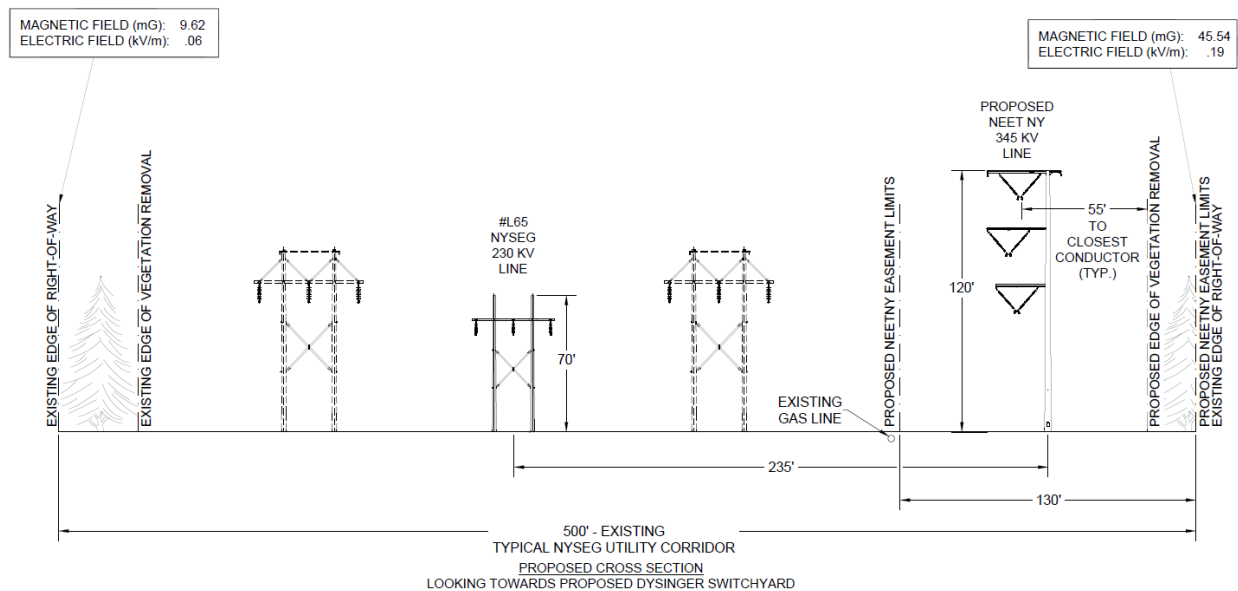
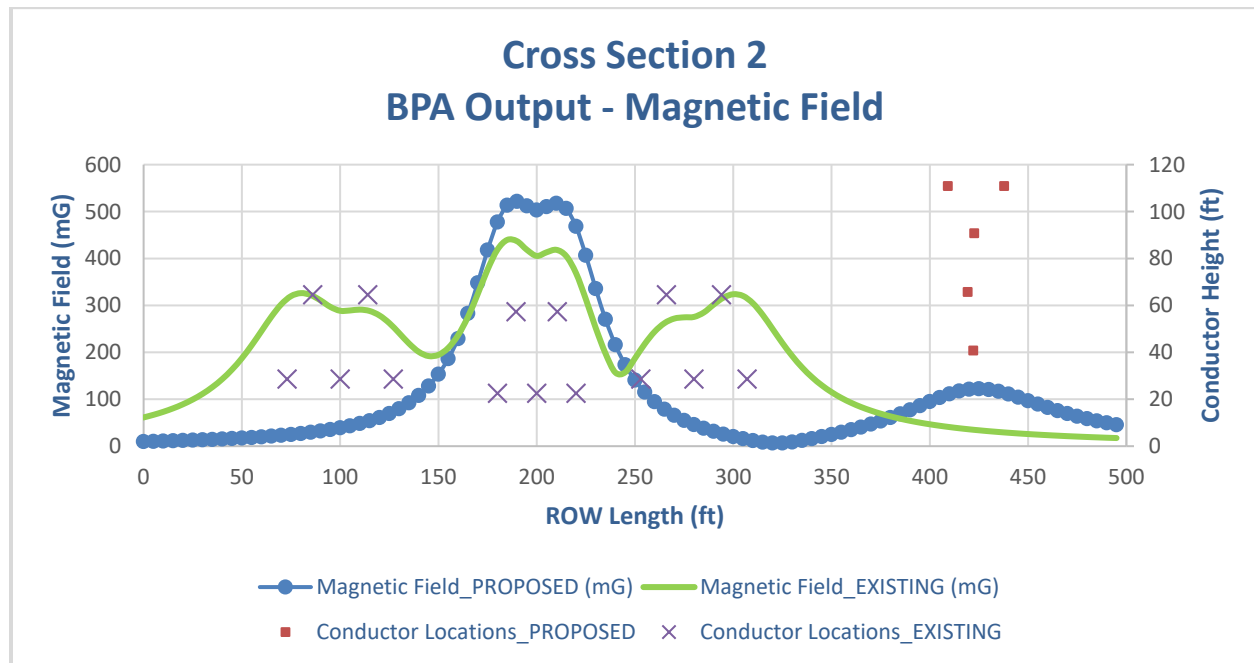
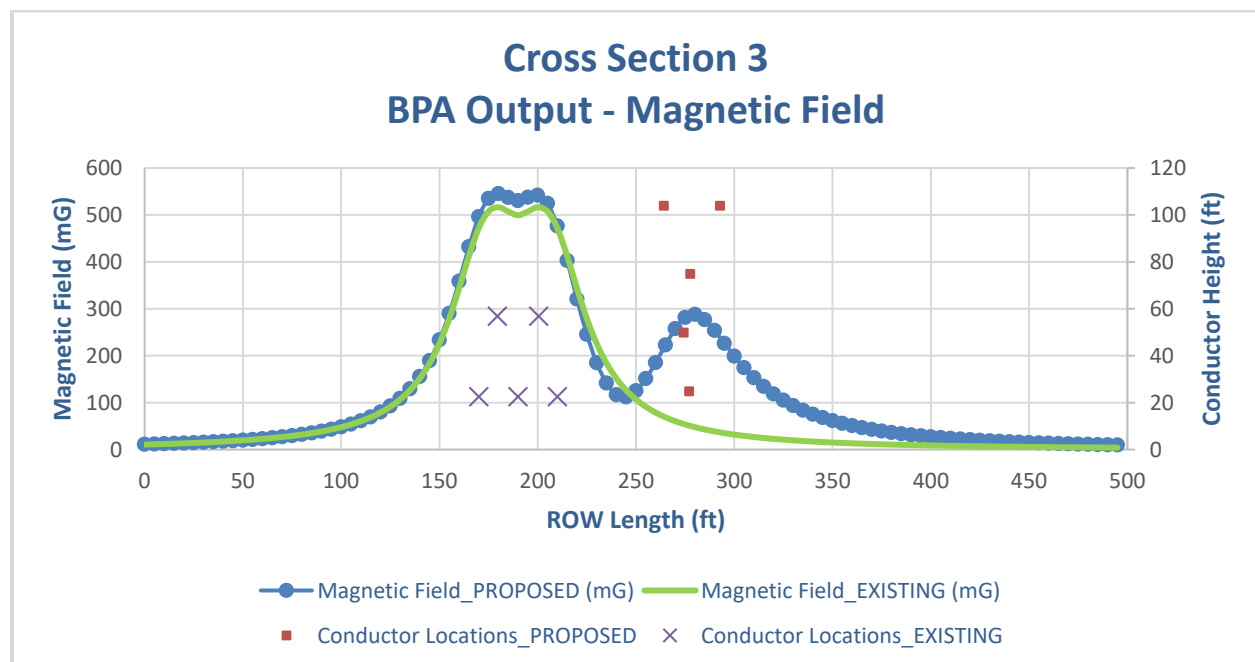
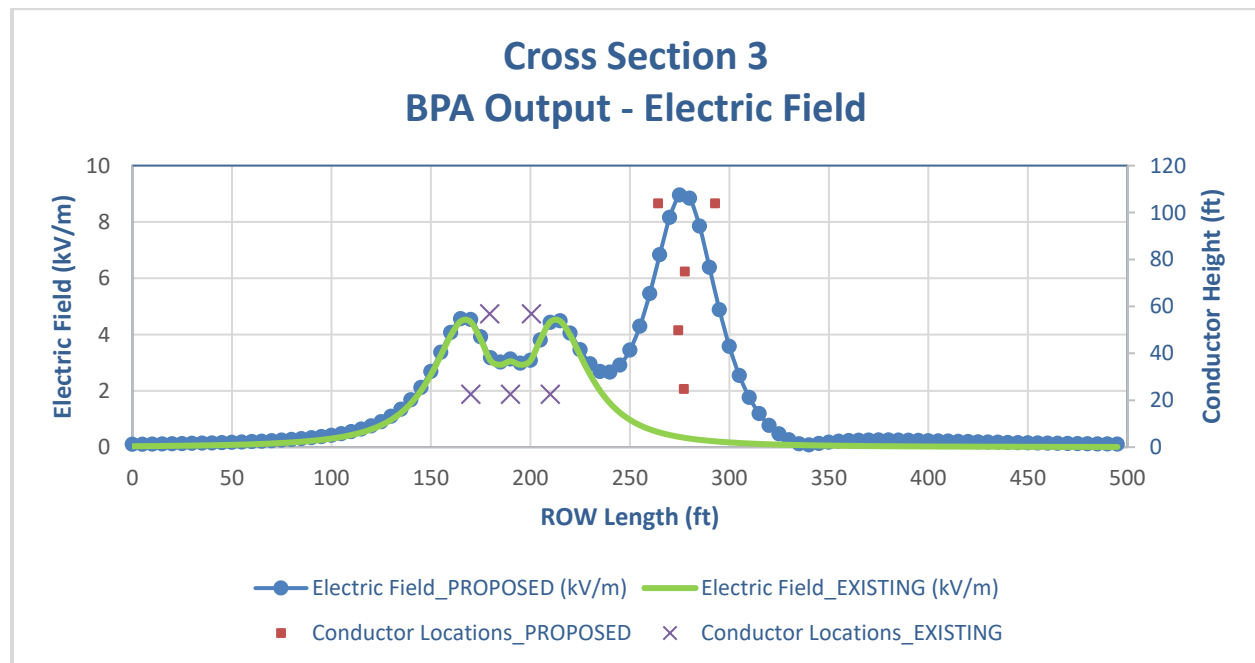


Figure 18 - PROPOSED CROSS SECTION 2 EMF RESULTS

Cross Section 3






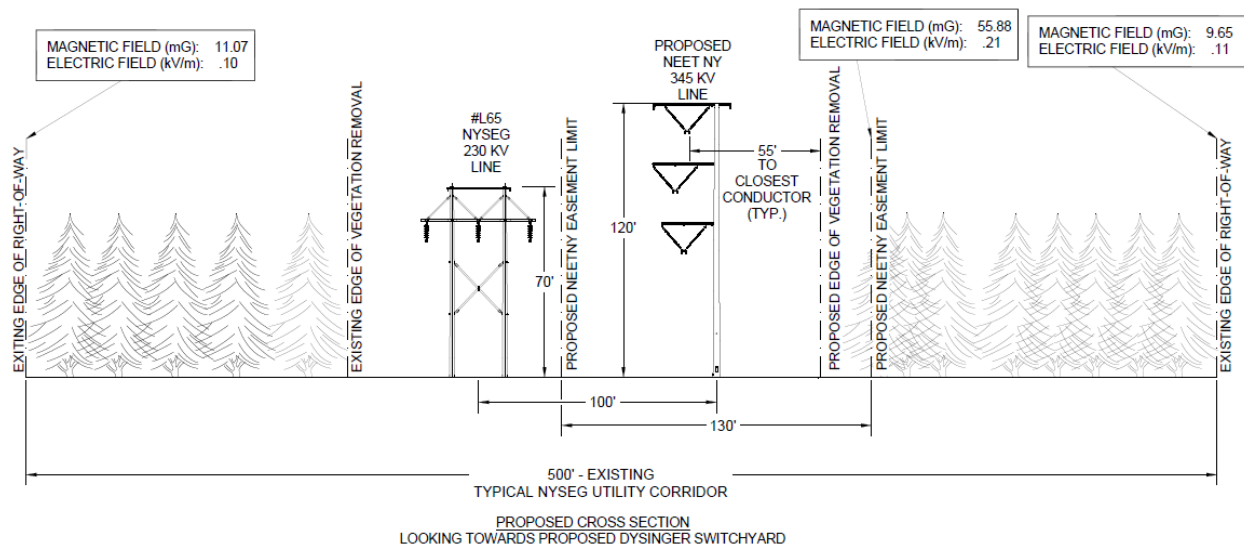


Figure 19 - PROPOSED CROSS SECTION 3 EMF RESULTS

Cross Section 4

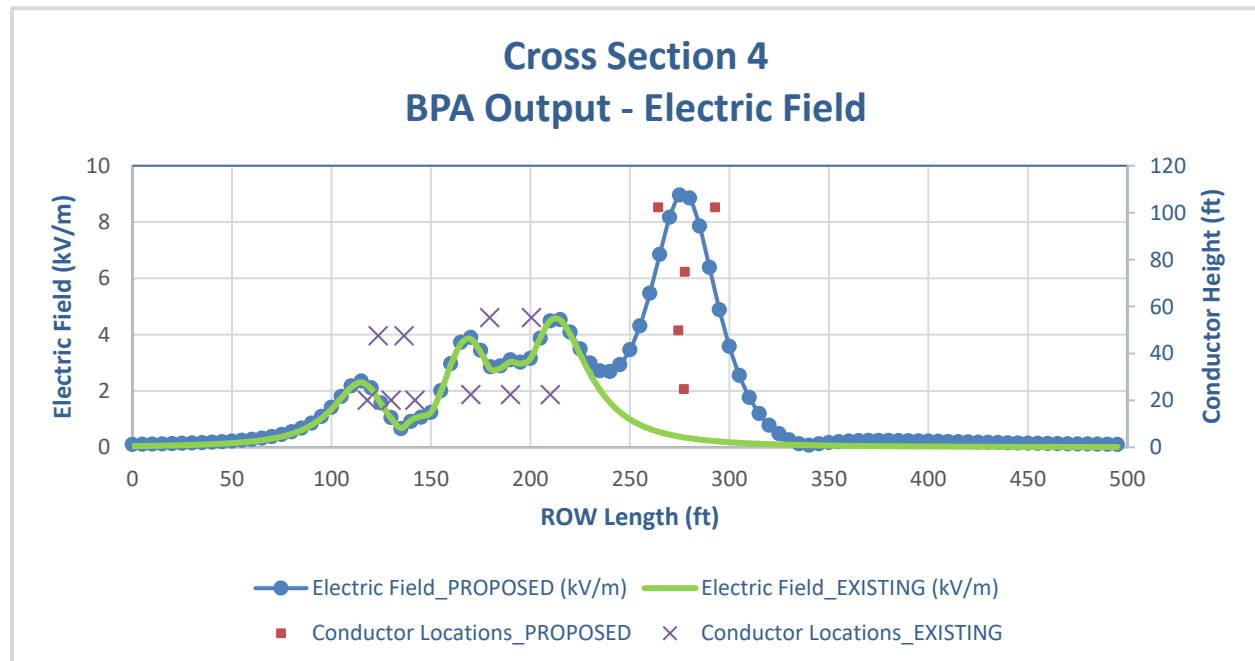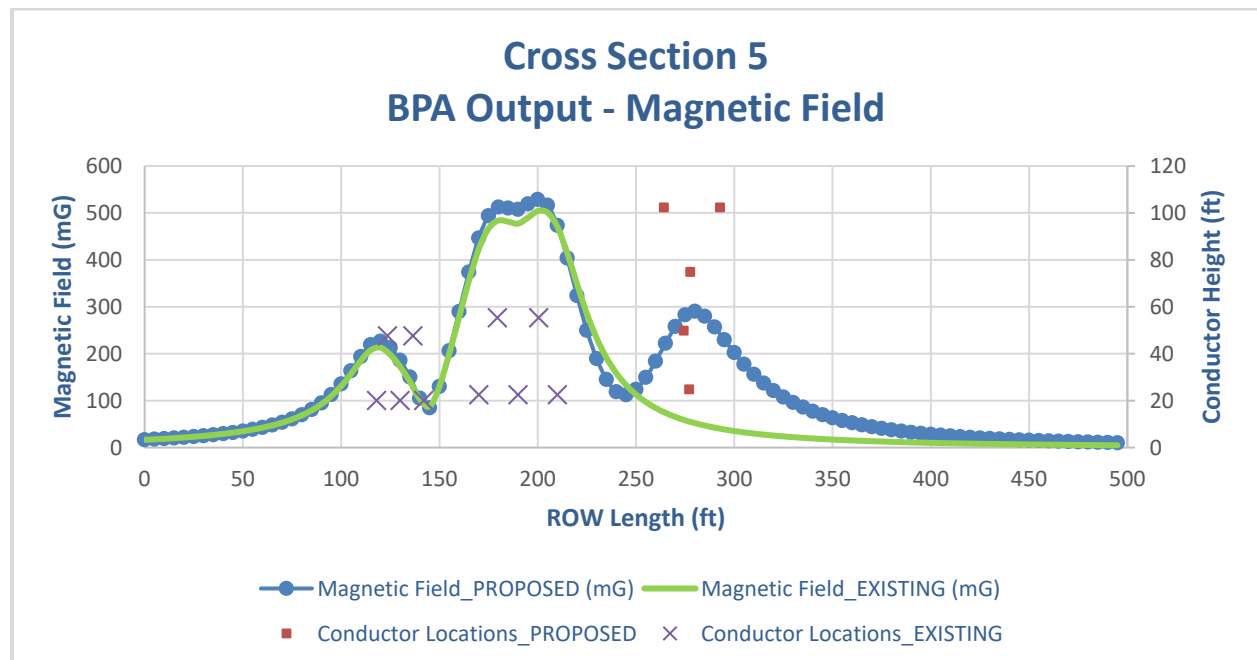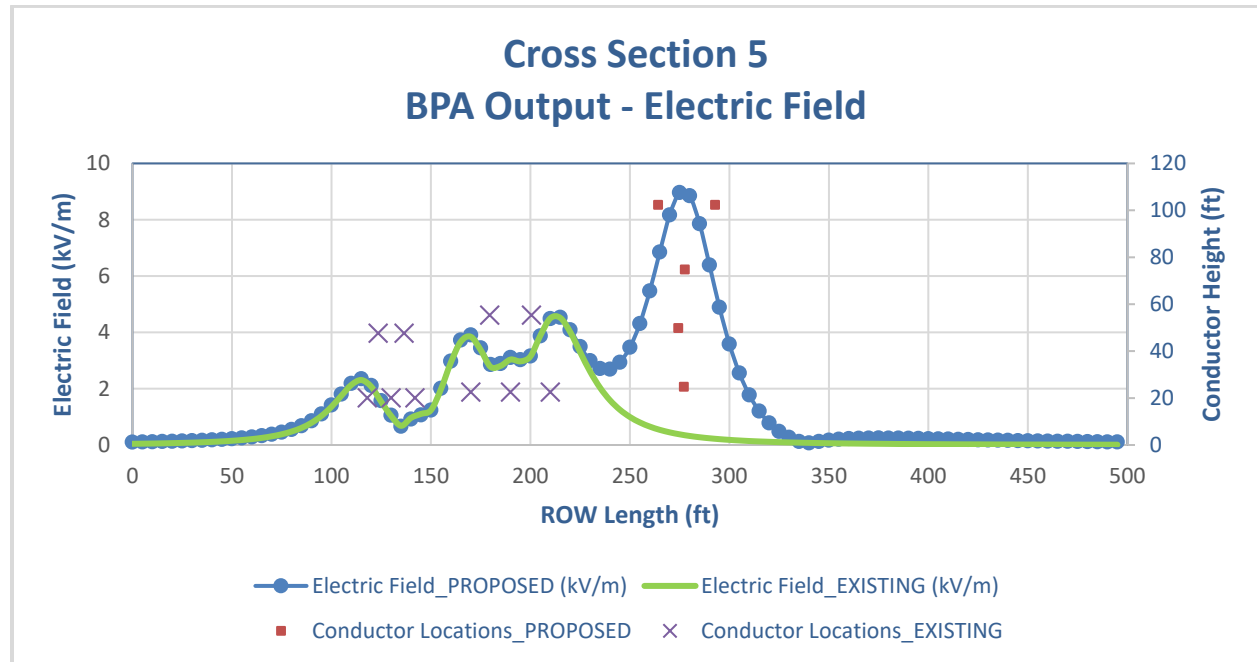

Cross Section 5



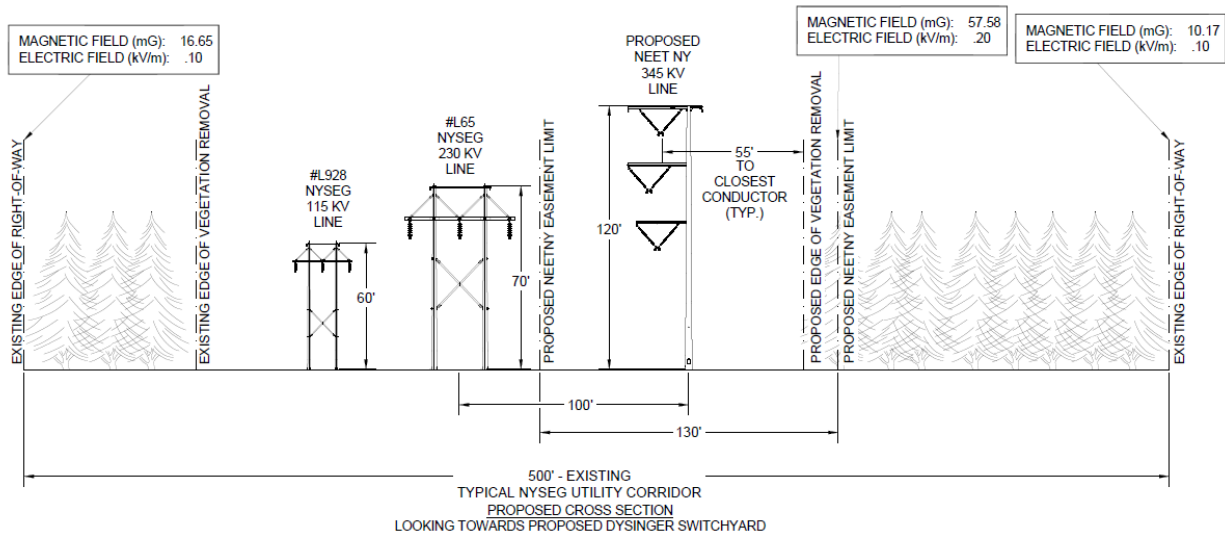
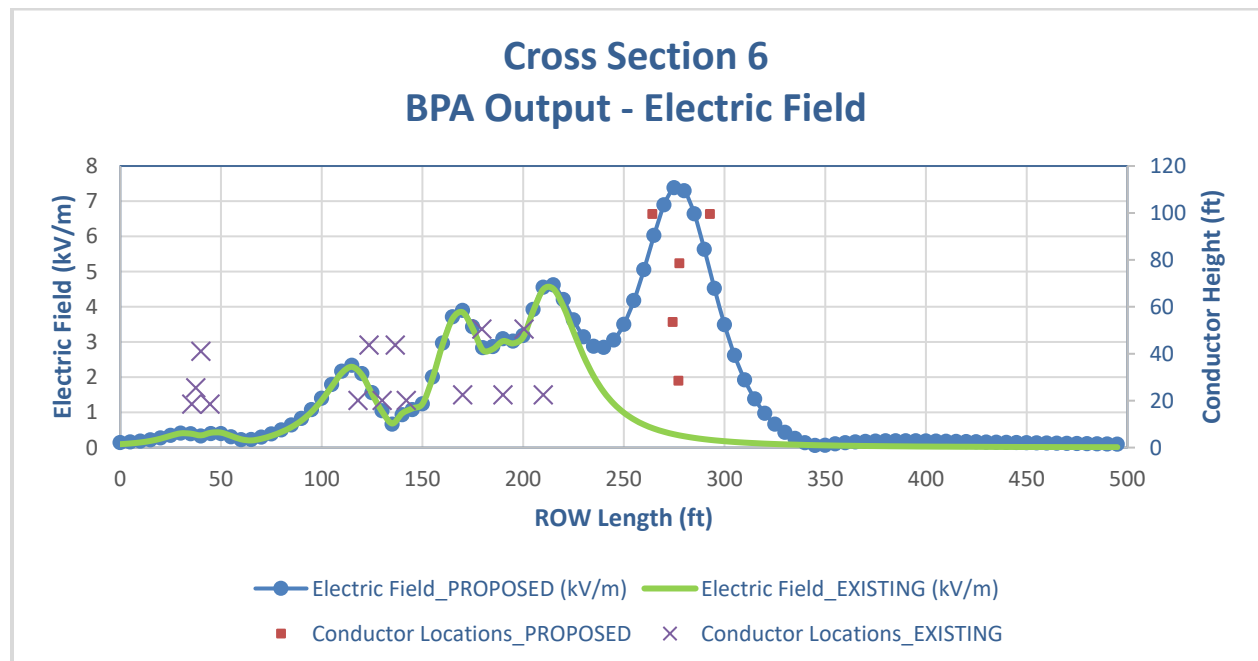


Figure 21 - PROPOSED CROSS SECTION 5 EMF RESULTS

Cross Section 6



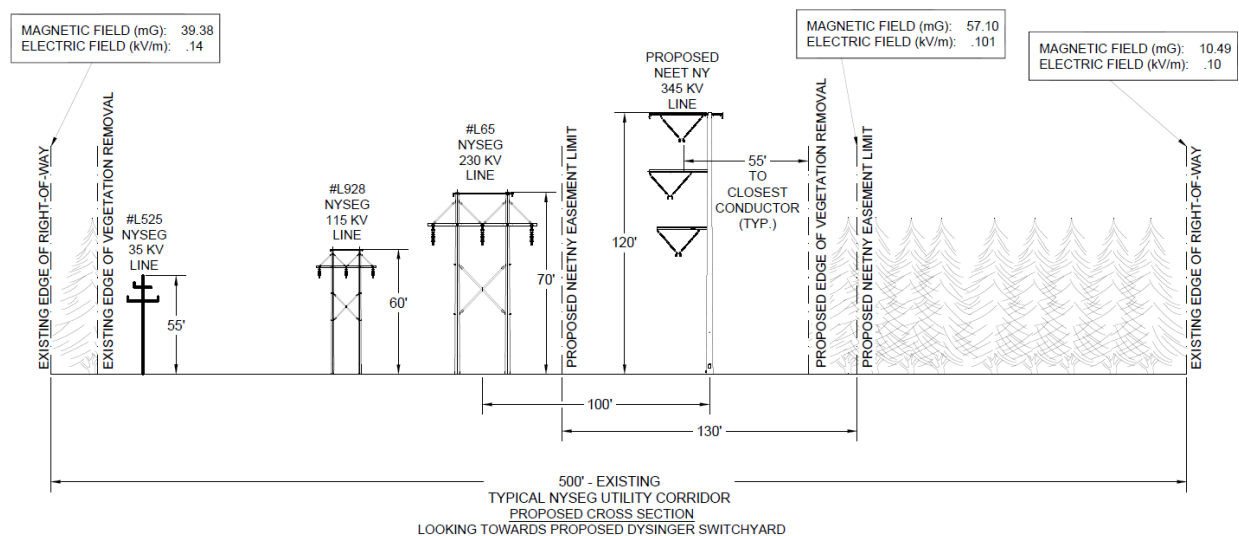
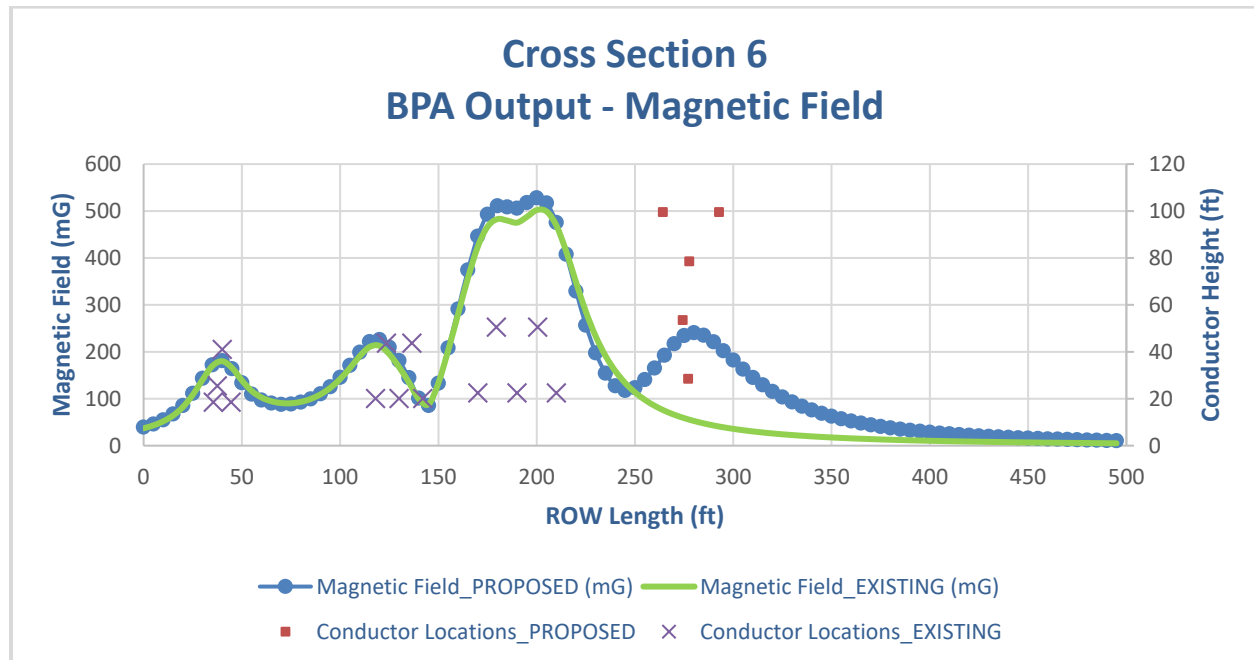
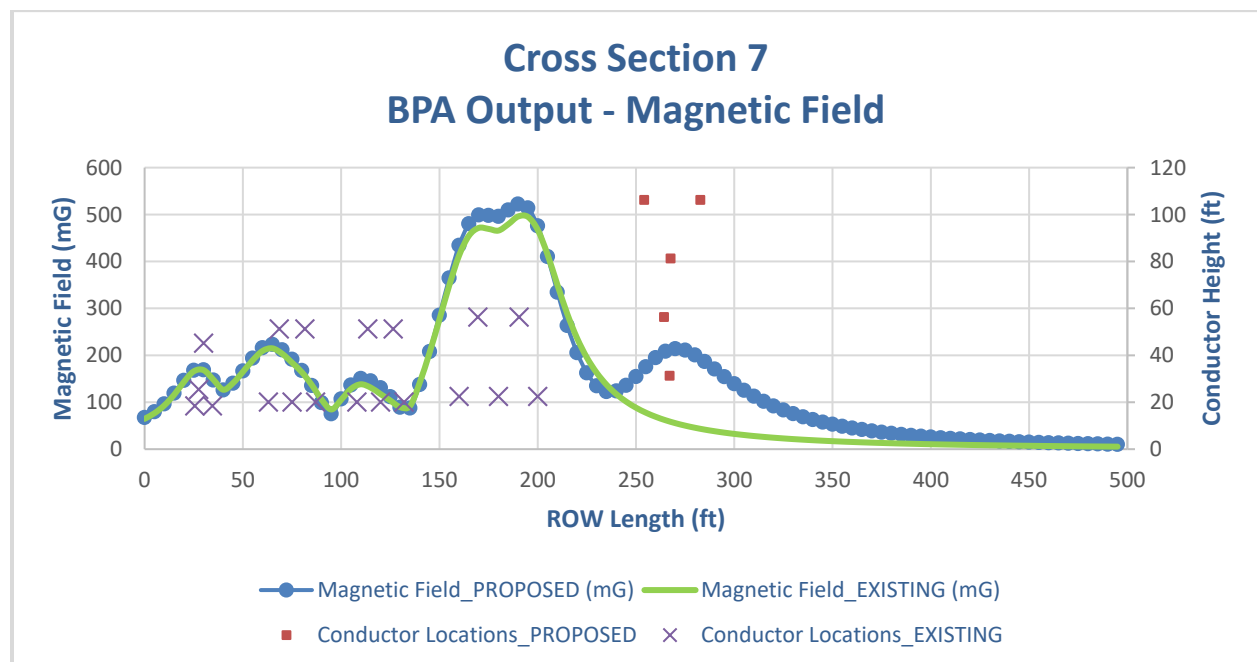
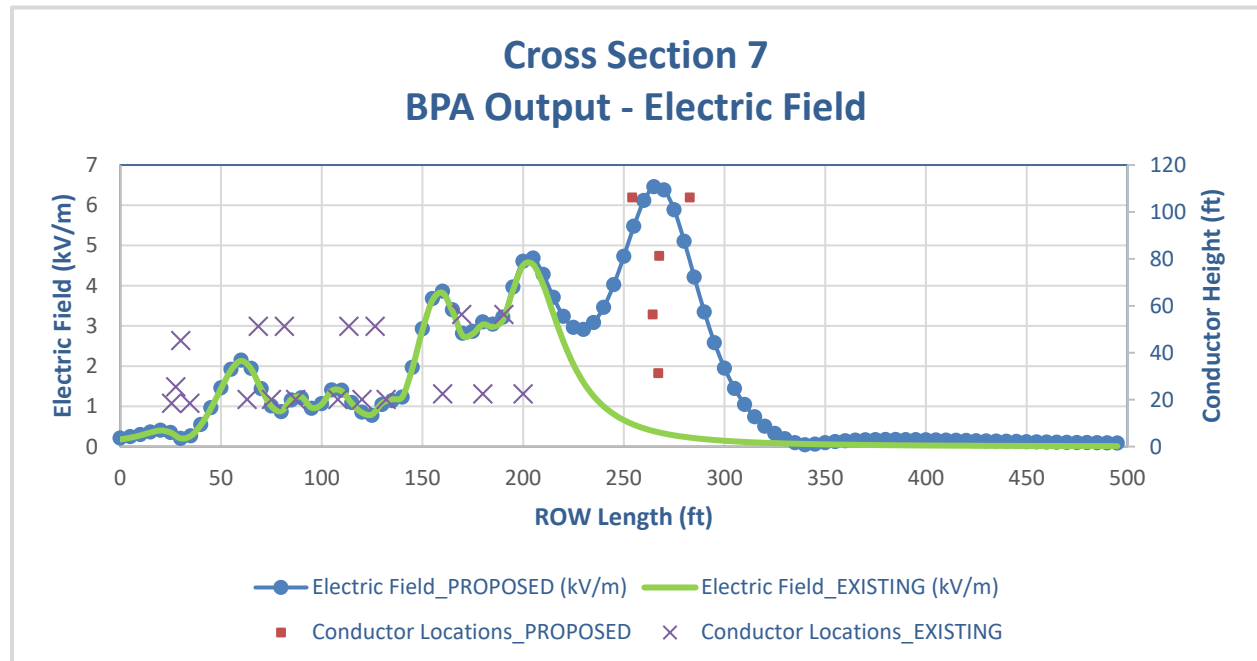


Figure 22 - PROPOSED CROSS SECTION 6 EMF RESULTS

Cross Section 7



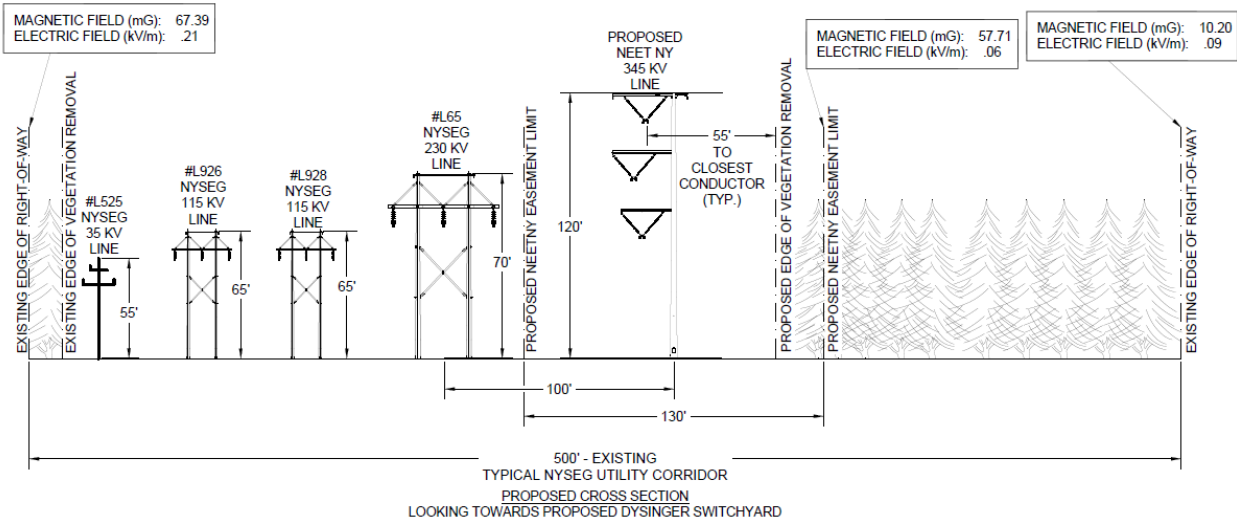
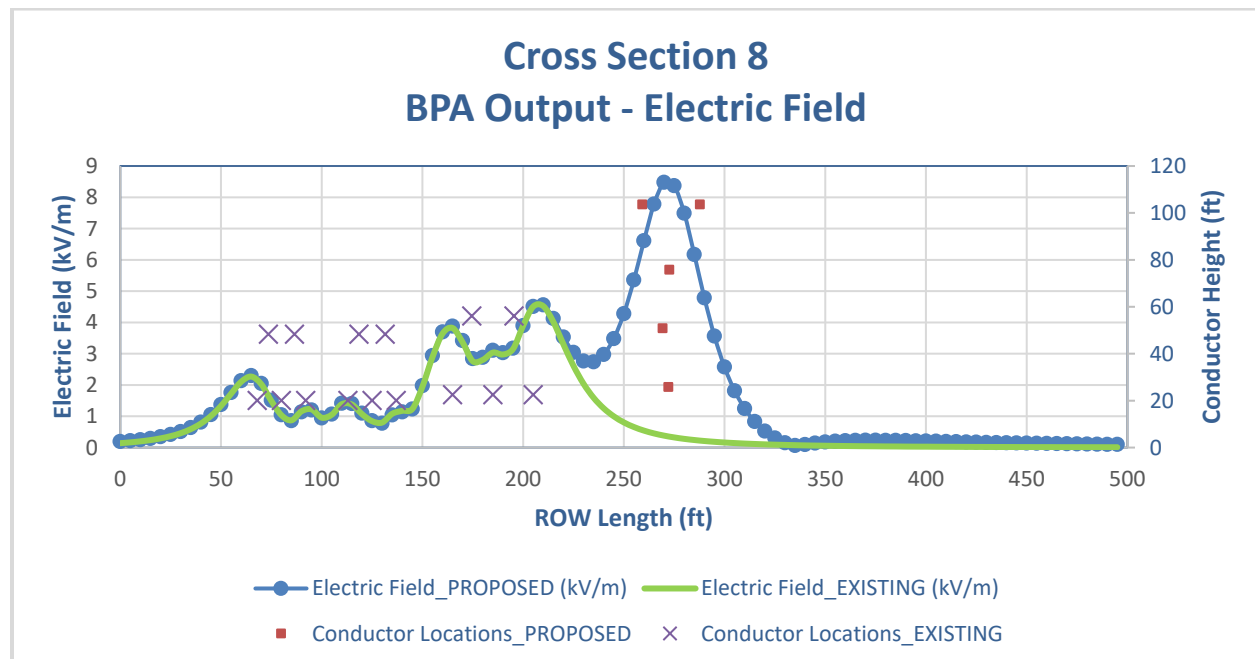


Figure 23 - PROPOSED CROSS SECTION 7 EMF RESULTS

Cross Section 8



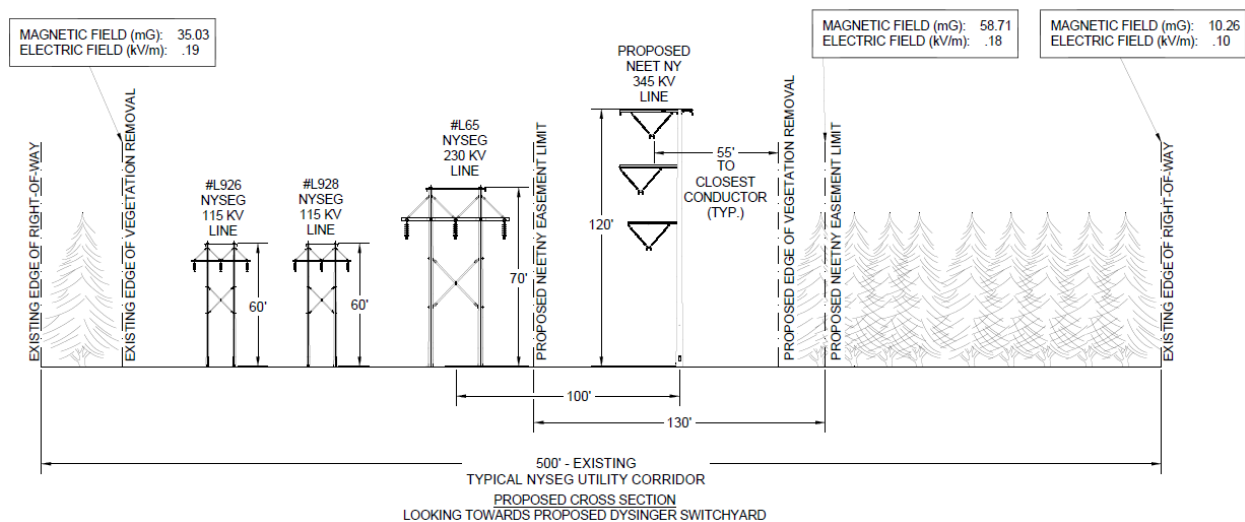
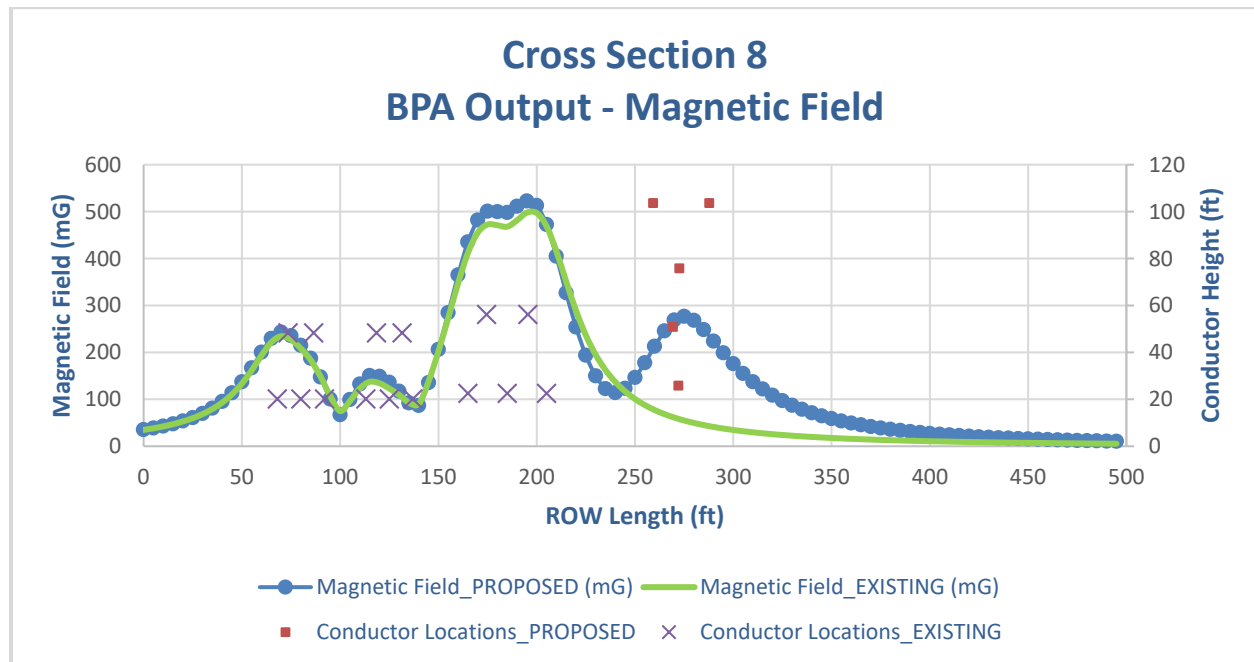
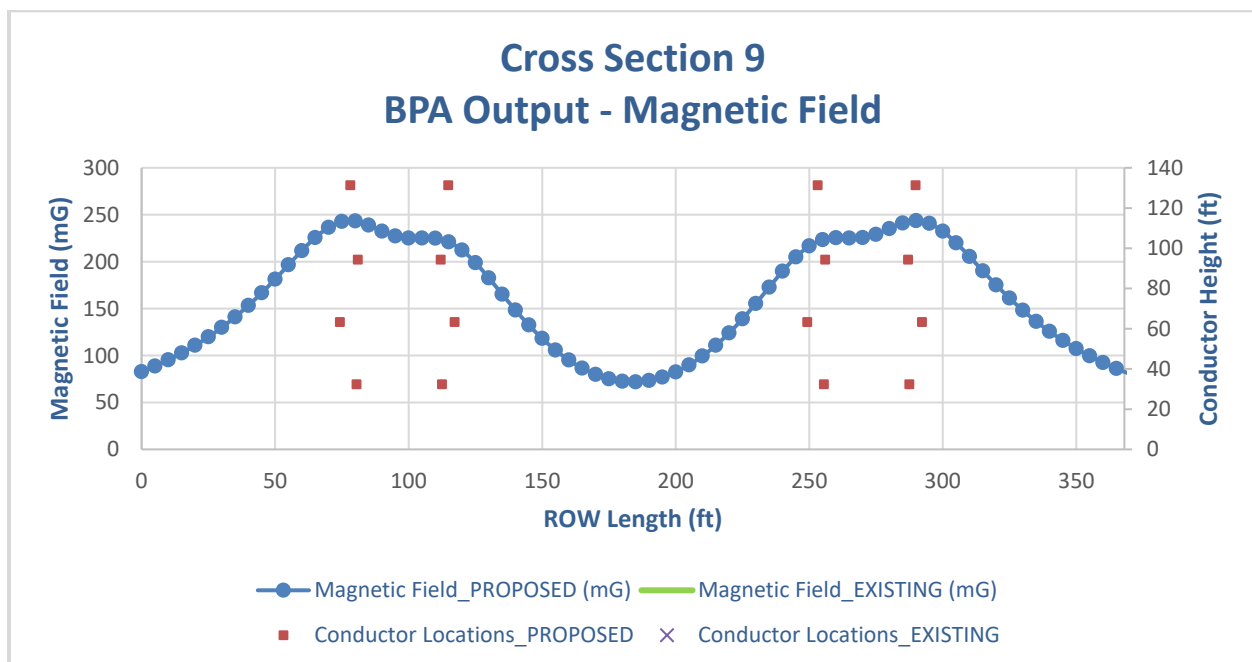
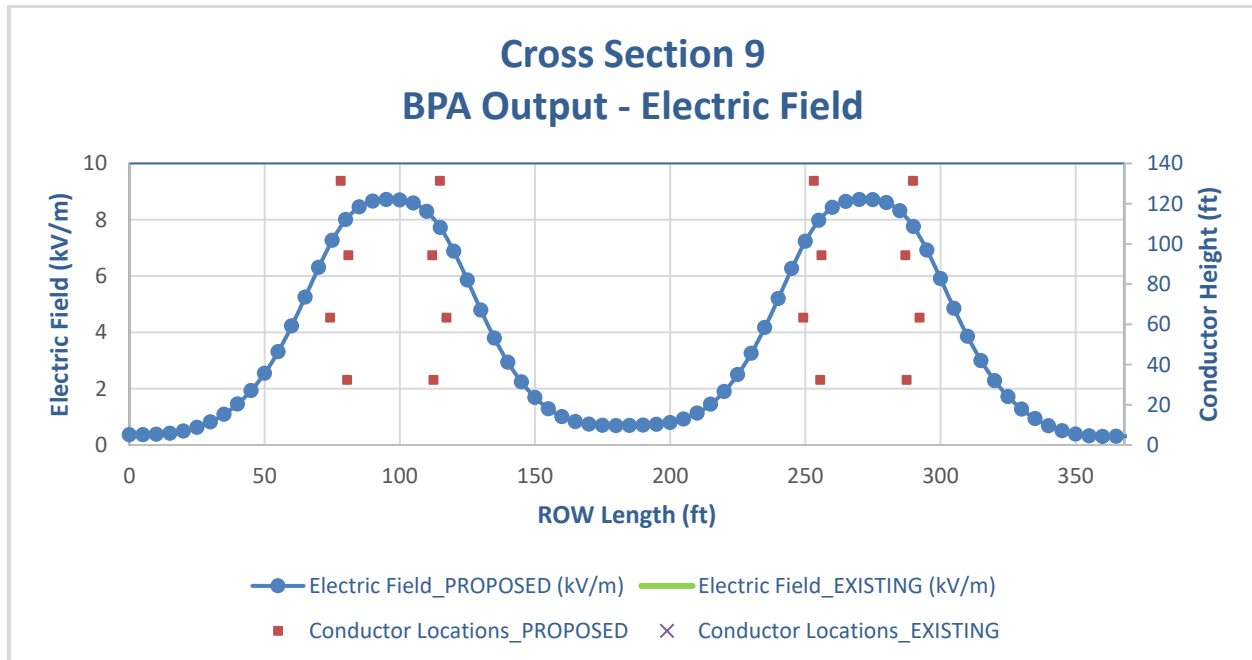


Figure 24 - PROPOSED CROSS SECTION 8 EMF RESULTS

Cross Section 9



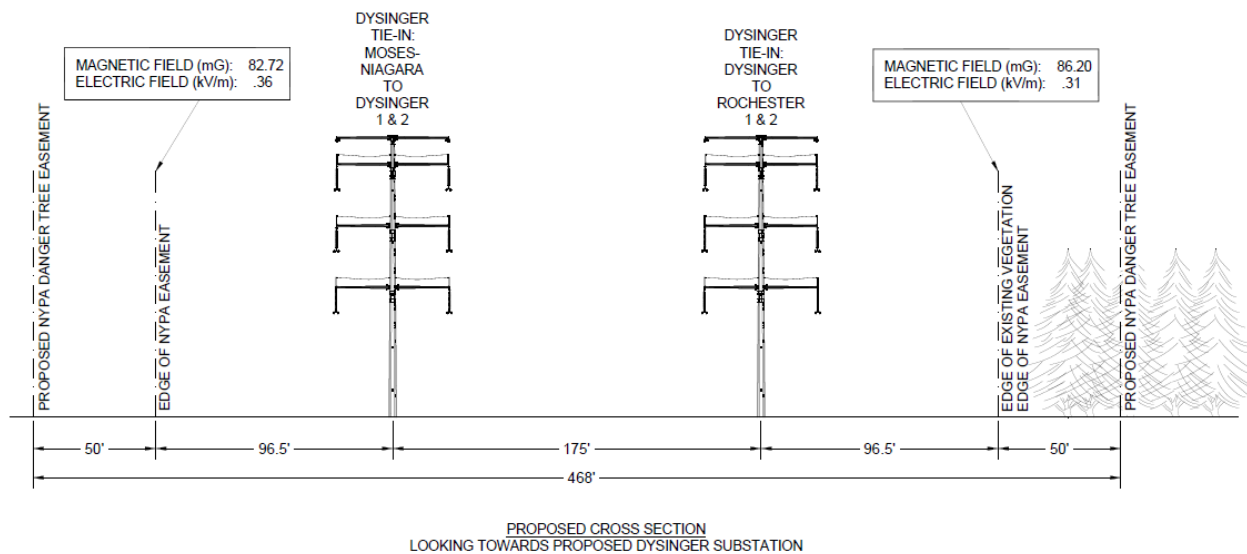
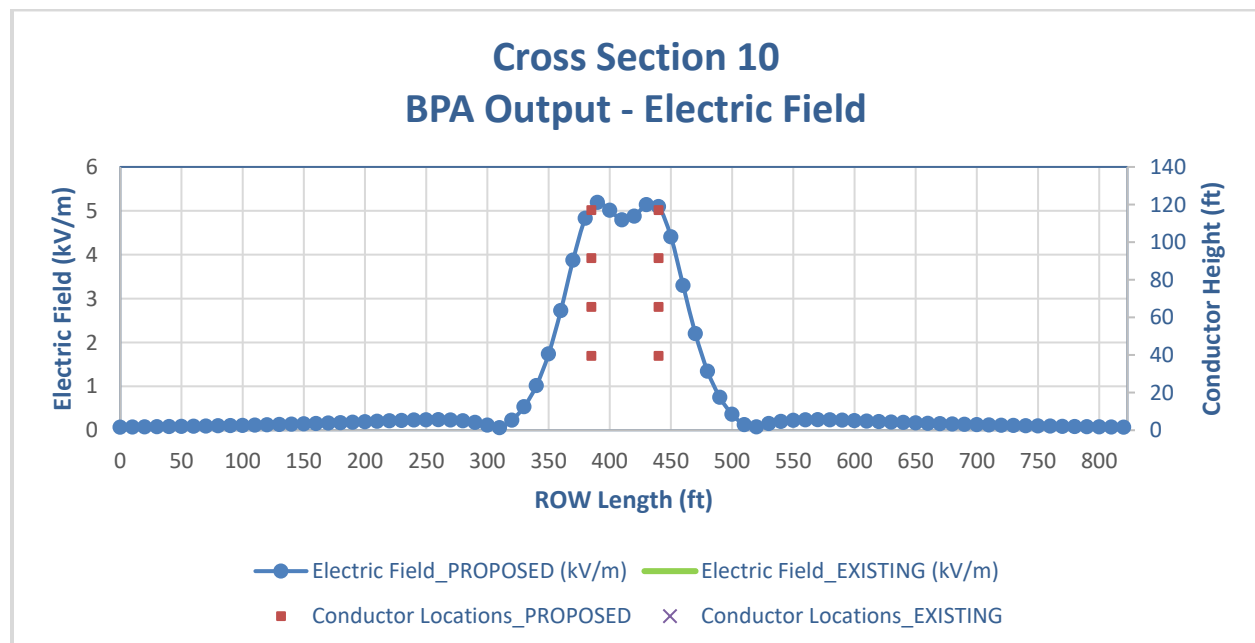


Figure 25 - PROPOSED CROSS SECTION 9 EMF RESULTS

Cross Section 10



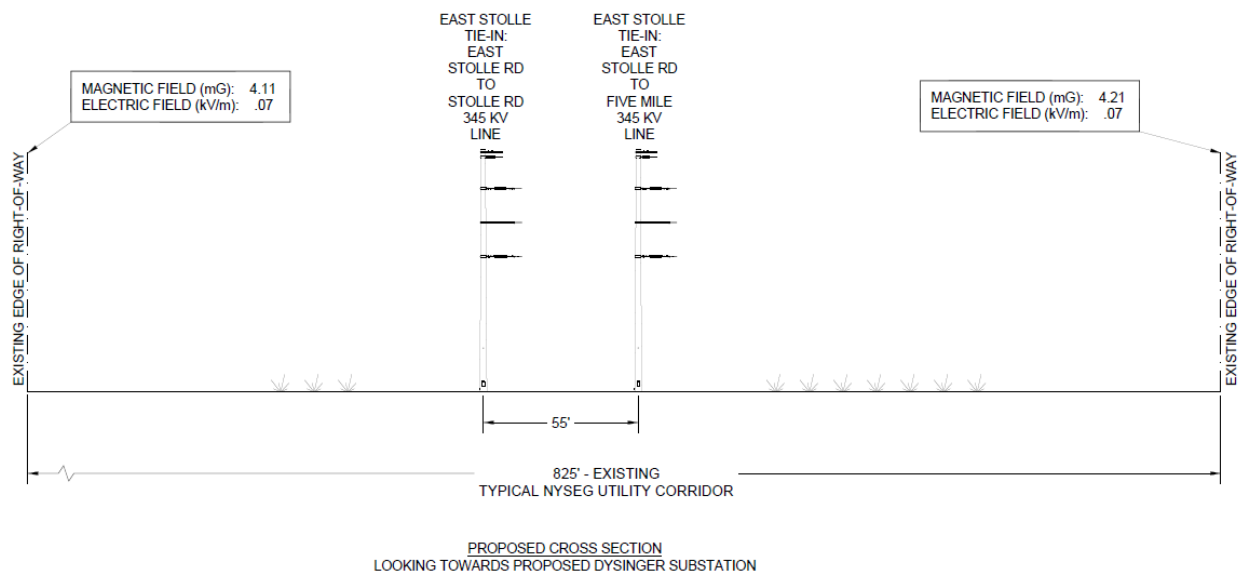
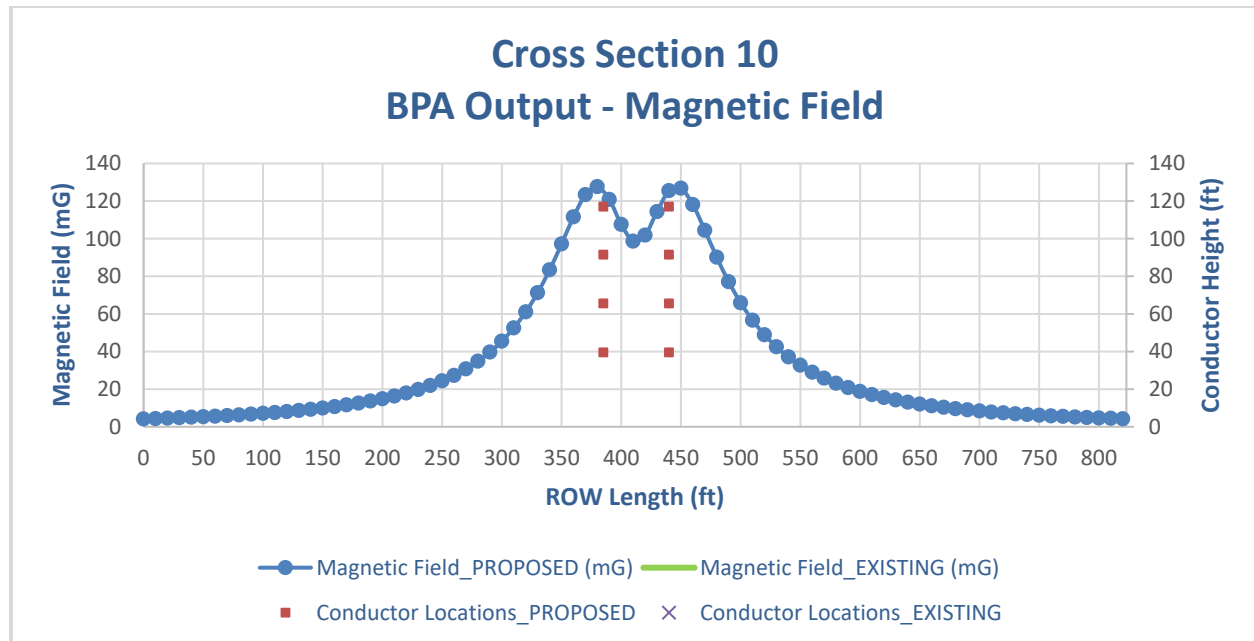
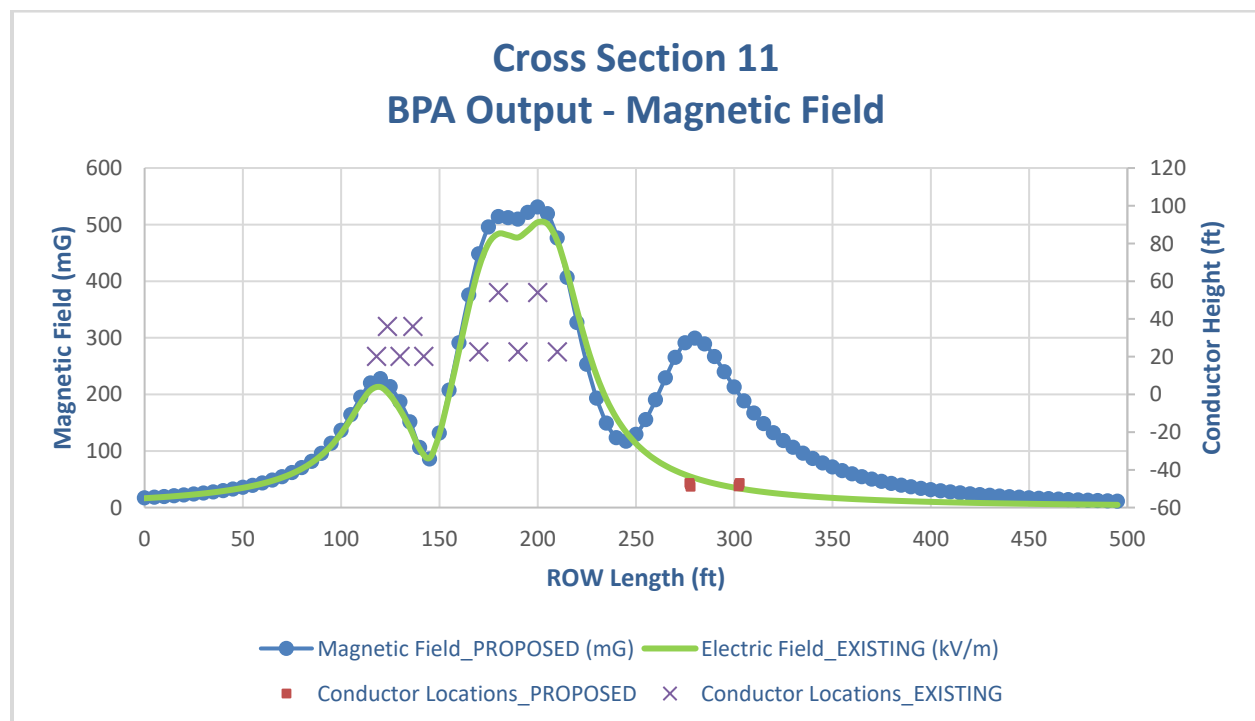
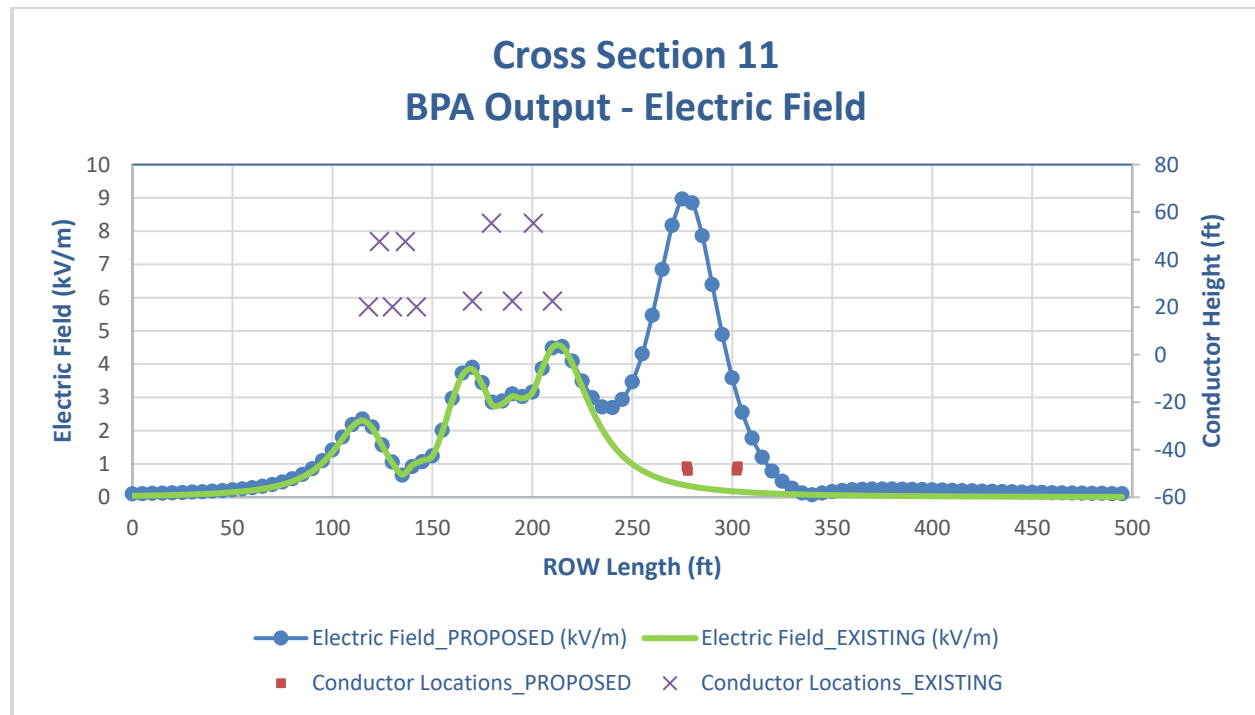


Figure 26 - PROPOSED CROSS SECTION 10 EMF RESULTS

Cross Section 11



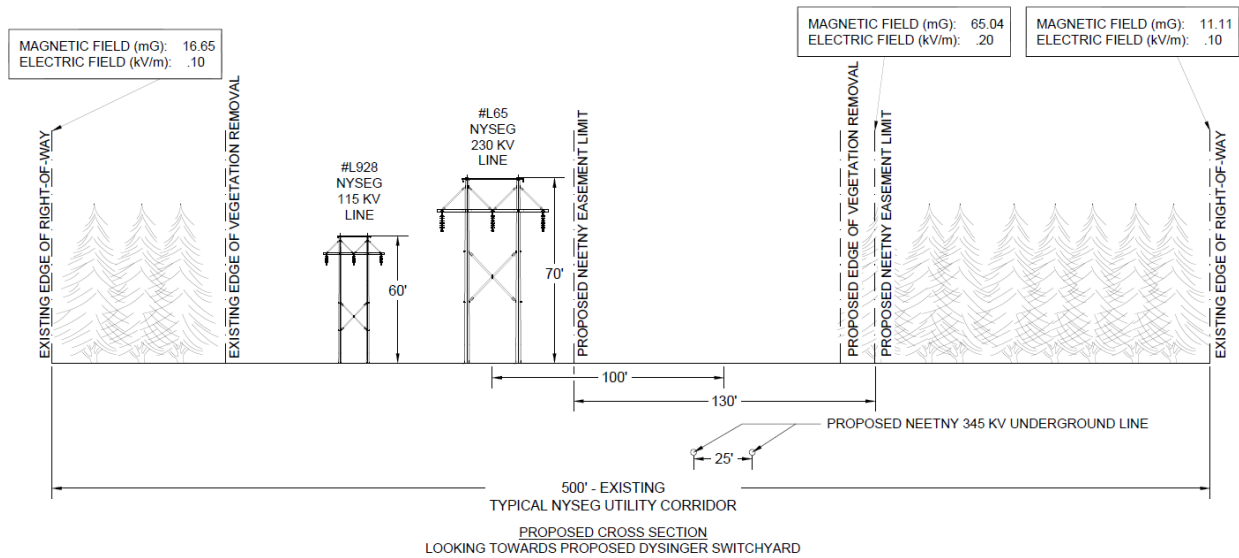


Figure 27 - PROPOSED CROSS SECTION 11 EMF RESULTS

5.0 REFERENCES

1. STATE OF NEW YORK PUBLIC SERVICE COMMISSION CASES 26529 and 26559 - Proceeding on Motion of the Commission as to Regulations Regarding Electric and Magnetic Field Standards for Transmission Lines – Statement of Interim Policy on Magnetic Fields of Major Electric Transmission Facilities (Issued and Effective: September 11, 1990)
2. STATE OF NEW YORK PUBLIC SERVICE COMMISSION OPINION NO. 78-13 - Opinion and Order Determining Health and Safety Issues, Imposing Operating Conditions and Authorizing, in Case 26529, Operation Pursuant to those Conditions (Issued June 19, 1978)
3. New York Power Pool – Tie-Line Rating Task Force – Final Report on Tie-Line Rating (Approved November 1995)
4. EPRI AC Transmission Line Reference Book – 200 kV and Above, 2015 Edition (3002005659 Update November 2015)
5. S&L Empire State Line Conductor Rating Report Rev. A (S&L 13139-026-002, Dated 1/25/17)
6. S&L Empire State Line Design Criteria Rev. G (Dated 2/13/2020)
7. NYISO 2016 Load & Capacity Data, “Gold Book” (Released April 2016)
8. National Electrical Safety Code (NESC) - 2017 Edition (C2-2017)

6.0 ATTACHMENTS

1. Appendix A: EMF Study of Each Segment

Appendix A: EMF Study (ROW Segments 1-11)

ROW Segment -1

8/27/2020

22:33:25

CROSS SECTION 1,,,,,,,,

VERTICAL MONOPOLE SINGLE CIRCUIT WITH 2 345KV NYPA LINES,,,,,,,,,

1,0, 9,15,0.0, 0.50, 1.00, 0.00

(ENGLISH UNITS OPTION)

(GRADIENTS ARE COMPUTED BY PROGRAM)

PHYSICAL SYSTEM CONSISTS OF 15 CONDUCTORS, OF WHICH 9 ARE ENERGIZED PHASES

OPTIONS: 'COMB',,,,,,,,,,

5.000,	6.600,	9.800,	0.000,	1.000,	75.000,	3.280,	7.300,	3.280		
'NEETNY-A',	'A',	55.10,	126.10,	2,	1.107,	18.000,	219.104,	0.000,	1.349,	0.000
'NEETNY-B',	'A',	51.80,	101.10,	2,	1.107,	18.000,	219.104,	-120.000,	1.349,	0.000
'NEETNY-C',	'A',	54.60,	76.10,	2,	1.107,	18.000,	219.104,	120.000,	1.349,	0.000
'DY-SS2-A',	'A',	287.50,	77.20,	2,	1.302,	18.000,	219.104,	0.000,	1.500,	0.000
'DY-SS2-B',	'A',	287.50,	55.20,	2,	1.302,	18.000,	219.104,	-120.000,	1.500,	0.000
'DY-SS2-C',	'A',	287.50,	33.20,	2,	1.302,	18.000,	219.104,	120.000,	1.500,	0.000
'DY-SS1-A',	'A',	355.00,	77.20,	2,	1.302,	18.000,	219.104,	0.000,	1.500,	0.000
'DY-SS1-B',	'A',	355.00,	55.20,	2,	1.302,	18.000,	219.104,	-120.000,	1.500,	0.000
'DY-SS1-C',	'A',	355.00,	33.20,	2,	1.302,	18.000,	219.104,	120.000,	1.500,	0.000
'NEETNY-1',	'A',	41.70,	143.80,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000
'NEETNY-2',	'A',	70.30,	143.80,	1,	0.530,	0.000,	0.000,	0.000,	0.000,	0.000
'DY-SS2-S',	'A',	287.50,	108.50,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000
'DY-SS2-S',	'A',	287.50,	107.50,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000
'DY-SS1-S',	'A',	355.00,	108.50,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000
'DY-SS1-S',	'A',	355.00,	107.50,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000
100	0.0	5.0								

1COMBINED OUTPUT OF AUDIBLE NOISE, RADIO NOISE, TVI, OZONE CONCENTRATION, GROUND GRADIENT AND MAGNETIC FIELD
CROSS SECTION 1,,,,,,,,,

VERTICAL MONOPOLE SINGLE CIRCUIT WITH 2 345KV NYPA LINES,,,,,,,,,

	DIST. FROM CENTER OF TOWER (FEET)	HEIGHT (FEET)	MAXIMUM GRADIENT (KV/CM)	SUBCON DIAM. (IN)	NO. OF SUBCON	SUBCON SPACING (IN)	VOLTAGE L-N (KV)	PHASE ANGLE (DEGREES)	CURRENT (kAmps)	CORONA LOSSES (KW/MI)
NEETNY-A	55.10	126.10	17.58	1.11	2	18.00	219.10	0.00	1.35	19.419
NEETNY-B	51.80	101.10	18.58	1.11	2	18.00	219.10	-120.00	1.35	27.817
NEETNY-C	54.60	76.10	17.22	1.11	2	18.00	219.10	120.00	1.35	16.982
DY-SS2-A	287.50	77.20	15.11	1.30	2	18.00	219.10	0.00	1.50	13.892
DY-SS2-B	287.50	55.20	16.74	1.30	2	18.00	219.10	-120.00	1.50	26.973
DY-SS2-C	287.50	33.20	16.00	1.30	2	18.00	219.10	120.00	1.50	20.159
DY-SS1-A	355.00	77.20	15.12	1.30	2	18.00	219.10	0.00	1.50	13.922
DY-SS1-B	355.00	55.20	16.74	1.30	2	18.00	219.10	-120.00	1.50	26.942
DY-SS1-C	355.00	33.20	16.01	1.30	2	18.00	219.10	120.00	1.50	20.173
NEETNY-1	41.70	143.80	9.64	0.39	1	0.00	0.00	0.00	0.00	0.000
NEETNY-2	70.30	143.80	7.29	0.53	1	0.00	0.00	0.00	0.00	0.000
DY-SS2-S	287.50	108.50	6.81	0.39	1	0.00	0.00	0.00	0.00	0.000
DY-SS2-S	287.50	107.50	7.20	0.39	1	0.00	0.00	0.00	0.00	0.000
DY-SS1-S	355.00	108.50	6.78	0.39	1	0.00	0.00	0.00	0.00	0.000
DY-SS1-S	355.00	107.50	7.17	0.39	1	0.00	0.00	0.00	0.00	0.000

AN MICROPHONE HT.= 5.0 FT, RI ANT. HT.= 6.6 FT, TV ANT. HT.= 9.8 FT, ALTITUDE= 0.0 FT

RI FREQ= 1.000 MHZ, TV FREQ= 75.000 MHZ, WIND VEL.(OZ)= 0.500 MPH, GROUND CONDUCTIVITY = 7.3 MMHOS/M

E-FIELD TRANSDUCER HT.= 3.3FT, B-FIELD TRANSDUCER HT.= 3.3FT

LATERAL DIST FROM REFERENCE (FEET)	AUDIBLE NOISE (RAIN) L50 DBA	NOISE (FAIR) L50 DBA	RADIO INTERFERENCE (RAIN) L50 DBUV/M	INTERFERENCE (FAIR) L50 DBUV/M	TVI TOTAL RAIN DBUV/M	OZONE FOR RAIN RATE OF 1.00 IN/HR AT 0. FT LEVEL PPB	ELECTRIC FIELD KV/M	MAGNETIC FIELD GAUSS
0.0	48.5	23.5	63.7	46.7	21.1	0.000000	0.725	0.03107
5.0	48.6	23.6	64.0	47.0	21.3	0.000000	0.819	0.03203
10.0	48.7	23.7	64.3	47.3	21.5	0.000000	0.918	0.03292
15.0	48.8	23.8	64.6	47.6	21.6	0.000000	1.020	0.03373
20.0	48.9	23.9	64.8	47.8	21.8	0.000000	1.123	0.03442
25.0	49.0	24.0	65.0	48.0	21.9	0.000000	1.223	0.03497
30.0	49.1	24.1	65.2	48.2	22.1	0.000000	1.318	0.03534
35.0	49.1	24.1	65.4	48.4	22.1	0.000000	1.402	0.03552
40.0	49.2	24.2	65.5	48.5	22.2	0.000000	1.473	0.03547
45.0	49.2	24.2	65.6	48.6	22.3	0.000000	1.525	0.03519

PROPOSED_CS1.txt

50.0	49.3	24.3	65.6	48.6	22.3	0.000000	1.557	0.03466
55.0	49.3	24.3	65.6	48.6	22.3	0.000000	1.566	0.03389
60.0	49.3	24.3	65.6	48.6	22.3	0.001048	1.550	0.03291
65.0	49.3	24.3	65.5	48.5	22.2	0.125886	1.512	0.03172
70.0	49.3	24.3	65.3	48.3	22.1	0.441327	1.452	0.03039
75.0	49.3	24.3	65.2	48.2	22.0	0.724320	1.375	0.02893
80.0	49.3	24.3	65.0	48.0	21.9	0.914962	1.283	0.02742
85.0	49.3	24.3	64.7	47.7	21.8	1.023666	1.182	0.02589
90.0	49.3	24.3	64.5	47.5	21.6	1.074662	1.074	0.02439
95.0	49.2	24.2	64.2	47.2	21.4	1.088840	0.964	0.02298
100.0	49.2	24.2	63.9	46.9	21.2	1.080737	0.854	0.02169
105.0	49.2	24.2	63.6	46.6	21.0	1.059701	0.748	0.02057
110.0	49.2	24.2	63.2	46.2	20.8	1.031552	0.646	0.01966
115.0	49.1	24.1	62.9	45.9	20.6	0.999860	0.551	0.01899
120.0	49.1	24.1	62.5	45.5	20.4	0.966798	0.462	0.01856
125.0	49.1	24.1	62.2	45.2	20.1	0.933671	0.380	0.01841
130.0	49.1	24.1	61.8	44.8	19.9	0.901247	0.306	0.01853
135.0	49.1	24.1	61.4	44.4	19.7	0.869963	0.240	0.01891
140.0	49.1	24.1	61.1	44.1	19.4	0.840047	0.181	0.01955
145.0	49.1	24.1	60.7	43.7	19.2	0.811599	0.132	0.02041
150.0	49.1	24.1	60.4	43.4	19.0	0.784642	0.093	0.02150
155.0	49.1	24.1	60.0	43.0	18.7	0.759150	0.072	0.02279
160.0	49.1	24.1	59.6	42.6	18.5	0.735068	0.078	0.02427
165.0	49.1	24.1	59.3	42.3	18.3	0.712328	0.097	0.02595
170.0	49.2	24.2	58.9	41.9	18.0	0.690855	0.119	0.02782
175.0	49.2	24.2	58.6	41.6	17.8	0.670568	0.140	0.02989
180.0	49.3	24.3	58.3	41.3	17.6	0.651392	0.158	0.03218
185.0	49.3	24.3	58.0	41.0	17.9	0.633252	0.172	0.03470
190.0	49.4	24.4	57.6	40.6	18.2	0.616076	0.180	0.03749
195.0	49.5	24.5	57.3	40.3	18.6	0.599799	0.182	0.04056
200.0	49.5	24.5	57.0	40.0	19.0	0.584357	0.176	0.04395
205.0	49.6	24.6	57.5	40.5	19.4	0.569693	0.161	0.04772
210.0	49.7	24.7	58.2	41.2	19.8	0.555755	0.135	0.05189
215.0	49.9	24.9	58.9	41.9	20.2	0.542492	0.098	0.05655
220.0	50.0	25.0	59.7	42.7	20.7	0.529858	0.057	0.06173
225.0	50.1	25.1	60.4	43.4	21.1	0.517814	0.100	0.06753
230.0	50.3	25.3	61.2	44.2	21.6	0.506318	0.214	0.07401
235.0	50.4	25.4	62.0	45.0	22.0	0.495338	0.378	0.08125
240.0	50.6	25.6	62.9	45.9	22.5	0.484838	0.598	0.08933
245.0	50.8	25.8	63.7	46.7	23.0	0.474790	0.889	0.09830
250.0	51.0	26.0	64.5	47.5	23.6	0.465165	1.266	0.10818

PROPOSED_CS1.txt

255.0	51.2	26.2	65.3	48.3	24.5	0.455938	1.746	0.11887
260.0	51.4	26.4	66.0	49.0	25.4	0.447085	2.338	0.13014
265.0	51.6	26.6	67.2	50.2	26.3	0.438584	3.042	0.14147
270.0	51.8	26.8	68.7	51.7	27.2	0.430415	3.824	0.15193
275.0	52.0	27.0	70.1	53.1	28.1	0.422558	4.613	0.16011
280.0	52.2	27.2	71.1	54.1	28.7	0.414997	5.288	0.16420
285.0	52.3	27.3	71.7	54.7	29.1	0.407715	5.712	0.16250
290.0	52.4	27.4	71.7	54.7	29.1	0.407265	5.790	0.15413
295.0	52.4	27.4	71.1	54.1	28.7	1.290356	5.529	0.13967
300.0	52.3	27.3	70.1	53.1	28.1	1.878020	5.039	0.12096
305.0	52.3	27.3	68.7	51.7	27.2	2.018288	4.471	0.10045
310.0	52.3	27.3	67.2	50.2	26.3	1.972732	3.964	0.08085
315.0	52.2	27.2	66.0	49.0	25.4	1.869130	3.607	0.06548
320.0	52.2	27.2	65.3	48.3	24.5	1.754813	3.447	0.05792
325.0	52.2	27.2	65.7	48.7	24.9	1.645866	3.500	0.05981
330.0	52.2	27.2	66.4	49.4	25.9	1.546985	3.762	0.07093
335.0	52.2	27.2	68.0	51.0	26.8	1.458774	4.203	0.08886
340.0	52.3	27.3	69.4	52.4	27.7	1.380444	4.754	0.10988
345.0	52.3	27.3	70.6	53.6	28.4	1.310822	5.302	0.13086
350.0	52.3	27.3	71.5	54.5	29.0	1.248726	5.695	0.14904
355.0	52.2	27.2	71.8	54.8	29.2	1.193091	5.794	0.16205
360.0	52.1	27.1	71.5	54.5	29.0	1.527964	5.536	0.16843
365.0	52.0	27.0	70.6	53.6	28.4	2.366139	4.970	0.16824
370.0	51.8	26.8	69.4	52.4	27.7	2.656975	4.220	0.16278
375.0	51.5	26.5	68.0	51.0	26.8	2.648864	3.421	0.15391
380.0	51.3	26.3	66.4	49.4	25.9	2.536480	2.670	0.14329
385.0	51.0	26.0	65.7	48.7	24.9	2.398296	2.019	0.13214
390.0	50.8	25.8	64.9	47.9	24.1	2.261868	1.482	0.12122
395.0	50.5	25.5	64.1	47.1	23.2	2.135909	1.054	0.11094
400.0	50.3	25.3	63.3	46.3	22.7	2.022324	0.720	0.10146
405.0	50.1	25.1	62.4	45.4	22.3	1.920632	0.464	0.09285
410.0	49.8	24.8	61.6	44.6	21.8	1.829613	0.272	0.08509
415.0	49.6	24.6	60.8	43.8	21.3	1.747922	0.135	0.07811
420.0	49.4	24.4	60.0	43.0	20.9	1.674302	0.066	0.07185
425.0	49.2	24.2	59.3	42.3	20.4	1.607653	0.114	0.06624
430.0	49.0	24.0	58.6	41.6	20.0	1.547037	0.164	0.06120
435.0	48.8	23.8	57.9	40.9	19.6	1.491658	0.203	0.05668
440.0	48.7	23.7	57.2	40.2	19.2	1.440849	0.232	0.05261
445.0	48.5	23.5	56.5	39.5	18.8	1.394047	0.252	0.04894
450.0	48.3	23.3	55.9	38.9	18.4	1.350775	0.264	0.04562
455.0	48.2	23.2	55.3	38.3	18.0	1.310629	0.272	0.04262

PROPOSED_CS1.txt								
460.0	48.0	23.0	54.7	37.7	17.7	1.273263	0.275	0.03989
465.0	47.9	22.9	54.2	37.2	17.4	1.238384	0.275	0.03741
470.0	47.7	22.7	53.7	36.7	17.0	1.205734	0.273	0.03515
475.0	47.6	22.6	53.2	36.2	16.7	1.175093	0.269	0.03309
480.0	47.4	22.4	52.7	35.7	16.4	1.146271	0.264	0.03120
485.0	47.3	22.3	52.2	35.2	16.1	1.119098	0.258	0.02946
490.0	47.2	22.2	51.8	34.8	15.8	1.093428	0.252	0.02787
495.0	47.1	22.1	51.3	34.3	15.5	1.069130	0.245	0.02640

ROW Segment -2

8/28/2020

07:50:12

CROSS SECTION 2,,,,,,,,

"VERTICAL MONOPOLE SINGLE CIRCUIT WITH L-65, 230KV",,,,,,,,,,

1,0, 6,10,0.0, 0.50, 1.00, 0.00

(ENGLISH UNITS OPTION)

(GRADIENTS ARE COMPUTED BY PROGRAM)

PHYSICAL SYSTEM CONSISTS OF 10 CONDUCTORS, OF WHICH 6 ARE ENERGIZED PHASES

OPTIONS: 'COMB',,,,,,,,,,

	5.000,	6.600,	9.800,	0.000,	1.000,	75.000,	3.280,	7.300,	3.280		
'L65-A'	, 'A',	180.00,	22.50,	1,	1.302,	0.000,	139.400,	0.000,	1.690,	0.000	
'L65-B'	, 'A',	200.00,	22.50,	1,	1.302,	0.000,	139.400,-120.000,	1.690,	0.000		
'L65-C'	, 'A',	220.00,	22.50,	1,	1.302,	0.000,	139.400, 120.000,	1.690,	0.000		
'NEETNY-A'	, 'A',	422.60,	90.70,	2,	1.108,	18.000,	219.100,	0.000,	1.349,	0.000	
'NEETNY-B'	, 'A',	419.30,	65.70,	2,	1.108,	18.000,	219.100,-120.000,	1.349,	0.000		
'NEETNY-C'	, 'A',	422.10,	40.70,	2,	1.108,	18.000,	219.100, 120.000,	1.349,	0.000		
'NEETNY-1'	, 'A',	409.20,	110.80,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000	
'NEETNY-2'	, 'A',	437.80,	110.80,	1,	0.530,	0.000,	0.000,	0.000,	0.000,	0.000	
'L65-SW1'	, 'A',	189.50,	57.30,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000	
'L65-SW2'	, 'A',	210.50,	57.30,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000	
100	0.0	5.0									

1COMBINED OUTPUT OF AUDIBLE NOISE, RADIO NOISE, TVI, OZONE CONCENTRATION, GROUND GRADIENT AND MAGNETIC FIELD

CROSS SECTION 2,,,,,,,,

"VERTICAL MONOPOLE SINGLE CIRCUIT WITH L-65, 230KV",,,,,,,,,,

DIST. FROM	MAXIMUM	SUBCON	NO. OF	SUBCON	VOLTAGE	PHASE	CURRENT	CORONA
------------	---------	--------	--------	--------	---------	-------	---------	--------

PROPOSED_CS2.txt										
	CENTER OF TOWER (FEET)	HEIGHT (FEET)	GRADIENT (KV/CM)	DIAM. (IN)	SUBCON	SPACING (IN)	L-N (KV)	ANGLE (DEGREES)	(kAmps)	LOSSES (KW/MI)
L65-A	180.00	22.50	13.91	1.30	1	0.00	139.40	0.00	1.69	3.291
L65-B	200.00	22.50	14.63	1.30	1	0.00	139.40	-120.00	1.69	4.575
L65-C	220.00	22.50	13.96	1.30	1	0.00	139.40	120.00	1.69	3.373
NEETNY-A	422.60	90.70	17.50	1.11	2	18.00	219.10	0.00	1.35	18.894
NEETNY-B	419.30	65.70	18.51	1.11	2	18.00	219.10	-120.00	1.35	27.251
NEETNY-C	422.10	40.70	17.67	1.11	2	18.00	219.10	120.00	1.35	20.121
NEETNY-1	409.20	110.80	8.97	0.39	1	0.00	0.00	0.00	0.00	0.000
NEETNY-2	437.80	110.80	6.70	0.53	1	0.00	0.00	0.00	0.00	0.000
L65-SW1	189.50	57.30	1.26	0.39	1	0.00	0.00	0.00	0.00	0.000
L65-SW2	210.50	57.30	0.78	0.39	1	0.00	0.00	0.00	0.00	0.000

AN MICROPHONE HT.= 5.0 FT, RI ANT. HT.= 6.6 FT, TV ANT. HT.= 9.8 FT, ALTITUDE= 0.0 FT

RI FREQ= 1.000 MHZ, TV FREQ= 75.000 MHZ, WIND VEL.(OZ)= 0.500 MPH, GROUND CONDUCTIVITY = 7.3 MMHOS/M

E-FIELD TRANSDUCER HT.= 3.3FT, B-FIELD TRANSDUCER HT.= 3.3FT

LATERAL DIST FROM REFERENCE (FEET)	AUDIBLE NOISE		RADIO INTERFERENCE		TVI TOTAL RAIN DBUV/M	OZONE FOR RAIN RATE OF 1.00 IN/HR AT 0. FT LEVEL PPB	ELECTRIC FIELD KV/M	MAGNETIC FIELD GAUSS
	(RAIN) L50 DBA	(FAIR) L50 DBA	(RAIN) L50 DBUV/M	(FAIR) L50 DBUV/M				
0.0	41.8	16.8	43.5	26.5	8.8	0.000000	0.055	0.00962
5.0	41.9	16.9	43.6	26.6	8.9	0.000000	0.058	0.01011
10.0	42.0	17.0	43.7	26.7	9.0	0.000000	0.061	0.01065
15.0	42.0	17.0	43.8	26.8	9.1	0.000000	0.064	0.01123
20.0	42.1	17.1	43.9	26.9	9.2	0.000000	0.068	0.01187
25.0	42.2	17.2	44.0	27.0	9.3	0.000000	0.072	0.01255
30.0	42.3	17.3	44.2	27.2	9.4	0.000000	0.076	0.01330
35.0	42.4	17.4	44.3	27.3	9.5	0.000000	0.081	0.01413
40.0	42.5	17.5	44.4	27.4	9.7	0.000000	0.086	0.01503
45.0	42.5	17.5	44.5	27.5	9.8	0.000000	0.092	0.01602
50.0	42.6	17.6	44.7	27.7	9.9	0.000000	0.099	0.01711
55.0	42.7	17.7	44.8	27.8	10.0	0.000000	0.107	0.01832
60.0	42.8	17.8	44.9	27.9	10.1	0.000000	0.116	0.01966
65.0	42.9	17.9	45.1	28.1	10.2	0.000000	0.126	0.02116
70.0	43.0	18.0	45.2	28.2	10.4	0.000000	0.137	0.02283
75.0	43.2	18.2	45.4	28.4	10.5	0.000000	0.150	0.02471
80.0	43.3	18.3	45.5	28.5	10.6	0.000000	0.166	0.02684
85.0	43.4	18.4	45.7	28.7	10.7	0.000000	0.184	0.02925
90.0	43.5	18.5	45.8	28.8	11.0	0.000000	0.206	0.03200
95.0	43.6	18.6	46.0	29.0	11.4	0.000000	0.231	0.03515

PROPOSED_CS2.txt

100.0	43.8	18.8	46.1	29.1	11.8	0.000000	0.262	0.03880
105.0	43.9	18.9	46.3	29.3	12.2	0.000000	0.299	0.04303
110.0	44.1	19.1	46.4	29.4	12.7	0.000000	0.344	0.04800
115.0	44.2	19.2	46.6	29.6	13.2	0.000000	0.400	0.05386
120.0	44.4	19.4	46.9	29.9	13.7	0.000000	0.470	0.06085
125.0	44.6	19.6	48.2	31.2	14.2	0.000000	0.558	0.06927
130.0	44.8	19.8	49.6	32.6	15.0	0.000000	0.671	0.07952
135.0	45.0	20.0	51.2	34.2	15.8	0.000000	0.817	0.09216
140.0	45.2	20.2	52.9	35.9	16.8	0.000000	1.009	0.10791
145.0	45.5	20.5	54.8	37.8	17.8	0.000000	1.262	0.12783
150.0	45.7	20.7	56.9	39.9	19.0	0.000000	1.597	0.15332
155.0	46.0	21.0	59.2	42.2	20.3	0.000000	2.040	0.18622
160.0	46.4	21.4	61.8	44.8	21.7	0.000000	2.609	0.22875
165.0	46.8	21.8	64.5	47.5	23.4	0.000000	3.294	0.28280
170.0	47.2	22.2	67.1	50.1	25.1	0.000000	4.003	0.34794
175.0	47.5	22.5	69.1	52.1	26.5	0.000000	4.500	0.41766
180.0	47.9	22.9	69.9	52.9	27.2	0.000000	4.473	0.47756
185.0	48.1	23.1	69.1	52.1	26.5	0.338288	3.851	0.51312
190.0	48.4	23.4	69.7	52.7	27.7	0.351880	3.098	0.52141
195.0	48.5	23.5	71.8	54.8	29.2	0.285336	2.943	0.51168
200.0	48.6	23.6	72.6	55.6	29.8	0.235118	3.055	0.50305
205.0	48.6	23.6	71.8	54.8	29.2	0.719746	2.919	0.51019
210.0	48.5	23.5	69.7	52.7	27.7	0.714374	3.048	0.51744
215.0	48.4	23.4	69.3	52.3	26.7	0.592005	3.790	0.50627
220.0	48.2	23.2	70.1	53.1	27.4	0.499048	4.407	0.46812
225.0	48.0	23.0	69.3	52.3	26.7	0.780761	4.426	0.40639
230.0	47.7	22.7	67.3	50.3	25.3	0.743963	3.920	0.33570
235.0	47.5	22.5	64.7	47.7	23.6	0.635745	3.202	0.27017
240.0	47.2	22.2	62.0	45.0	21.9	0.552309	2.507	0.21601
245.0	47.0	22.0	59.4	42.4	20.5	0.489510	1.929	0.17344
250.0	46.9	21.9	57.1	40.1	19.2	0.440801	1.478	0.14046
255.0	46.8	21.8	55.0	38.0	18.0	0.401853	1.136	0.11483
260.0	46.7	21.7	53.5	36.5	17.0	0.369911	0.877	0.09467
265.0	46.7	21.7	53.9	36.9	17.0	0.343174	0.680	0.07857
270.0	46.7	21.7	54.2	37.2	17.3	0.320417	0.529	0.06551
275.0	46.7	21.7	54.6	37.6	17.5	0.300777	0.411	0.05473
280.0	46.7	21.7	55.0	38.0	17.8	0.283632	0.320	0.04569
285.0	46.8	21.8	55.4	38.4	18.1	0.268515	0.248	0.03799
290.0	46.8	21.8	55.9	38.9	18.3	0.255074	0.191	0.03132
295.0	46.9	21.9	56.3	39.3	18.6	0.243034	0.147	0.02547
300.0	47.0	22.0	56.7	39.7	18.9	0.232180	0.114	0.02027

PROPOSED_CS2.txt

305.0	47.1	22.1	57.2	40.2	19.2	0.222338	0.092	0.01563
310.0	47.2	22.2	57.7	40.7	19.5	0.213369	0.082	0.01157
315.0	47.3	22.3	58.2	41.2	19.9	0.205157	0.082	0.00836
320.0	47.5	22.5	58.7	41.7	20.2	0.197607	0.091	0.00664
325.0	47.6	22.6	59.3	42.3	20.5	0.190641	0.107	0.00662
330.0	47.7	22.7	59.8	42.8	20.9	0.184189	0.128	0.00854
335.0	47.9	22.9	60.4	43.4	21.2	0.178197	0.155	0.01195
340.0	48.1	23.1	61.0	44.0	21.6	0.172614	0.192	0.01588
345.0	48.2	23.2	61.6	44.6	22.0	0.167400	0.239	0.02012
350.0	48.4	23.4	62.2	45.2	22.3	0.162517	0.301	0.02466
355.0	48.6	23.6	62.9	45.9	22.7	0.157934	0.382	0.02953
360.0	48.8	23.8	63.5	46.5	23.1	0.153624	0.486	0.03477
365.0	49.0	24.0	64.2	47.2	23.5	0.149562	0.618	0.04046
370.0	49.2	24.2	64.8	47.8	23.9	0.145727	0.785	0.04664
375.0	49.4	24.4	65.5	48.5	24.3	0.142099	0.993	0.05338
380.0	49.6	24.6	66.1	49.1	24.6	0.138663	1.250	0.06069
385.0	49.8	24.8	66.7	49.7	25.2	0.135402	1.561	0.06860
390.0	50.1	25.1	67.3	50.3	25.9	0.132303	1.930	0.07704
395.0	50.3	25.3	67.8	50.8	26.6	0.129354	2.352	0.08587
400.0	50.4	25.4	68.7	51.7	27.3	0.126545	2.812	0.09481
405.0	50.6	25.6	69.8	52.8	27.9	0.123864	3.281	0.10344
410.0	50.7	25.7	70.7	53.7	28.5	0.121305	3.711	0.11115
415.0	50.8	25.8	71.3	54.3	28.9	0.118857	4.044	0.11723
420.0	50.9	25.9	71.6	54.6	29.1	0.116514	4.223	0.12104
425.0	50.9	25.9	71.6	54.6	29.1	0.123644	4.215	0.12215
430.0	50.8	25.8	71.2	54.2	28.8	0.982236	4.022	0.12053
435.0	50.7	25.7	70.5	53.5	28.4	1.609159	3.679	0.11655
440.0	50.5	25.5	69.6	52.6	27.8	1.836436	3.244	0.11083
445.0	50.3	25.3	68.5	51.5	27.2	1.879326	2.773	0.10401
450.0	50.1	25.1	67.3	50.3	26.5	1.835139	2.311	0.09671
455.0	49.9	24.9	66.6	49.6	25.8	1.754983	1.886	0.08935
460.0	49.7	24.7	66.0	49.0	25.1	1.663598	1.513	0.08223
465.0	49.4	24.4	65.3	48.3	24.4	1.572220	1.196	0.07551
470.0	49.2	24.2	64.7	47.7	23.8	1.485608	0.931	0.06928
475.0	49.0	24.0	64.0	47.0	23.4	1.405493	0.714	0.06357
480.0	48.8	23.8	63.4	46.4	23.0	1.332214	0.538	0.05837
485.0	48.5	23.5	62.7	45.7	22.6	1.265492	0.396	0.05366
490.0	48.3	23.3	62.1	45.1	22.2	1.204806	0.283	0.04940
495.0	48.1	23.1	61.4	44.4	21.9	1.149562	0.193	0.04554

ROW Segment -3

11:14:45

3/ 5/2020

11:14:45

CROSS SECTION 3,,,,,,,,

VERTICAL MONOPOLE SINGLE CIRCUIT WITH L-65 230KV,,,,,,,,,,

1,0, 6,10,0.0, 0.50, 1.00, 0.00

(ENGLISH UNITS OPTION)

(GRADIENTS ARE COMPUTED BY PROGRAM)

PHYSICAL SYSTEM CONSISTS OF 10 CONDUCTORS, OF WHICH 6 ARE ENERGIZED PHASES

OPTIONS: 'COMB',,,,,,,,,,

	5.000,	6.600,	9.800,	0.000,	1.000,	75.000,	3.280,	7.300,	3.280		
'L65-A	'A'	170.00,	22.50,	1,	1.302,	0.000,	139.400,	0.000,	1.690,	0.000	
'L65-B	'A'	190.00,	22.50,	1,	1.302,	0.000,	139.400,-120.000,	1.690,	0.000		
'L65-C	'A'	210.00,	22.50,	1,	1.302,	0.000,	139.400, 120.000,	1.690,	0.000		
'NEETNY-A'	'A'	277.60,	74.80,	2,	1.108,	18.000,	219.100,	0.000,	1.349,	0.000	
'NEETNY-B'	'A'	274.30,	49.80,	2,	1.108,	18.000,	219.100,-120.000,	1.349,	0.000		
'NEETNY-C'	'A'	277.10,	24.80,	2,	1.108,	18.000,	219.100, 120.000,	1.349,	0.000		
'L65-SW1	'A'	179.50,	56.80,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000	
'L65-SW2	'A'	200.50,	56.80,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000	
'NEETNY-1'	'A'	264.20,	103.90,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000	
'NEETNY-2'	'A'	292.80,	103.90,	1,	0.530,	0.000,	0.000,	0.000,	0.000,	0.000	

100 0.0 5.0

1COMBINED OUTPUT OF AUDIBLE NOISE, RADIO NOISE, TVI, OZONE CONCENTRATION, GROUND GRADIENT AND MAGNETIC FIELD

CROSS SECTION 3,,,,,,,,

VERTICAL MONOPOLE SINGLE CIRCUIT WITH L-65 230KV,,,,,,,,,,,,,

DIST. FROM	MAXIMUM	SUBCON	NO. OF	SUBCON	VOLTAGE	PHASE	CURRENT	CORONA
------------	---------	--------	--------	--------	---------	-------	---------	--------

PROPOSED_CS3.txt										
	CENTER OF TOWER (FEET)	HEIGHT (FEET)	GRADIENT (KV/CM)	DIAM. (IN)	SUBCON	SPACING (IN)	L-N (KV)	ANGLE (DEGREES)	(kAmps)	LOSSES (KW/MI)
L65-A	170.00	22.50	13.87	1.30	1	0.00	139.40	0.00	1.69	3.230
L65-B	190.00	22.50	14.57	1.30	1	0.00	139.40	-120.00	1.69	4.455
L65-C	210.00	22.50	14.07	1.30	1	0.00	139.40	120.00	1.69	3.537
NEETNY-A	277.60	74.80	17.24	1.11	2	18.00	219.10	0.00	1.35	17.135
NEETNY-B	274.30	49.80	18.53	1.11	2	18.00	219.10	-120.00	1.35	27.367
NEETNY-C	277.10	24.80	18.26	1.11	2	18.00	219.10	120.00	1.35	24.877
L65-SW1	179.50	56.80	2.04	0.39	1	0.00	0.00	0.00	0.00	0.000
L65-SW2	200.50	56.80	0.80	0.39	1	0.00	0.00	0.00	0.00	0.000
NEETNY-1	264.20	103.90	7.36	0.39	1	0.00	0.00	0.00	0.00	0.000
NEETNY-2	292.80	103.90	5.66	0.53	1	0.00	0.00	0.00	0.00	0.000

AN MICROPHONE HT.= 5.0 FT, RI ANT. HT.= 6.6 FT, TV ANT. HT.= 9.8 FT, ALTITUDE= 0.0 FT

RI FREQ= 1.000 MHZ, TV FREQ= 75.000 MHZ, WIND VEL.(OZ)= 0.500 MPH, GROUND CONDUCTIVITY = 7.3 MMHOS/M

E-FIELD TRANSDUCER HT.= 3.3FT, B-FIELD TRANSDUCER HT.= 3.3FT

LATERAL DIST FROM REFERENCE (FEET)	AUDIBLE NOISE		RADIO INTERFERENCE		TVI TOTAL RAIN DBUV/M	OZONE FOR RAIN RATE OF 1.00 IN/HR AT 0. FT LEVEL PPB	ELECTRIC FIELD KV/M	MAGNETIC FIELD GAUSS
	(RAIN) L50 DBA	(FAIR) L50 DBA	(RAIN) L50 DBUV/M	(FAIR) L50 DBUV/M				
0.0	43.8	18.8	45.4	28.4	12.5	0.000000	0.097	0.01107
5.0	43.9	18.9	45.6	28.6	12.7	0.000000	0.101	0.01165
10.0	44.0	19.0	45.8	28.8	12.8	0.000000	0.106	0.01228
15.0	44.1	19.1	46.0	29.0	13.0	0.000000	0.112	0.01296
20.0	44.2	19.2	46.2	29.2	13.1	0.000000	0.117	0.01370
25.0	44.3	19.3	46.4	29.4	13.3	0.000000	0.124	0.01451
30.0	44.4	19.4	46.6	29.6	13.5	0.000000	0.131	0.01540
35.0	44.5	19.5	46.9	29.9	13.7	0.000000	0.139	0.01638
40.0	44.6	19.6	47.1	30.1	13.8	0.000000	0.147	0.01746
45.0	44.7	19.7	47.3	30.3	14.0	0.000000	0.157	0.01865
50.0	44.9	19.9	47.6	30.6	14.2	0.000000	0.168	0.01997
55.0	45.0	20.0	47.8	30.8	14.4	0.000000	0.180	0.02144
60.0	45.1	20.1	48.1	31.1	14.6	0.000000	0.193	0.02309
65.0	45.2	20.2	48.3	31.3	14.8	0.000000	0.209	0.02495
70.0	45.4	20.4	48.6	31.6	15.0	0.000000	0.226	0.02705
75.0	45.5	20.5	48.9	31.9	15.2	0.000000	0.247	0.02943
80.0	45.6	20.6	49.2	32.2	15.4	0.000000	0.271	0.03215
85.0	45.8	20.8	49.5	32.5	15.6	0.000000	0.298	0.03528
90.0	45.9	20.9	49.8	32.8	15.8	0.000000	0.331	0.03891
95.0	46.1	21.1	50.1	33.1	16.1	0.000000	0.370	0.04313

PROPOSED_CS3.txt

100.0	46.3	21.3	50.5	33.5	16.3	0.000000	0.418	0.04809
105.0	46.4	21.4	50.8	33.8	16.6	0.000000	0.476	0.05397
110.0	46.6	21.6	51.1	34.1	16.8	0.000000	0.548	0.06100
115.0	46.8	21.8	51.5	34.5	17.0	0.000000	0.638	0.06950
120.0	47.0	22.0	51.9	34.9	17.3	0.000000	0.752	0.07988
125.0	47.2	22.2	52.3	35.3	17.6	0.000000	0.899	0.09273
130.0	47.4	22.4	52.8	35.8	17.9	0.000000	1.091	0.10882
135.0	47.6	22.6	54.7	37.7	18.1	0.000000	1.344	0.12924
140.0	47.9	22.9	56.8	39.8	18.8	0.000000	1.678	0.15549
145.0	48.2	23.2	59.1	42.1	20.1	0.000000	2.118	0.18952
150.0	48.5	23.5	61.6	44.6	21.6	0.000000	2.684	0.23370
155.0	48.8	23.8	64.3	47.3	23.2	0.000000	3.366	0.29011
160.0	49.1	24.1	66.9	49.9	24.9	0.000000	4.070	0.35847
165.0	49.5	24.5	69.0	52.0	26.4	0.000000	4.562	0.43212
170.0	49.8	24.8	69.8	52.8	27.0	0.000000	4.534	0.49608
175.0	50.0	25.0	69.0	52.0	26.4	0.330067	3.915	0.53493
180.0	50.3	25.3	69.5	52.5	27.5	0.343329	3.172	0.54538
185.0	50.5	25.5	71.6	54.6	29.0	0.278402	3.019	0.53723
190.0	50.7	25.7	72.4	55.4	29.6	0.229404	3.126	0.53034
195.0	50.8	25.8	71.6	54.6	29.0	0.697195	2.982	0.53764
200.0	50.9	25.9	69.5	52.5	27.5	0.691752	3.083	0.54195
205.0	51.0	26.0	69.7	52.7	27.1	0.573351	3.804	0.52438
210.0	51.0	26.0	70.5	53.5	27.7	0.483405	4.429	0.47645
215.0	51.1	26.1	69.7	52.7	27.1	0.789688	4.484	0.40293
220.0	51.2	26.2	67.6	50.6	25.6	0.755419	4.050	0.32063
225.0	51.3	26.3	65.0	48.0	25.9	0.644055	3.455	0.24545
230.0	51.4	26.4	66.0	49.0	26.7	0.558297	2.959	0.18495
235.0	51.6	26.6	66.9	49.9	27.6	0.493947	2.682	0.14154
240.0	51.9	26.9	67.8	50.8	28.5	0.444178	2.663	0.11689
245.0	52.1	27.1	68.7	51.7	29.6	0.404481	2.911	0.11209
250.0	52.5	27.5	69.8	52.8	30.8	0.371993	3.444	0.12513
255.0	52.8	27.8	72.0	55.0	32.1	0.344846	4.290	0.15120
260.0	53.2	28.2	74.4	57.4	33.5	0.321775	5.453	0.18529
265.0	53.5	28.5	76.7	59.7	34.9	0.301890	6.835	0.22272
270.0	53.8	28.8	78.6	61.6	36.2	0.284549	8.156	0.25750
275.0	54.0	29.0	79.7	62.7	37.0	0.269274	8.952	0.28154
280.0	53.9	28.9	79.6	62.6	36.9	0.786205	8.840	0.28805
285.0	53.7	28.7	78.3	61.3	36.0	2.826095	7.848	0.27673
290.0	53.3	28.3	76.3	59.3	34.7	2.959150	6.383	0.25369
295.0	52.9	27.9	74.0	57.0	33.2	2.821598	4.879	0.22618
300.0	52.5	27.5	71.7	54.7	31.8	2.615560	3.576	0.19899

PROPOSED_CS3.txt

305.0	52.1	27.1	69.5	52.5	30.6	2.404773	2.544	0.17433
310.0	51.7	26.7	67.6	50.6	29.4	2.211619	1.764	0.15282
315.0	51.3	26.3	66.6	49.6	28.4	2.041286	1.189	0.13436
320.0	51.0	26.0	65.7	48.7	27.4	1.892872	0.771	0.11861
325.0	50.6	25.6	64.8	47.8	26.6	1.763708	0.470	0.10518
330.0	50.3	25.3	63.9	46.9	25.8	1.650904	0.257	0.09368
335.0	50.0	25.0	63.0	46.0	25.1	1.551856	0.115	0.08381
340.0	49.7	24.7	62.1	45.1	24.4	1.464359	0.077	0.07529
345.0	49.4	24.4	61.3	44.3	23.8	1.386593	0.129	0.06791
350.0	49.2	24.2	60.5	43.5	23.2	1.317063	0.175	0.06149
355.0	48.9	23.9	59.8	42.8	22.6	1.254551	0.208	0.05588
360.0	48.7	23.7	59.1	42.1	22.1	1.198055	0.230	0.05095
365.0	48.4	23.4	58.4	41.4	21.6	1.146750	0.243	0.04661
370.0	48.2	23.2	57.7	40.7	21.1	1.099950	0.249	0.04277
375.0	48.0	23.0	57.1	40.1	20.7	1.057083	0.251	0.03937
380.0	47.8	22.8	56.5	39.5	20.3	1.017670	0.250	0.03633
385.0	47.6	22.6	56.0	39.0	19.9	0.981304	0.246	0.03362
390.0	47.4	22.4	55.4	38.4	19.6	0.947641	0.240	0.03118
395.0	47.2	22.2	54.9	37.9	19.3	0.916386	0.233	0.02899
400.0	47.1	22.1	54.4	37.4	19.0	0.887284	0.226	0.02702
405.0	46.9	21.9	53.9	36.9	18.6	0.860118	0.218	0.02523
410.0	46.7	21.7	53.5	36.5	18.3	0.834695	0.210	0.02361
415.0	46.6	21.6	53.0	36.0	18.1	0.810851	0.202	0.02214
420.0	46.4	21.4	52.6	35.6	17.8	0.788439	0.194	0.02080
425.0	46.2	21.2	52.2	35.2	17.5	0.767332	0.186	0.01957
430.0	46.1	21.1	51.8	34.8	17.2	0.747416	0.178	0.01844
435.0	46.0	21.0	51.4	34.4	17.0	0.728592	0.171	0.01741
440.0	45.8	20.8	51.0	34.0	16.7	0.710768	0.164	0.01646
445.0	45.7	20.7	50.7	33.7	16.5	0.693867	0.157	0.01559
450.0	45.5	20.5	50.4	33.4	16.2	0.677816	0.151	0.01478
455.0	45.4	20.4	50.0	33.0	16.0	0.662551	0.144	0.01403
460.0	45.3	20.3	49.7	32.7	15.8	0.648015	0.139	0.01334
465.0	45.2	20.2	49.4	32.4	15.6	0.634156	0.133	0.01269
470.0	45.0	20.0	49.1	32.1	15.4	0.620925	0.128	0.01209
475.0	44.9	19.9	48.8	31.8	15.1	0.608280	0.123	0.01154
480.0	44.8	19.8	48.5	31.5	14.9	0.596182	0.118	0.01101
485.0	44.7	19.7	48.3	31.3	14.7	0.584596	0.113	0.01053
490.0	44.6	19.6	48.0	31.0	14.5	0.573488	0.109	0.01007
495.0	44.5	19.5	47.8	30.8	14.3	0.562829	0.105	0.00965

ROW Segment -4

3/ 5/2020 11:15:44

(ENGLISH UNITS OPTION)

PHYSICAL SYSTEM CONSISTS OF 15 CONDUCTORS, OF WHICH 9 ARE ENERGIZED PHASES

5.000,	6.600,	9.800,	0.000,	1.000,	75.000,	3.280,	7.300,	3.280		
'L928-A',	'A',	118.00,	20.10,	1,	1.170,	0.000,	69.700,	0.000,	0.732,	0.000
'L928-B',	'A',	130.00,	20.10,	1,	1.170,	0.000,	69.700,-120.000,	0.732,	0.000	
'L928-C',	'A',	142.00,	20.10,	1,	1.170,	0.000,	69.700, 120.000,	0.732,	0.000	
'L65-A',	'A',	170.00,	22.50,	1,	1.302,	0.000,	139.400,	0.000,	1.690,	0.000
'L65-B',	'A',	190.00,	22.50,	1,	1.302,	0.000,	139.400,-120.000,	1.690,	0.000	
'L65-C',	'A',	210.00,	22.50,	1,	1.302,	0.000,	139.400, 120.000,	1.690,	0.000	
'NEETNY-A',	'A',	277.60,	74.80,	2,	1.108,	18.000,	219.100,	0.000,	1.349,	0.000
'NEETNY-B',	'A',	274.30,	49.80,	2,	1.108,	18.000,	219.100,-120.000,	1.349,	0.000	
'NEETNY-C',	'A',	277.10,	24.80,	2,	1.108,	18.000,	219.100, 120.000,	1.349,	0.000	
'L928-SW1',	'A',	123.50,	47.60,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000
'L928-SW2',	'A',	136.50,	47.60,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000
'L65-SW1',	'A',	179.50,	55.30,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000
'L65-SW2',	'A',	200.50,	55.30,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000
'NEETNY-1',	'A',	264.20,	102.30,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000
'NEETNY-2',	'A',	292.80,	102.30,	1,	0.530,	0.000,	0.000,	0.000,	0.000,	0.000
100	0.0	5.0								

Page 1

"VERTICAL MONOPOLE SINGLE CIRCUIT WITH L-65 230KV, L928 115KV",,,,,,,,,,

	DIST. FROM CENTER OF TOWER (FEET)	HEIGHT (FEET)	MAXIMUM GRADIENT (KV/CM)	SUBCON DIAM. (IN)	NO. OF SUBCON	SUBCON SPACING (IN)	VOLTAGE L-N (KV)	PHASE ANGLE (DEGREES)	CURRENT (kAmps)	CORONA LOSSES (KW/MI)
L928-A	118.00	20.10	8.01	1.17	1	0.00	69.70	0.00	0.73	0.060
L928-B	130.00	20.10	8.81	1.17	1	0.00	69.70	-120.00	0.73	0.110
L928-C	142.00	20.10	8.71	1.17	1	0.00	69.70	120.00	0.73	0.102
L65-A	170.00	22.50	14.18	1.30	1	0.00	139.40	0.00	1.69	3.720
L65-B	190.00	22.50	14.59	1.30	1	0.00	139.40	-120.00	1.69	4.480
L65-C	210.00	22.50	14.03	1.30	1	0.00	139.40	120.00	1.69	3.475
NEETNY-A	277.60	74.80	17.28	1.11	2	18.00	219.10	0.00	1.35	17.424
NEETNY-B	274.30	49.80	18.52	1.11	2	18.00	219.10	-120.00	1.35	27.329
NEETNY-C	277.10	24.80	18.25	1.11	2	18.00	219.10	120.00	1.35	24.819
L928-SW1	123.50	47.60	1.41	0.39	1	0.00	0.00	0.00	0.00	0.000
L928-SW2	136.50	47.60	1.23	0.39	1	0.00	0.00	0.00	0.00	0.000
L65-SW1	179.50	55.30	1.51	0.39	1	0.00	0.00	0.00	0.00	0.000
L65-SW2	200.50	55.30	0.79	0.39	1	0.00	0.00	0.00	0.00	0.000
NEETNY-1	264.20	102.30	7.53	0.39	1	0.00	0.00	0.00	0.00	0.000
NEETNY-2	292.80	102.30	5.81	0.53	1	0.00	0.00	0.00	0.00	0.000

AN MICROPHONE HT.= 5.0 FT, RI ANT. HT.= 6.6 FT, TV ANT. HT.= 9.8 FT, ALTITUDE= 0.0 FT

RI FREQ= 1.000 MHZ, TV FREQ= 75.000 MHZ, WIND VEL.(OZ)= 0.500 MPH, GROUND CONDUCTIVITY = 7.3 MMHOS/M

E-FIELD TRANSDUCER HT.= 3.3FT, B-FIELD TRANSDUCER HT.= 3.3FT

LATERAL DIST FROM REFERENCE (FEET)	AUDIBLE NOISE (RAIN) L50 DBA	(FAIR) L50 DBA	RADIO INTERFERENCE (RAIN) L50 DBUV/M	(FAIR) L50 DBUV/M	TVI TOTAL RAIN DBUV/M	OZONE FOR RAIN RATE OF 1.00 IN/HR AT 0. FT LEVEL PPB	ELECTRIC FIELD KV/M	MAGNETIC FIELD GAUSS
0.0	43.9	18.9	45.4	28.4	12.5	0.000000	0.100	0.01665
5.0	44.0	19.0	45.6	28.6	12.6	0.000000	0.106	0.01770
10.0	44.1	19.1	45.8	28.8	12.8	0.000000	0.112	0.01886
15.0	44.2	19.2	46.0	29.0	13.0	0.000000	0.120	0.02015
20.0	44.3	19.3	46.2	29.2	13.1	0.000000	0.128	0.02158
25.0	44.4	19.4	46.4	29.4	13.3	0.000000	0.138	0.02318
30.0	44.5	19.5	46.6	29.6	13.5	0.000000	0.150	0.02499
35.0	44.6	19.6	46.9	29.9	13.6	0.000000	0.163	0.02702
40.0	44.7	19.7	47.1	30.1	13.8	0.000000	0.179	0.02934
45.0	44.8	19.8	47.3	30.3	14.0	0.000000	0.197	0.03200

PROPOSED_CS4_CS5 - Copy.txt

50.0	44.9	19.9	47.6	30.6	14.2	0.000000	0.220	0.03506
55.0	45.1	20.1	47.8	30.8	14.4	0.000000	0.247	0.03862
60.0	45.2	20.2	48.1	31.1	14.6	0.000000	0.282	0.04279
65.0	45.3	20.3	48.3	31.3	14.8	0.000000	0.325	0.04775
70.0	45.5	20.5	48.6	31.6	15.0	0.000000	0.380	0.05369
75.0	45.6	20.6	48.9	31.9	15.2	0.000000	0.453	0.06091
80.0	45.7	20.7	49.2	32.2	15.4	0.000000	0.549	0.06979
85.0	45.9	20.9	49.5	32.5	15.6	0.000000	0.679	0.08088
90.0	46.0	21.0	49.8	32.8	15.8	0.000000	0.856	0.09489
95.0	46.2	21.2	50.1	33.1	16.1	0.000000	1.097	0.11277
100.0	46.4	21.4	50.4	33.4	16.3	0.000000	1.417	0.13548
105.0	46.5	21.5	50.8	33.8	16.5	0.000000	1.805	0.16332
110.0	46.7	21.7	51.1	34.1	16.8	0.000000	2.183	0.19390
115.0	46.9	21.9	51.5	34.5	17.0	0.000000	2.352	0.21908
120.0	47.1	22.1	51.9	34.9	17.3	0.001334	2.112	0.22663
125.0	47.3	22.3	52.3	35.3	17.6	0.010068	1.571	0.21251
130.0	47.5	22.5	53.9	36.9	17.8	0.008096	1.055	0.18589
135.0	47.8	22.8	55.8	38.8	18.8	0.028301	0.661	0.15026
140.0	48.1	23.1	57.9	40.9	20.0	0.025277	0.920	0.10498
145.0	48.3	23.3	60.2	43.2	21.3	0.031353	1.064	0.08461
150.0	48.7	23.7	62.8	45.8	22.7	0.036552	1.237	0.13014
155.0	49.0	24.0	65.4	48.4	24.3	0.029964	2.008	0.20608
160.0	49.3	24.3	68.0	51.0	26.0	0.025075	2.973	0.28967
165.0	49.7	24.7	70.1	53.1	27.5	0.021592	3.724	0.37391
170.0	50.0	25.0	70.9	53.9	28.1	0.019009	3.904	0.44658
175.0	50.2	25.2	70.1	53.1	27.5	0.414042	3.444	0.49388
180.0	50.4	25.4	69.5	52.5	27.5	0.428407	2.857	0.51223
185.0	50.6	25.6	71.6	54.6	29.0	0.349014	2.889	0.51019
190.0	50.8	25.8	72.4	55.4	29.6	0.288996	3.105	0.50738
195.0	50.9	25.9	71.6	54.6	29.0	0.752525	3.023	0.51914
200.0	51.0	26.0	69.5	52.5	27.5	0.741245	3.157	0.52872
205.0	51.0	26.0	69.6	52.6	27.0	0.617468	3.872	0.51649
210.0	51.1	26.1	70.4	53.4	27.6	0.523259	4.485	0.47345
215.0	51.1	26.1	69.6	52.6	27.0	0.817581	4.531	0.40374
220.0	51.2	26.2	67.5	50.5	25.5	0.780146	4.090	0.32382
225.0	51.3	26.3	65.0	48.0	25.9	0.668089	3.491	0.24972
230.0	51.5	26.5	65.9	48.9	26.7	0.581573	2.992	0.18927
235.0	51.6	26.6	66.9	49.9	27.6	0.516373	2.713	0.14505
240.0	51.9	26.9	67.8	50.8	28.5	0.465735	2.691	0.11883
245.0	52.2	27.2	68.7	51.7	29.6	0.425188	2.936	0.11218
250.0	52.5	27.5	69.8	52.8	30.8	0.391891	3.466	0.12386

PROPOSED_CS4_CS5 - Copy.txt

255.0	52.8	27.8	72.0	55.0	32.0	0.363981	4.309	0.14950
260.0	53.2	28.2	74.4	57.4	33.4	0.340195	5.469	0.18385
265.0	53.5	28.5	76.6	59.6	34.9	0.319643	6.849	0.22199
270.0	53.8	28.8	78.6	61.6	36.2	0.301680	8.168	0.25773
275.0	54.0	29.0	79.7	62.7	37.0	0.285825	8.962	0.28281
280.0	53.9	28.9	79.6	62.6	36.9	0.800741	8.849	0.29024
285.0	53.7	28.7	78.3	61.3	36.0	2.834914	7.856	0.27958
290.0	53.4	28.4	76.3	59.3	34.6	2.970649	6.392	0.25690
295.0	52.9	27.9	74.0	57.0	33.2	2.836515	4.888	0.22951
300.0	52.5	27.5	71.6	54.6	31.8	2.632281	3.585	0.20230
305.0	52.1	27.1	69.4	52.4	30.6	2.422169	2.554	0.17753
310.0	51.7	26.7	67.6	50.6	29.4	2.229096	1.774	0.15586
315.0	51.3	26.3	66.6	49.6	28.4	2.058551	1.200	0.13723
320.0	51.0	26.0	65.7	48.7	27.4	1.909786	0.782	0.12131
325.0	50.6	25.6	64.8	47.8	26.6	1.780210	0.481	0.10770
330.0	50.3	25.3	63.9	46.9	25.8	1.666974	0.267	0.09604
335.0	50.0	25.0	63.0	46.0	25.0	1.567494	0.123	0.08601
340.0	49.7	24.7	62.1	45.1	24.4	1.479575	0.072	0.07735
345.0	49.5	24.5	61.3	44.3	23.7	1.401402	0.121	0.06984
350.0	49.2	24.2	60.5	43.5	23.1	1.331485	0.167	0.06330
355.0	48.9	23.9	59.8	42.8	22.6	1.268604	0.200	0.05758
360.0	48.7	23.7	59.1	42.1	22.1	1.211757	0.222	0.05255
365.0	48.5	23.5	58.4	41.4	21.6	1.160119	0.235	0.04812
370.0	48.3	23.3	57.7	40.7	21.1	1.113002	0.242	0.04420
375.0	48.0	23.0	57.1	40.1	20.7	1.069835	0.244	0.04071
380.0	47.8	22.8	56.5	39.5	20.3	1.030136	0.243	0.03760
385.0	47.6	22.6	55.9	38.9	19.9	0.993498	0.239	0.03483
390.0	47.4	22.4	55.4	38.4	19.6	0.959576	0.234	0.03233
395.0	47.3	22.3	54.9	37.9	19.3	0.928073	0.227	0.03009
400.0	47.1	22.1	54.4	37.4	18.9	0.898736	0.220	0.02806
405.0	46.9	21.9	53.9	36.9	18.6	0.871343	0.212	0.02623
410.0	46.7	21.7	53.4	36.4	18.3	0.845705	0.205	0.02457
415.0	46.6	21.6	53.0	36.0	18.0	0.821654	0.197	0.02305
420.0	46.4	21.4	52.6	35.6	17.8	0.799044	0.189	0.02167
425.0	46.3	21.3	52.2	35.2	17.5	0.777747	0.181	0.02041
430.0	46.1	21.1	51.8	34.8	17.2	0.757649	0.174	0.01925
435.0	46.0	21.0	51.4	34.4	17.0	0.738648	0.167	0.01819
440.0	45.8	20.8	51.0	34.0	16.7	0.720656	0.160	0.01721
445.0	45.7	20.7	50.7	33.7	16.5	0.703591	0.153	0.01631
450.0	45.6	20.6	50.3	33.3	16.2	0.687383	0.147	0.01547
455.0	45.5	20.5	50.0	33.0	16.0	0.671968	0.141	0.01470

PROPOSED_CS4_CS5 - Copy.txt

460.0	45.3	20.3	49.7	32.7	15.8	0.657285	0.135	0.01398
465.0	45.2	20.2	49.4	32.4	15.6	0.643284	0.130	0.01332
470.0	45.1	20.1	49.1	32.1	15.3	0.629917	0.125	0.01270
475.0	45.0	20.0	48.8	31.8	15.1	0.617140	0.120	0.01212
480.0	44.9	19.9	48.5	31.5	14.9	0.604914	0.115	0.01158
485.0	44.7	19.7	48.3	31.3	14.7	0.593204	0.111	0.01108
490.0	44.6	19.6	48.0	31.0	14.5	0.581976	0.106	0.01061
495.0	44.5	19.5	47.7	30.7	14.3	0.571201	0.102	0.01017

ROW Segment -5

3/ 5/2020

CROSS SECTIONS 5,,,,,,,,,

```
"VERTICAL MONOPOLE SINGLE CIRCUIT WITH L-65 230KV, L928 115KV",,,,,,,,,,
```

1,0, 9,15,0.0, 0.50, 1.00, 0.00

(ENGLISH UNITS OPTION)

(GRADIENTS ARE COMPUTED BY PROGRAM)

PHYSICAL SYSTEM CONSISTS OF 15 CONDUCTORS, OF WHICH 9 ARE ENERGIZED PHASES

OPTIONS: 'COMB',,,,,,,,,,

5.000,	6.600,	9.800,	0.000,	1.000,	75.000,	3.280,	7.300,	3.280		
'L928-A',	'A',	118.00,	20.10,	1,	1.170,	0.000,	69.700,	0.000,	0.732,	0.000
'L928-B',	'A',	130.00,	20.10,	1,	1.170,	0.000,	69.700,-120.000,		0.732,	0.000
'L928-C',	'A',	142.00,	20.10,	1,	1.170,	0.000,	69.700, 120.000,		0.732,	0.000
'L65-A',	'A',	170.00,	22.50,	1,	1.302,	0.000,	139.400,	0.000,	1.690,	0.000
'L65-B',	'A',	190.00,	22.50,	1,	1.302,	0.000,	139.400,-120.000,		1.690,	0.000
'L65-C',	'A',	210.00,	22.50,	1,	1.302,	0.000,	139.400, 120.000,		1.690,	0.000
'NEETNY-A',	'A',	277.60,	74.80,	2,	1.108,	18.000,	219.100,	0.000,	1.349,	0.000
'NEETNY-B',	'A',	274.30,	49.80,	2,	1.108,	18.000,	219.100,-120.000,		1.349,	0.000
'NEETNY-C',	'A',	277.10,	24.80,	2,	1.108,	18.000,	219.100, 120.000,		1.349,	0.000
'L928-SW1',	'A',	123.50,	47.60,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000
'L928-SW2',	'A',	136.50,	47.60,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000
'L65-SW1',	'A',	179.50,	55.30,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000
'L65-SW2',	'A',	200.50,	55.30,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000
'NEETNY-1',	'A',	264.20,	102.30,	1,	0.390,	0.000,	0.000,	0.000,	0.000,	0.000
'NEETNY-2',	'A',	292.80,	102.30,	1,	0.530,	0.000,	0.000,	0.000,	0.000,	0.000
100	0.0	5.0								

1COMBINED OUTPUT OF AUDIBLE NOISE, RADIO NOISE, TVI, OZONE CONCENTRATION, GROUND GRADIENT AND MAGNETIC FIELD
CROSS SECTIONS 4 & 5,,,,,,,,,,

"VERTICAL MONOPOLE SINGLE CIRCUIT WITH L-65 230KV, L928 115KV",,,,,,,,,,

	DIST. FROM CENTER OF TOWER (FEET)	HEIGHT (FEET)	MAXIMUM GRADIENT (KV/CM)	SUBCON DIAM. (IN)	NO. OF SUBCON	SUBCON SPACING (IN)	VOLTAGE L-N (KV)	PHASE ANGLE (DEGREES)	CURRENT (kAmps)	CORONA LOSSES (KW/MI)
L928-A	118.00	20.10	8.01	1.17	1	0.00	69.70	0.00	0.73	0.060
L928-B	130.00	20.10	8.81	1.17	1	0.00	69.70	-120.00	0.73	0.110
L928-C	142.00	20.10	8.71	1.17	1	0.00	69.70	120.00	0.73	0.102
L65-A	170.00	22.50	14.18	1.30	1	0.00	139.40	0.00	1.69	3.720
L65-B	190.00	22.50	14.59	1.30	1	0.00	139.40	-120.00	1.69	4.480
L65-C	210.00	22.50	14.03	1.30	1	0.00	139.40	120.00	1.69	3.475
NEETNY-A	277.60	74.80	17.28	1.11	2	18.00	219.10	0.00	1.35	17.424
NEETNY-B	274.30	49.80	18.52	1.11	2	18.00	219.10	-120.00	1.35	27.329
NEETNY-C	277.10	24.80	18.25	1.11	2	18.00	219.10	120.00	1.35	24.819
L928-SW1	123.50	47.60	1.41	0.39	1	0.00	0.00	0.00	0.00	0.000
L928-SW2	136.50	47.60	1.23	0.39	1	0.00	0.00	0.00	0.00	0.000
L65-SW1	179.50	55.30	1.51	0.39	1	0.00	0.00	0.00	0.00	0.000
L65-SW2	200.50	55.30	0.79	0.39	1	0.00	0.00	0.00	0.00	0.000
NEETNY-1	264.20	102.30	7.53	0.39	1	0.00	0.00	0.00	0.00	0.000
NEETNY-2	292.80	102.30	5.81	0.53	1	0.00	0.00	0.00	0.00	0.000

AN MICROPHONE HT.= 5.0 FT, RI ANT. HT.= 6.6 FT, TV ANT. HT.= 9.8 FT, ALTITUDE= 0.0 FT

RI FREQ= 1.000 MHZ, TV FREQ= 75.000 MHZ, WIND VEL.(OZ)= 0.500 MPH, GROUND CONDUCTIVITY = 7.3 MMHOS/M

E-FIELD TRANSDUCER HT.= 3.3FT, B-FIELD TRANSDUCER HT.= 3.3FT

LATERAL DIST FROM REFERENCE (FEET)	AUDIBLE NOISE (RAIN) L50 DBA	(FAIR) L50 DBA	RADIO INTERFERENCE (RAIN) L50 DBUV/M	(FAIR) L50 DBUV/M	TVI TOTAL RAIN DBUV/M	OZONE FOR RAIN RATE OF 1.00 IN/HR AT 0. FT LEVEL PPB	ELECTRIC FIELD KV/M	MAGNETIC FIELD GAUSS
0.0	43.9	18.9	45.4	28.4	12.5	0.000000	0.100	0.01665
5.0	44.0	19.0	45.6	28.6	12.6	0.000000	0.106	0.01770
10.0	44.1	19.1	45.8	28.8	12.8	0.000000	0.112	0.01886
15.0	44.2	19.2	46.0	29.0	13.0	0.000000	0.120	0.02015
20.0	44.3	19.3	46.2	29.2	13.1	0.000000	0.128	0.02158
25.0	44.4	19.4	46.4	29.4	13.3	0.000000	0.138	0.02318
30.0	44.5	19.5	46.6	29.6	13.5	0.000000	0.150	0.02499
35.0	44.6	19.6	46.9	29.9	13.6	0.000000	0.163	0.02702
40.0	44.7	19.7	47.1	30.1	13.8	0.000000	0.179	0.02934
45.0	44.8	19.8	47.3	30.3	14.0	0.000000	0.197	0.03200

PROPOSED_CS4_CS5 - Copy.txt

50.0	44.9	19.9	47.6	30.6	14.2	0.000000	0.220	0.03506
55.0	45.1	20.1	47.8	30.8	14.4	0.000000	0.247	0.03862
60.0	45.2	20.2	48.1	31.1	14.6	0.000000	0.282	0.04279
65.0	45.3	20.3	48.3	31.3	14.8	0.000000	0.325	0.04775
70.0	45.5	20.5	48.6	31.6	15.0	0.000000	0.380	0.05369
75.0	45.6	20.6	48.9	31.9	15.2	0.000000	0.453	0.06091
80.0	45.7	20.7	49.2	32.2	15.4	0.000000	0.549	0.06979
85.0	45.9	20.9	49.5	32.5	15.6	0.000000	0.679	0.08088
90.0	46.0	21.0	49.8	32.8	15.8	0.000000	0.856	0.09489
95.0	46.2	21.2	50.1	33.1	16.1	0.000000	1.097	0.11277
100.0	46.4	21.4	50.4	33.4	16.3	0.000000	1.417	0.13548
105.0	46.5	21.5	50.8	33.8	16.5	0.000000	1.805	0.16332
110.0	46.7	21.7	51.1	34.1	16.8	0.000000	2.183	0.19390
115.0	46.9	21.9	51.5	34.5	17.0	0.000000	2.352	0.21908
120.0	47.1	22.1	51.9	34.9	17.3	0.001334	2.112	0.22663
125.0	47.3	22.3	52.3	35.3	17.6	0.010068	1.571	0.21251
130.0	47.5	22.5	53.9	36.9	17.8	0.008096	1.055	0.18589
135.0	47.8	22.8	55.8	38.8	18.8	0.028301	0.661	0.15026
140.0	48.1	23.1	57.9	40.9	20.0	0.025277	0.920	0.10498
145.0	48.3	23.3	60.2	43.2	21.3	0.031353	1.064	0.08461
150.0	48.7	23.7	62.8	45.8	22.7	0.036552	1.237	0.13014
155.0	49.0	24.0	65.4	48.4	24.3	0.029964	2.008	0.20608
160.0	49.3	24.3	68.0	51.0	26.0	0.025075	2.973	0.28967
165.0	49.7	24.7	70.1	53.1	27.5	0.021592	3.724	0.37391
170.0	50.0	25.0	70.9	53.9	28.1	0.019009	3.904	0.44658
175.0	50.2	25.2	70.1	53.1	27.5	0.414042	3.444	0.49388
180.0	50.4	25.4	69.5	52.5	27.5	0.428407	2.857	0.51223
185.0	50.6	25.6	71.6	54.6	29.0	0.349014	2.889	0.51019
190.0	50.8	25.8	72.4	55.4	29.6	0.288996	3.105	0.50738
195.0	50.9	25.9	71.6	54.6	29.0	0.752525	3.023	0.51914
200.0	51.0	26.0	69.5	52.5	27.5	0.741245	3.157	0.52872
205.0	51.0	26.0	69.6	52.6	27.0	0.617468	3.872	0.51649
210.0	51.1	26.1	70.4	53.4	27.6	0.523259	4.485	0.47345
215.0	51.1	26.1	69.6	52.6	27.0	0.817581	4.531	0.40374
220.0	51.2	26.2	67.5	50.5	25.5	0.780146	4.090	0.32382
225.0	51.3	26.3	65.0	48.0	25.9	0.668089	3.491	0.24972
230.0	51.5	26.5	65.9	48.9	26.7	0.581573	2.992	0.18927
235.0	51.6	26.6	66.9	49.9	27.6	0.516373	2.713	0.14505
240.0	51.9	26.9	67.8	50.8	28.5	0.465735	2.691	0.11883
245.0	52.2	27.2	68.7	51.7	29.6	0.425188	2.936	0.11218
250.0	52.5	27.5	69.8	52.8	30.8	0.391891	3.466	0.12386

PROPOSED_CS4_CS5 - Copy.txt

255.0	52.8	27.8	72.0	55.0	32.0	0.363981	4.309	0.14950
260.0	53.2	28.2	74.4	57.4	33.4	0.340195	5.469	0.18385
265.0	53.5	28.5	76.6	59.6	34.9	0.319643	6.849	0.22199
270.0	53.8	28.8	78.6	61.6	36.2	0.301680	8.168	0.25773
275.0	54.0	29.0	79.7	62.7	37.0	0.285825	8.962	0.28281
280.0	53.9	28.9	79.6	62.6	36.9	0.800741	8.849	0.29024
285.0	53.7	28.7	78.3	61.3	36.0	2.834914	7.856	0.27958
290.0	53.4	28.4	76.3	59.3	34.6	2.970649	6.392	0.25690
295.0	52.9	27.9	74.0	57.0	33.2	2.836515	4.888	0.22951
300.0	52.5	27.5	71.6	54.6	31.8	2.632281	3.585	0.20230
305.0	52.1	27.1	69.4	52.4	30.6	2.422169	2.554	0.17753
310.0	51.7	26.7	67.6	50.6	29.4	2.229096	1.774	0.15586
315.0	51.3	26.3	66.6	49.6	28.4	2.058551	1.200	0.13723
320.0	51.0	26.0	65.7	48.7	27.4	1.909786	0.782	0.12131
325.0	50.6	25.6	64.8	47.8	26.6	1.780210	0.481	0.10770
330.0	50.3	25.3	63.9	46.9	25.8	1.666974	0.267	0.09604
335.0	50.0	25.0	63.0	46.0	25.0	1.567494	0.123	0.08601
340.0	49.7	24.7	62.1	45.1	24.4	1.479575	0.072	0.07735
345.0	49.5	24.5	61.3	44.3	23.7	1.401402	0.121	0.06984
350.0	49.2	24.2	60.5	43.5	23.1	1.331485	0.167	0.06330
355.0	48.9	23.9	59.8	42.8	22.6	1.268604	0.200	0.05758
360.0	48.7	23.7	59.1	42.1	22.1	1.211757	0.222	0.05255
365.0	48.5	23.5	58.4	41.4	21.6	1.160119	0.235	0.04812
370.0	48.3	23.3	57.7	40.7	21.1	1.113002	0.242	0.04420
375.0	48.0	23.0	57.1	40.1	20.7	1.069835	0.244	0.04071
380.0	47.8	22.8	56.5	39.5	20.3	1.030136	0.243	0.03760
385.0	47.6	22.6	55.9	38.9	19.9	0.993498	0.239	0.03483
390.0	47.4	22.4	55.4	38.4	19.6	0.959576	0.234	0.03233
395.0	47.3	22.3	54.9	37.9	19.3	0.928073	0.227	0.03009
400.0	47.1	22.1	54.4	37.4	18.9	0.898736	0.220	0.02806
405.0	46.9	21.9	53.9	36.9	18.6	0.871343	0.212	0.02623
410.0	46.7	21.7	53.4	36.4	18.3	0.845705	0.205	0.02457
415.0	46.6	21.6	53.0	36.0	18.0	0.821654	0.197	0.02305
420.0	46.4	21.4	52.6	35.6	17.8	0.799044	0.189	0.02167
425.0	46.3	21.3	52.2	35.2	17.5	0.777747	0.181	0.02041
430.0	46.1	21.1	51.8	34.8	17.2	0.757649	0.174	0.01925
435.0	46.0	21.0	51.4	34.4	17.0	0.738648	0.167	0.01819
440.0	45.8	20.8	51.0	34.0	16.7	0.720656	0.160	0.01721
445.0	45.7	20.7	50.7	33.7	16.5	0.703591	0.153	0.01631
450.0	45.6	20.6	50.3	33.3	16.2	0.687383	0.147	0.01547
455.0	45.5	20.5	50.0	33.0	16.0	0.671968	0.141	0.01470

PROPOSED_CS4_CS5 - Copy.txt

460.0	45.3	20.3	49.7	32.7	15.8	0.657285	0.135	0.01398
465.0	45.2	20.2	49.4	32.4	15.6	0.643284	0.130	0.01332
470.0	45.1	20.1	49.1	32.1	15.3	0.629917	0.125	0.01270
475.0	45.0	20.0	48.8	31.8	15.1	0.617140	0.120	0.01212
480.0	44.9	19.9	48.5	31.5	14.9	0.604914	0.115	0.01158
485.0	44.7	19.7	48.3	31.3	14.7	0.593204	0.111	0.01108
490.0	44.6	19.6	48.0	31.0	14.5	0.581976	0.106	0.01061
495.0	44.5	19.5	47.7	30.7	14.3	0.571201	0.102	0.01017

ROW Segment -6

3/ 5/2020

CROSS SECTION 6,,,,,,,,

(ENGLISH UNITS OPTION)

PHYSICAL SYSTEM CONSISTS OF 19 CONDUCTORS, OF WHICH 12 ARE ENERGIZED PHASES

OPTIONS: 'COMB',,,,,,,,,,

Page 1

PROPOSED_CS6.txt

'NEETNY-2','A', 292.80, 99.50, 1, 0.530, 0.000, 0.000, 0.000, 0.000, 0.000
100 0.0 5.0

1COMBINED OUTPUT OF AUDIBLE NOISE, RADIO NOISE, TVI, OZONE CONCENTRATION, GROUND GRADIENT AND MAGNETIC FIELD
CROSS SECTION 6,,,,,,,,,
"VERTICAL MONOPOLE SINGLE CIRCUIT WITH L-65 230KV, L928 115KV, L525 34.5

	DIST. FROM CENTER OF TOWER (FEET)	HEIGHT (FEET)	MAXIMUM GRADIENT (KV/CM)	SUBCON DIAM. (IN)	NO. OF SUBCON	SUBCON SPACING (IN)	VOLTAGE L-N (KV)	PHASE ANGLE (DEGREES)	CURRENT (kAmps)	CORONA LOSSES (KW/MI)
L525-A	37.50	25.50	3.66	0.79	1	0.00	20.91	0.00	0.95	0.000
L525-B	35.50	18.50	3.85	0.79	1	0.00	20.91	-120.00	0.95	0.000
L525-C	44.50	18.50	3.76	0.79	1	0.00	20.91	120.00	0.95	0.000
L928-A	118.00	20.10	8.02	1.17	1	0.00	69.70	0.00	0.73	0.060
L928-B	130.00	20.10	8.81	1.17	1	0.00	69.70	-120.00	0.73	0.110
L928-C	142.00	20.10	8.70	1.17	1	0.00	69.70	120.00	0.73	0.101
L65-A	170.00	22.50	14.18	1.30	1	0.00	139.40	0.00	1.69	3.731
L65-B	190.00	22.50	14.60	1.30	1	0.00	139.40	-120.00	1.69	4.507
L65-C	210.00	22.50	13.97	1.30	1	0.00	139.40	120.00	1.69	3.386
NEETNY-A	277.60	78.50	17.47	1.11	2	18.00	219.10	0.00	1.35	18.669
NEETNY-B	274.30	53.50	18.52	1.11	2	18.00	219.10	-120.00	1.35	27.323
NEETNY-C	277.10	28.50	18.01	1.11	2	18.00	219.10	120.00	1.35	22.741
L525-SW	40.00	41.00	0.77	0.39	1	0.00	0.00	0.00	0.00	0.000
L928-SW1	123.50	43.70	1.48	0.39	1	0.00	0.00	0.00	0.00	0.000
L928-SW2	136.50	43.70	1.12	0.39	1	0.00	0.00	0.00	0.00	0.000
L65-SW1	179.50	50.50	1.66	0.39	1	0.00	0.00	0.00	0.00	0.000
L65-SW2	200.50	50.50	1.23	0.39	1	0.00	0.00	0.00	0.00	0.000
NEETNY-1	264.20	99.50	8.71	0.39	1	0.00	0.00	0.00	0.00	0.000
NEETNY-2	292.80	99.50	6.62	0.53	1	0.00	0.00	0.00	0.00	0.000

AN MICROPHONE HT.= 5.0 FT, RI ANT. HT.= 6.6 FT, TV ANT. HT.= 9.8 FT, ALTITUDE= 0.0 FT

RI FREQ= 1.000 MHZ, TV FREQ= 75.000 MHZ, WIND VEL.(OZ)= 0.500 MPH, GROUND CONDUCTIVITY = 7.3 MMHOS/M

E-FIELD TRANSDUCER HT.= 3.3FT, B-FIELD TRANSDUCER HT.= 3.3FT

LATERAL DIST FROM REFERENCE (FEET)	AUDIBLE NOISE		RADIO INTERFERENCE		TVI	OZONE		ELECTRIC FIELD KV/M	MAGNETIC FIELD GAUSS
	(RAIN)	(FAIR)	(RAIN)	(FAIR)	TOTAL	FOR RAIN RATE OF			
	L50	L50	L50	L50	RAIN	1.00 IN/HR AT 0. FT LEVEL			
	DBA	DBA	DBUV/M	DBUV/M	DBUV/M	PPB			
0.0	43.8	18.8	46.0	29.0	12.5	0.000000		0.138	0.03938
5.0	43.8	18.8	46.2	29.2	12.6	0.000000		0.156	0.04590

PROPOSED_CS6.txt

10.0	43.9	18.9	46.4	29.4	12.8	0.000000	0.180	0.05476
15.0	44.0	19.0	46.6	29.6	12.9	0.000000	0.217	0.06729
20.0	44.1	19.1	46.8	29.8	13.1	0.000000	0.272	0.08547
25.0	44.3	19.3	47.0	30.0	13.3	0.000000	0.346	0.11128
30.0	44.4	19.4	47.2	30.2	13.5	0.000000	0.408	0.14350
35.0	44.5	19.5	47.4	30.4	13.6	0.000000	0.389	0.17212
40.0	44.6	19.6	47.7	30.7	13.8	0.000051	0.325	0.18082
45.0	44.7	19.7	47.9	30.9	14.0	0.000067	0.394	0.16382
50.0	44.8	19.8	48.1	31.1	14.2	0.000097	0.394	0.13384
55.0	44.9	19.9	48.4	31.4	14.4	0.000079	0.304	0.10970
60.0	45.1	20.1	48.7	31.7	14.5	0.000064	0.220	0.09688
65.0	45.2	20.2	48.9	31.9	14.7	0.000054	0.224	0.09043
70.0	45.3	20.3	49.2	32.2	14.9	0.000047	0.292	0.08792
75.0	45.5	20.5	49.5	32.5	15.2	0.000041	0.385	0.08866
80.0	45.6	20.6	49.8	32.8	15.4	0.000037	0.498	0.09246
85.0	45.8	20.8	50.0	33.0	15.6	0.000034	0.641	0.09949
90.0	45.9	20.9	50.4	33.4	15.8	0.000031	0.827	0.11019
95.0	46.1	21.1	50.7	33.7	16.0	0.000029	1.074	0.12525
100.0	46.2	21.2	51.0	34.0	16.3	0.000027	1.398	0.14544
105.0	46.4	21.4	51.3	34.3	16.5	0.000025	1.789	0.17086
110.0	46.6	21.6	51.7	34.7	16.7	0.000023	2.168	0.19891
115.0	46.8	21.8	52.0	35.0	17.0	0.000022	2.337	0.22134
120.0	47.0	22.0	52.4	35.4	17.2	0.001367	2.097	0.22608
125.0	47.2	22.2	52.8	35.8	17.5	0.010177	1.557	0.20950
130.0	47.4	22.4	53.9	36.9	17.8	0.008186	1.045	0.18116
135.0	47.7	22.7	55.8	38.8	18.8	0.028434	0.664	0.14487
140.0	47.9	22.9	57.9	40.9	20.0	0.025394	0.931	0.10104
145.0	48.2	23.2	60.2	43.2	21.3	0.031328	1.075	0.08536
150.0	48.5	23.5	62.8	45.8	22.7	0.036417	1.239	0.13277
155.0	48.9	23.9	65.5	48.5	24.4	0.029865	2.003	0.20833
160.0	49.2	24.2	68.1	51.1	26.1	0.025003	2.965	0.29106
165.0	49.6	24.6	70.1	53.1	27.5	0.021538	3.714	0.37436
170.0	49.9	24.9	70.9	53.9	28.2	0.018967	3.892	0.44618
175.0	50.1	25.1	70.1	53.1	27.5	0.415626	3.429	0.49284
180.0	50.3	25.3	69.6	52.6	27.6	0.430063	2.836	0.51081
185.0	50.5	25.5	71.6	54.6	29.0	0.350356	2.869	0.50859
190.0	50.6	25.6	72.5	55.5	29.7	0.290102	3.091	0.50572
195.0	50.7	25.7	71.6	54.6	29.0	0.757443	3.022	0.51773
200.0	50.8	25.8	69.6	52.6	27.6	0.746200	3.181	0.52808
205.0	50.8	25.8	69.4	52.4	26.8	0.621546	3.920	0.51710
210.0	50.9	25.9	70.2	53.2	27.4	0.526673	4.553	0.47560

PROPOSED_CS6.txt

215.0	50.9	25.9	69.4	52.4	26.8	0.808312	4.620	0.40755
220.0	50.9	25.9	67.3	50.3	25.3	0.770028	4.203	0.32925
225.0	51.0	26.0	65.0	48.0	25.0	0.660095	3.627	0.25667
230.0	51.1	26.1	65.9	48.9	25.8	0.575171	3.146	0.19763
235.0	51.3	26.3	66.7	49.7	26.6	0.511084	2.875	0.15430
240.0	51.5	26.5	67.6	50.6	27.5	0.461245	2.843	0.12747
245.0	51.7	26.7	68.4	51.4	28.5	0.421294	3.051	0.11759
250.0	51.9	26.9	69.2	52.2	29.5	0.388456	3.497	0.12328
255.0	52.2	27.2	71.1	54.1	30.6	0.360909	4.176	0.14078
260.0	52.5	27.5	73.0	56.0	31.8	0.337417	5.054	0.16538
265.0	52.7	27.7	74.8	57.8	32.9	0.317108	6.028	0.19244
270.0	52.9	27.9	76.3	59.3	33.9	0.299347	6.894	0.21716
275.0	53.0	28.0	77.0	60.0	34.4	0.283665	7.381	0.23446
280.0	53.0	28.0	77.0	60.0	34.3	0.480260	7.293	0.24059
285.0	52.8	27.8	76.1	59.1	33.7	2.257369	6.640	0.23513
290.0	52.6	27.6	74.6	57.6	32.7	2.591176	5.631	0.22098
295.0	52.2	27.2	72.7	55.7	31.6	2.579619	4.521	0.20222
300.0	51.9	26.9	70.8	53.8	30.5	2.451934	3.489	0.18217
305.0	51.6	26.6	68.9	51.9	29.4	2.289781	2.617	0.16283
310.0	51.2	26.2	67.4	50.4	28.3	2.127685	1.920	0.14514
315.0	50.9	25.9	66.5	49.5	27.4	1.977960	1.379	0.12938
320.0	50.6	25.6	65.7	48.7	26.5	1.843745	0.969	0.11555
325.0	50.3	25.3	64.8	47.8	25.7	1.724701	0.660	0.10347
330.0	50.0	25.0	64.0	47.0	24.9	1.619330	0.429	0.09294
335.0	49.7	24.7	63.1	46.1	24.2	1.525884	0.259	0.08376
340.0	49.4	24.4	62.3	45.3	23.5	1.442705	0.135	0.07574
345.0	49.2	24.2	61.6	44.6	23.0	1.368331	0.057	0.06871
350.0	48.9	23.9	60.8	43.8	22.5	1.301513	0.062	0.06254
355.0	48.7	23.7	60.1	43.1	22.1	1.241201	0.101	0.05710
360.0	48.5	23.5	59.4	42.4	21.7	1.186513	0.133	0.05229
365.0	48.2	23.2	58.8	41.8	21.3	1.136710	0.156	0.04802
370.0	48.0	23.0	58.1	41.1	20.9	1.091172	0.172	0.04423
375.0	47.8	22.8	57.5	40.5	20.5	1.049375	0.182	0.04084
380.0	47.6	22.6	57.0	40.0	20.2	1.010876	0.188	0.03781
385.0	47.4	22.4	56.4	39.4	19.8	0.975298	0.190	0.03509
390.0	47.3	22.3	55.9	38.9	19.5	0.942317	0.190	0.03264
395.0	47.1	22.1	55.4	38.4	19.2	0.911657	0.188	0.03043
400.0	46.9	21.9	54.9	37.9	18.9	0.883078	0.185	0.02843
405.0	46.7	21.7	54.4	37.4	18.6	0.856371	0.181	0.02661
410.0	46.6	21.6	54.0	37.0	18.3	0.831355	0.177	0.02496
415.0	46.4	21.4	53.5	36.5	18.0	0.807873	0.172	0.02345

PROPOSED_CS6.txt

420.0	46.3	21.3	53.1	36.1	17.7	0.785785	0.166	0.02208
425.0	46.1	21.1	52.7	35.7	17.4	0.764967	0.161	0.02082
430.0	46.0	21.0	52.3	35.3	17.2	0.745312	0.155	0.01966
435.0	45.8	20.8	51.9	34.9	16.9	0.726722	0.150	0.01859
440.0	45.7	20.7	51.6	34.6	16.7	0.709111	0.145	0.01761
445.0	45.6	20.6	51.2	34.2	16.4	0.692402	0.139	0.01670
450.0	45.4	20.4	50.9	33.9	16.2	0.676526	0.134	0.01586
455.0	45.3	20.3	50.6	33.6	16.0	0.661421	0.129	0.01508
460.0	45.2	20.2	50.3	33.3	15.7	0.647030	0.125	0.01436
465.0	45.1	20.1	50.0	33.0	15.5	0.633304	0.120	0.01369
470.0	44.9	19.9	49.7	32.7	15.3	0.620195	0.116	0.01306
475.0	44.8	19.8	49.4	32.4	15.1	0.607662	0.112	0.01248
480.0	44.7	19.7	49.2	32.2	14.9	0.595667	0.107	0.01193
485.0	44.6	19.6	48.9	31.9	14.7	0.584175	0.104	0.01142
490.0	44.5	19.5	48.7	31.7	14.5	0.573155	0.100	0.01094
495.0	44.4	19.4	48.4	31.4	14.3	0.562577	0.096	0.01049

ROW Segment -7

11:18:05

"VERTICAL MONOPOLE L-65 230KV, L928 115KV, L525 34.5kV, L926 115KV",,,,
1,0,15,24,0.0, 0.50, 1.00, 0.00

(GRADIENTS ARE COMPUTED BY PROGRAM)

OPTIONS: 'COMB',,,,,,,,,,

Page 1

PROPOSED_CS7.txt

'L928-SW1','A', 113.50, 51.30, 1, 0.390, 0.000, 0.000, 0.000, 0.000, 0.000
 'L928-SW2','A', 126.50, 51.30, 1, 0.390, 0.000, 0.000, 0.000, 0.000, 0.000
 'L65-SW1 ','A', 169.50, 56.30, 1, 0.390, 0.000, 0.000, 0.000, 0.000, 0.000
 'L65-SW2 ','A', 190.50, 56.30, 1, 0.390, 0.000, 0.000, 0.000, 0.000, 0.000
 'NEETNY-1','A', 254.20, 106.20, 1, 0.390, 0.000, 0.000, 0.000, 0.000, 0.000
 'NEETNY-2','A', 282.80, 106.20, 1, 0.530, 0.000, 0.000, 0.000, 0.000, 0.000
 100 0.0 5.0

1COMBINED OUTPUT OF AUDIBLE NOISE, RADIO NOISE, TVI, OZONE CONCENTRATION, GROUND GRADIENT AND MAGNETIC FIELD
 CROSS SECTION 7,,,,,,,,,

"VERTICAL MONOPOLE L-65 230KV, L928 115KV, L525 34.5kV, L926 115KV",,,,,,

	DIST. FROM CENTER OF TOWER (FEET)	HEIGHT (FEET)	MAXIMUM GRADIENT (KV/CM)	SUBCON DIAM. (IN)	NO. OF SUBCON	SUBCON SPACING (IN)	VOLTAGE L-N (KV)	PHASE ANGLE (DEGREES)	CURRENT (kAmps)	CORONA LOSSES (KW/MI)
L525-A	27.50	25.50	3.48	0.79	1	0.00	20.90	0.00	0.95	0.000
L525-B	25.50	18.50	3.89	0.79	1	0.00	20.90	-120.00	0.95	0.000
L525-C	34.50	18.50	3.99	0.79	1	0.00	20.90	120.00	0.95	0.000
L926-A	63.00	20.10	7.88	1.21	1	0.00	69.70	0.00	0.83	0.062
L926-B	75.00	20.10	8.53	1.21	1	0.00	69.70	-120.00	0.83	0.103
L926-C	87.00	20.10	8.32	1.21	1	0.00	69.70	120.00	0.83	0.087
L928-A	108.00	20.10	8.38	1.17	1	0.00	69.70	0.00	0.73	0.080
L928-B	120.00	20.10	8.84	1.17	1	0.00	69.70	-120.00	0.73	0.113
L928-C	132.00	20.10	8.63	1.17	1	0.00	69.70	120.00	0.73	0.096
L65-A	160.00	22.50	14.21	1.30	1	0.00	139.40	0.00	1.69	3.773
L65-B	180.00	22.50	14.59	1.30	1	0.00	139.40	-120.00	1.69	4.491
L65-C	200.00	22.50	13.93	1.30	1	0.00	139.40	120.00	1.69	3.318
NEETNY-A	267.60	81.30	17.38	1.11	2	18.00	219.10	0.00	1.35	18.042
NEETNY-B	264.30	56.30	18.54	1.11	2	18.00	219.10	-120.00	1.35	27.526
NEETNY-C	267.10	31.30	17.87	1.11	2	18.00	219.10	120.00	1.35	21.663
L525-SW	30.00	45.20	1.01	0.39	1	0.00	0.00	0.00	0.00	0.000
L926-SW1	68.50	51.30	0.85	0.39	1	0.00	0.00	0.00	0.00	0.000
L926-SW2	81.50	51.30	0.54	0.39	1	0.00	0.00	0.00	0.00	0.000
L928-SW1	113.50	51.30	0.73	0.39	1	0.00	0.00	0.00	0.00	0.000
L928-SW2	126.50	51.30	0.89	0.39	1	0.00	0.00	0.00	0.00	0.000
L65-SW1	169.50	56.30	1.26	0.39	1	0.00	0.00	0.00	0.00	0.000
L65-SW2	190.50	56.30	0.89	0.39	1	0.00	0.00	0.00	0.00	0.000
NEETNY-1	254.20	106.20	7.91	0.39	1	0.00	0.00	0.00	0.00	0.000
NEETNY-2	282.80	106.20	6.06	0.53	1	0.00	0.00	0.00	0.00	0.000

PROPOSED_CS7.txt

AN MICROPHONE HT.= 5.0 FT, RI ANT. HT.= 6.6 FT, TV ANT. HT.= 9.8 FT, ALTITUDE= 0.0 FT
 RI FREQ= 1.000 MHZ, TV FREQ= 75.000 MHZ, WIND VEL.(OZ)= 0.500 MPH, GROUND CONDUCTIVITY = 7.3 MMHOS/M
 E-FIELD TRANSDUCER HT.= 3.3FT, B-FIELD TRANSDUCER HT.= 3.3FT

LATERAL DIST FROM REFERENCE (FEET)	AUDIBLE NOISE		RADIO INTERFERENCE		TVI TOTAL RAIN DBUV/M	OZONE FOR RAIN RATE OF 1.00 IN/HR AT 0. FT LEVEL PPB	ELECTRIC FIELD KV/M	MAGNETIC FIELD GAUSS
	(RAIN) L50 DBA	(FAIR) L50 DBA	(RAIN) L50 DBUV/M	(FAIR) L50 DBUV/M				
0.0	43.8	18.8	46.9	29.9	12.8	0.000000	0.209	0.06739
5.0	43.9	18.9	47.1	30.1	13.0	0.000000	0.246	0.07964
10.0	44.0	19.0	47.3	30.3	13.2	0.000000	0.298	0.09646
15.0	44.1	19.1	47.5	30.5	13.3	0.000000	0.363	0.11931
20.0	44.2	19.2	47.7	30.7	13.5	0.000000	0.406	0.14654
25.0	44.3	19.3	47.9	30.9	13.7	0.000000	0.350	0.16809
30.0	44.5	19.5	48.1	31.1	13.8	0.000055	0.202	0.16897
35.0	44.6	19.6	48.4	31.4	14.0	0.000063	0.268	0.14732
40.0	44.7	19.7	48.6	31.6	14.2	0.000119	0.549	0.12598
45.0	44.8	19.8	48.9	31.9	14.4	0.000097	0.965	0.14049
50.0	44.9	19.9	49.1	32.1	14.6	0.000078	1.460	0.16659
55.0	45.1	20.1	49.4	32.4	14.8	0.000065	1.922	0.19395
60.0	45.2	20.2	49.7	32.7	15.0	0.000056	2.148	0.21623
65.0	45.3	20.3	49.9	32.9	15.2	0.001383	1.943	0.22328
70.0	45.5	20.5	50.2	33.2	15.4	0.010106	1.438	0.21184
75.0	45.6	20.6	50.5	33.5	15.6	0.008131	1.010	0.19142
80.0	45.8	20.8	50.8	33.8	15.8	0.025550	0.868	0.16775
85.0	45.9	20.9	51.1	34.1	16.1	0.022767	1.156	0.13565
90.0	46.1	21.1	51.4	34.4	16.3	0.026938	1.212	0.09929
95.0	46.3	21.3	51.8	34.8	16.5	0.030594	0.951	0.07518
100.0	46.5	21.5	52.1	35.1	16.8	0.025170	1.064	0.10710
105.0	46.7	21.7	52.5	35.5	17.0	0.021144	1.408	0.13665
110.0	46.9	21.9	52.9	35.9	17.3	0.020223	1.398	0.15076
115.0	47.1	22.1	53.2	36.2	17.5	0.030902	1.093	0.14566
120.0	47.3	22.3	54.0	37.0	17.9	0.026343	0.854	0.13092
125.0	47.5	22.5	55.9	38.9	18.9	0.045098	0.775	0.11185
130.0	47.8	22.8	58.0	41.0	20.1	0.040407	1.044	0.08933
135.0	48.1	23.1	60.3	43.3	21.4	0.044278	1.140	0.08750
140.0	48.4	23.4	62.9	45.9	22.8	0.047720	1.229	0.13781
145.0	48.8	23.8	65.5	48.5	24.5	0.040501	1.969	0.20794
150.0	49.1	24.1	68.2	51.2	26.2	0.035052	2.929	0.28534
155.0	49.5	24.5	70.2	53.2	27.6	0.031050	3.680	0.36470
160.0	49.8	24.8	71.0	54.0	28.2	0.027990	3.861	0.43420

PROPOSED_CS7.txt

165.0	50.0	25.0	70.2	53.2	27.6	0.430043	3.401	0.48026
170.0	50.2	25.2	69.6	52.6	27.6	0.444313	2.815	0.49897
175.0	50.4	25.4	71.6	54.6	29.0	0.363095	2.864	0.49797
180.0	50.5	25.5	72.4	55.4	29.6	0.301643	3.097	0.49617
185.0	50.6	25.6	71.6	54.6	29.0	0.765580	3.041	0.50974
190.0	50.6	25.6	69.6	52.6	27.6	0.753505	3.216	0.52241
195.0	50.7	25.7	69.2	52.2	26.6	0.628739	3.965	0.51426
200.0	50.7	25.7	70.0	53.0	27.2	0.533728	4.607	0.47584
205.0	50.7	25.7	69.2	52.2	26.6	0.806099	4.684	0.41062
210.0	50.7	25.7	67.1	50.1	25.1	0.767258	4.278	0.33459
215.0	50.8	25.8	65.1	48.1	24.8	0.658921	3.712	0.26365
220.0	50.9	25.9	65.9	48.9	25.3	0.575158	3.237	0.20569
225.0	51.0	26.0	66.7	49.7	26.0	0.511849	2.962	0.16273
230.0	51.2	26.2	67.5	50.5	26.8	0.462542	2.912	0.13504
235.0	51.4	26.4	68.2	51.2	27.7	0.422962	3.083	0.12254
240.0	51.6	26.6	68.9	51.9	28.7	0.390388	3.460	0.12392
245.0	51.8	26.8	70.5	53.5	29.7	0.363031	4.024	0.13604
250.0	52.0	27.0	72.1	55.1	30.7	0.339677	4.728	0.15471
255.0	52.2	27.2	73.6	56.6	31.6	0.319467	5.479	0.17571
260.0	52.4	27.4	74.8	57.8	32.4	0.301778	6.117	0.19493
265.0	52.4	27.4	75.4	58.4	32.8	0.286146	6.461	0.20860
270.0	52.4	27.4	75.4	58.4	32.8	0.375272	6.382	0.21409
275.0	52.2	27.2	74.6	57.6	32.3	1.920417	5.886	0.21097
280.0	52.0	27.0	73.4	56.4	31.5	2.354935	5.105	0.20093
285.0	51.8	26.8	71.9	54.9	30.5	2.404888	4.212	0.18666
290.0	51.5	26.5	70.2	53.2	29.5	2.317955	3.346	0.17062
295.0	51.2	26.2	68.5	51.5	28.5	2.183444	2.583	0.15451
300.0	50.9	25.9	67.2	50.2	27.6	2.040567	1.950	0.13928
305.0	50.6	25.6	66.5	49.5	26.7	1.904637	1.443	0.12536
310.0	50.3	25.3	65.7	48.7	25.9	1.780653	1.046	0.11287
315.0	50.0	25.0	64.9	47.9	25.1	1.669424	0.739	0.10178
320.0	49.7	24.7	64.1	47.1	24.4	1.570183	0.505	0.09198
325.0	49.4	24.4	63.3	46.3	23.7	1.481654	0.327	0.08333
330.0	49.2	24.2	62.5	45.5	23.3	1.402497	0.194	0.07570
335.0	48.9	23.9	61.8	44.8	22.9	1.331469	0.097	0.06896
340.0	48.7	23.7	61.1	44.1	22.4	1.267476	0.043	0.06300
345.0	48.5	23.5	60.4	43.4	22.0	1.209579	0.060	0.05771
350.0	48.2	23.2	59.7	42.7	21.6	1.156979	0.095	0.05301
355.0	48.0	23.0	59.1	42.1	21.2	1.108999	0.123	0.04882
360.0	47.8	22.8	58.5	41.5	20.9	1.065066	0.143	0.04508
365.0	47.6	22.6	57.9	40.9	20.5	1.024693	0.157	0.04173

PROPOSED_CS7.txt

370.0	47.4	22.4	57.3	40.3	20.2	0.987466	0.166	0.03871
375.0	47.2	22.2	56.8	39.8	19.8	0.953031	0.171	0.03600
380.0	47.1	22.1	56.3	39.3	19.5	0.921084	0.173	0.03355
385.0	46.9	21.9	55.8	38.8	19.2	0.891362	0.174	0.03134
390.0	46.7	21.7	55.3	38.3	18.9	0.863638	0.172	0.02932
395.0	46.6	21.6	54.8	37.8	18.6	0.837716	0.170	0.02749
400.0	46.4	21.4	54.4	37.4	18.3	0.813422	0.167	0.02583
405.0	46.2	21.2	53.9	36.9	18.0	0.790606	0.163	0.02430
410.0	46.1	21.1	53.5	36.5	17.7	0.769134	0.158	0.02290
415.0	45.9	20.9	53.1	36.1	17.4	0.748888	0.154	0.02162
420.0	45.8	20.8	52.8	35.8	17.2	0.729766	0.149	0.02044
425.0	45.7	20.7	52.4	35.4	16.9	0.711673	0.144	0.01936
430.0	45.5	20.5	52.0	35.0	16.7	0.694528	0.140	0.01836
435.0	45.4	20.4	51.7	34.7	16.5	0.678255	0.135	0.01743
440.0	45.3	20.3	51.4	34.4	16.2	0.662789	0.130	0.01657
445.0	45.1	20.1	51.0	34.0	16.0	0.648070	0.126	0.01577
450.0	45.0	20.0	50.7	33.7	15.8	0.634044	0.121	0.01503
455.0	44.9	19.9	50.4	33.4	15.5	0.620661	0.117	0.01434
460.0	44.8	19.8	50.1	33.1	15.3	0.607877	0.113	0.01370
465.0	44.7	19.7	49.8	32.8	15.1	0.595653	0.109	0.01310
470.0	44.5	19.5	49.6	32.6	14.9	0.583951	0.105	0.01253
475.0	44.4	19.4	49.3	32.3	14.7	0.572738	0.101	0.01201
480.0	44.3	19.3	49.0	32.0	14.5	0.561983	0.098	0.01151
485.0	44.2	19.2	48.8	31.8	14.3	0.551657	0.094	0.01105
490.0	44.1	19.1	48.6	31.6	14.2	0.541735	0.091	0.01061
495.0	44.0	19.0	48.3	31.3	14.0	0.532193	0.088	0.01020

ROW Segment -8

11:18:35

11:18:35

"VERTICAL MONOPOLE SINGLE CIRCUIT WITH L-65 230KV, L928 115KV, L926 115KV
1,0,12,20,0.0, 0.50, 1.00, 0.00

(GRADIENTS ARE COMPUTED BY PROGRAM)

OPTIONS: 'COMB',,,,,,,,,,

Page 1

PROPOSED_CS8.txt

'NEETNY-1','A', 259.20, 103.60, 1, 0.390, 0.000, 0.000, 0.000, 0.000, 0.000
 'NEETNY-2','A', 287.80, 103.60, 1, 0.530, 0.000, 0.000, 0.000, 0.000, 0.000
 100 0.0 5.0

1COMBINED OUTPUT OF AUDIBLE NOISE, RADIO NOISE, TVI, OZONE CONCENTRATION, GROUND GRADIENT AND MAGNETIC FIELD
 CROSS SECTION 8,,,,,,,,,

"VERTICAL MONOPOLE SINGLE CIRCUIT WITH L-65 230KV, L928 115KV, L926 115K

	DIST. FROM CENTER OF TOWER (FEET)	HEIGHT (FEET)	MAXIMUM GRADIENT (KV/CM)	SUBCON DIAM. (IN)	NO. OF SUBCON	SUBCON SPACING (IN)	VOLTAGE L-N (KV)	PHASE ANGLE (DEGREES)	CURRENT (kAmps)	CORONA LOSSES (KW/MI)
L926-A	68.00	20.10	7.84	1.21	1	0.00	69.70	0.00	0.83	0.060
L926-B	80.00	20.10	8.52	1.21	1	0.00	69.70	-120.00	0.83	0.102
L926-C	92.00	20.10	8.33	1.21	1	0.00	69.70	120.00	0.83	0.088
L928-A	113.00	20.10	8.38	1.17	1	0.00	69.70	0.00	0.73	0.080
L928-B	125.00	20.10	8.84	1.17	1	0.00	69.70	-120.00	0.73	0.113
L928-C	137.00	20.10	8.64	1.17	1	0.00	69.70	120.00	0.73	0.097
L65-A	165.00	22.50	14.19	1.30	1	0.00	139.40	0.00	1.69	3.752
L65-B	185.00	22.50	14.59	1.30	1	0.00	139.40	-120.00	1.69	4.481
L65-C	205.00	22.50	14.01	1.30	1	0.00	139.40	120.00	1.69	3.445
NEETNY-A	272.60	75.80	17.28	1.11	2	18.00	219.10	0.00	1.35	17.431
NEETNY-B	269.30	50.80	18.53	1.11	2	18.00	219.10	-120.00	1.35	27.383
NEETNY-C	272.10	25.80	18.18	1.11	2	18.00	219.10	120.00	1.35	24.217
L926-SW1	73.50	48.30	1.02	0.39	1	0.00	0.00	0.00	0.00	0.000
L926-SW2	86.50	48.30	0.56	0.39	1	0.00	0.00	0.00	0.00	0.000
L928-SW1	118.50	48.30	0.78	0.39	1	0.00	0.00	0.00	0.00	0.000
L928-SW2	131.50	48.30	0.91	0.39	1	0.00	0.00	0.00	0.00	0.000
L65-SW1	174.50	56.10	1.39	0.39	1	0.00	0.00	0.00	0.00	0.000
L65-SW2	195.50	56.10	0.78	0.39	1	0.00	0.00	0.00	0.00	0.000
NEETNY-1	259.20	103.60	7.46	0.39	1	0.00	0.00	0.00	0.00	0.000
NEETNY-2	287.80	103.60	5.76	0.53	1	0.00	0.00	0.00	0.00	0.000

AN MICROPHONE HT.= 5.0 FT, RI ANT. HT.= 6.6 FT, TV ANT. HT.= 9.8 FT, ALTITUDE= 0.0 FT

RI FREQ= 1.000 MHZ, TV FREQ= 75.000 MHZ, WIND VEL.(OZ)= 0.500 MPH, GROUND CONDUCTIVITY = 7.3 MMHOS/M

E-FIELD TRANSDUCER HT.= 3.3FT, B-FIELD TRANSDUCER HT.= 3.3FT

LATERAL DIST FROM REFERENCE (FEET)	AUDIBLE NOISE (RAIN) L50 DBA	AUDIBLE NOISE (FAIR) L50 DBA	RADIO INTERFERENCE (RAIN) L50 DBUV/M	RADIO INTERFERENCE (FAIR) L50 DBUV/M	TVI TOTAL RAIN DBUV/M	OZONE FOR RAIN RATE OF 1.00 IN/HR AT 0. FT LEVEL PPB	ELECTRIC FIELD KV/M	MAGNETIC FIELD GAUSS
---	---------------------------------------	---------------------------------------	---	---	--------------------------------	---	---------------------------	----------------------------

PROPOSED_CS8.txt

0.0	43.9	18.9	45.8	28.8	12.7	0.000000	0.190	0.03503
5.0	44.0	19.0	46.0	29.0	12.8	0.000000	0.216	0.03855
10.0	44.1	19.1	46.2	29.2	13.0	0.000000	0.248	0.04268
15.0	44.2	19.2	46.4	29.4	13.1	0.000000	0.290	0.04759
20.0	44.3	19.3	46.6	29.6	13.3	0.000000	0.343	0.05351
25.0	44.4	19.4	46.8	29.8	13.5	0.000000	0.414	0.06072
30.0	44.5	19.5	47.0	30.0	13.7	0.000000	0.508	0.06964
35.0	44.7	19.7	47.3	30.3	13.8	0.000000	0.637	0.08085
40.0	44.8	19.8	47.5	30.5	14.0	0.000000	0.812	0.09512
45.0	44.9	19.9	47.7	30.7	14.2	0.000000	1.052	0.11350
50.0	45.0	20.0	48.0	31.0	14.4	0.000000	1.370	0.13714
55.0	45.1	20.1	48.2	31.2	14.6	0.000000	1.758	0.16664
60.0	45.3	20.3	48.5	31.5	14.8	0.000000	2.134	0.20006
65.0	45.4	20.4	48.8	31.8	15.0	0.000000	2.297	0.22965
70.0	45.5	20.5	49.1	32.1	15.2	0.001277	2.049	0.24303
75.0	45.7	20.7	49.4	32.4	15.4	0.009635	1.510	0.23519
80.0	45.8	20.8	49.7	32.7	15.6	0.007747	1.044	0.21486
85.0	46.0	21.0	50.0	33.0	15.8	0.025062	0.855	0.18734
90.0	46.1	21.1	50.3	33.3	16.1	0.022345	1.139	0.14740
95.0	46.3	21.3	50.6	33.6	16.3	0.026678	1.199	0.10037
100.0	46.5	21.5	51.0	34.0	16.5	0.030457	0.943	0.06686
105.0	46.7	21.7	51.3	34.3	16.8	0.025036	1.066	0.09931
110.0	46.9	21.9	51.7	34.7	17.0	0.021012	1.411	0.13243
115.0	47.1	22.1	52.1	35.1	17.3	0.020092	1.401	0.15052
120.0	47.3	22.3	52.4	35.4	17.6	0.030755	1.096	0.14867
125.0	47.5	22.5	54.0	37.0	17.8	0.026207	0.856	0.13594
130.0	47.7	22.7	55.9	38.9	18.9	0.044949	0.773	0.11714
135.0	48.0	23.0	58.0	41.0	20.0	0.040269	1.040	0.09218
140.0	48.3	23.3	60.3	43.3	21.3	0.044188	1.136	0.08655
145.0	48.6	23.6	62.8	45.8	22.8	0.047668	1.231	0.13541
150.0	49.0	24.0	65.5	48.5	24.4	0.040443	1.976	0.20605
155.0	49.3	24.3	68.1	51.1	26.1	0.034989	2.939	0.28441
160.0	49.7	24.7	70.2	53.2	27.6	0.030986	3.692	0.36475
165.0	49.9	24.9	71.0	54.0	28.2	0.027926	3.876	0.43509
170.0	50.2	25.2	70.2	53.2	27.6	0.427017	3.420	0.48172
175.0	50.4	25.4	69.5	52.5	27.5	0.441168	2.838	0.50066
180.0	50.6	25.6	71.6	54.6	29.0	0.360534	2.881	0.49967
185.0	50.7	25.7	72.4	55.4	29.6	0.299523	3.104	0.49781
190.0	50.8	25.8	71.6	54.6	29.0	0.762336	3.030	0.51099
195.0	50.9	25.9	69.5	52.5	27.5	0.750433	3.172	0.52256
200.0	51.0	26.0	69.5	52.5	26.9	0.626127	3.893	0.51272

PROPOSED_CS8.txt

205.0	51.0	26.0	70.3	53.3	27.5	0.531468	4.510	0.47221
210.0	51.1	26.1	69.5	52.5	26.9	0.821238	4.560	0.40479
215.0	51.1	26.1	67.4	50.4	25.4	0.783291	4.126	0.32661
220.0	51.2	26.2	65.0	48.0	25.7	0.671746	3.533	0.25364
225.0	51.4	26.4	65.9	48.9	26.4	0.585571	3.039	0.19381
230.0	51.5	26.5	66.9	49.9	27.3	0.520561	2.762	0.14961
235.0	51.8	26.8	67.8	50.8	28.3	0.470017	2.737	0.12255
240.0	52.0	27.0	68.7	51.7	29.3	0.429505	2.973	0.11405
245.0	52.3	27.3	69.6	52.6	30.4	0.396205	3.480	0.12324
250.0	52.6	27.6	71.8	54.8	31.7	0.368270	4.278	0.14618
255.0	53.0	28.0	74.0	57.0	33.0	0.344444	5.355	0.17773
260.0	53.3	28.3	76.1	59.1	34.3	0.323841	6.610	0.21286
265.0	53.5	28.5	77.9	60.9	35.5	0.305821	7.783	0.24566
270.0	53.7	28.7	78.9	61.9	36.2	0.289906	8.477	0.26884
275.0	53.6	28.6	78.8	61.8	36.2	0.690934	8.371	0.27647
280.0	53.4	28.4	77.7	60.7	35.3	2.673036	7.490	0.26802
285.0	53.1	28.1	75.8	58.8	34.1	2.866380	6.170	0.24838
290.0	52.7	27.7	73.6	56.6	32.8	2.764011	4.785	0.22382
295.0	52.3	27.3	71.4	54.4	31.5	2.579317	3.560	0.19879
300.0	51.9	26.9	69.3	52.3	30.2	2.381696	2.572	0.17557
305.0	51.6	26.6	67.5	50.5	29.1	2.196951	1.813	0.15497
310.0	51.2	26.2	66.6	49.6	28.1	2.032208	1.246	0.13706
315.0	50.8	25.8	65.7	48.7	27.2	1.887646	0.828	0.12161
320.0	50.5	25.5	64.8	47.8	26.3	1.761221	0.524	0.10832
325.0	50.2	25.2	63.9	46.9	25.5	1.650418	0.304	0.09688
330.0	49.9	24.9	63.0	46.0	24.8	1.552864	0.150	0.08698
335.0	49.6	24.6	62.2	45.2	24.1	1.466502	0.064	0.07841
340.0	49.4	24.4	61.4	44.4	23.5	1.389611	0.094	0.07095
345.0	49.1	24.1	60.6	43.6	22.9	1.320764	0.142	0.06442
350.0	48.9	23.9	59.9	42.9	22.4	1.258790	0.178	0.05871
355.0	48.6	23.6	59.2	42.2	21.8	1.202720	0.202	0.05367
360.0	48.4	23.4	58.5	41.5	21.4	1.151754	0.218	0.04922
365.0	48.2	23.2	57.9	40.9	21.0	1.105225	0.227	0.04528
370.0	48.0	23.0	57.2	40.2	20.6	1.062575	0.231	0.04176
375.0	47.8	22.8	56.7	39.7	20.3	1.023334	0.232	0.03863
380.0	47.6	22.6	56.1	39.1	19.9	0.987105	0.229	0.03582
385.0	47.4	22.4	55.6	38.6	19.6	0.953550	0.225	0.03330
390.0	47.2	22.2	55.0	38.0	19.3	0.922378	0.220	0.03103
395.0	47.0	22.0	54.5	37.5	18.9	0.893340	0.213	0.02897
400.0	46.8	21.8	54.1	37.1	18.6	0.866221	0.206	0.02711
405.0	46.7	21.7	53.6	36.6	18.3	0.840832	0.199	0.02542

PROPOSED_CS8.txt

410.0	46.5	21.5	53.2	36.2	18.0	0.817009	0.192	0.02388
415.0	46.4	21.4	52.7	35.7	17.8	0.794609	0.185	0.02247
420.0	46.2	21.2	52.3	35.3	17.5	0.773505	0.177	0.02118
425.0	46.1	21.1	51.9	34.9	17.2	0.753586	0.170	0.02000
430.0	45.9	20.9	51.6	34.6	17.0	0.734752	0.163	0.01891
435.0	45.8	20.8	51.2	34.2	16.7	0.716914	0.157	0.01791
440.0	45.6	20.6	50.9	33.9	16.5	0.699994	0.151	0.01699
445.0	45.5	20.5	50.5	33.5	16.2	0.683921	0.144	0.01614
450.0	45.4	20.4	50.2	33.2	16.0	0.668630	0.139	0.01534
455.0	45.3	20.3	49.9	32.9	15.8	0.654066	0.133	0.01461
460.0	45.1	20.1	49.6	32.6	15.6	0.640176	0.128	0.01393
465.0	45.0	20.0	49.3	32.3	15.3	0.626913	0.123	0.01329
470.0	44.9	19.9	49.0	32.0	15.1	0.614234	0.118	0.01270
475.0	44.8	19.8	48.7	31.7	14.9	0.602101	0.113	0.01214
480.0	44.7	19.7	48.4	31.4	14.7	0.590479	0.109	0.01163
485.0	44.6	19.6	48.2	31.2	14.5	0.579334	0.105	0.01114
490.0	44.5	19.5	47.9	30.9	14.3	0.568637	0.101	0.01068
495.0	44.4	19.4	47.7	30.7	14.2	0.558361	0.097	0.01026

ROW Segment -9

8/16/2020

12:07:11

CROSS SECTION 9,,,,,,,,

"VERTICAL MONOPOLE DOUBLE CIRCUIT, NYPA LINES TO DYSINGER ",,,,,,,,,,

1,0,12,16,0.0, 0.50, 1.00, 0.00

(GRADIENTS ARE COMPUTED BY PROGRAM)

PHYSICAL SYSTEM CONSISTS OF 16 CONDUCTORS, OF WHICH 12 ARE ENERGIZED PHASES

OPTIONS: 'COMB',,,,,,,,,,

5.000,	6.600,	9.800,	0.000,	1.000,	75.000,	3.280,	7.300,	3.280		
'MN-DY1-A', 'A',	81.00,	94.30,	2,	1.108,	18.000,	219.100,	0.000,	1.331,	0.000	
'MN-DY1-B', 'A',	74.25,	63.30,	2,	1.108,	18.000,	219.100,	-120.000,	1.331,	0.000	
'MN-DY1-C', 'A',	80.50,	32.30,	2,	1.108,	18.000,	219.100,	120.000,	1.331,	0.000	
'MN-DY2-A', 'A',	112.00,	94.30,	2,	1.108,	18.000,	219.100,	0.000,	1.331,	0.000	
'MN-DY2-B', 'A',	117.25,	63.30,	2,	1.108,	18.000,	219.100,	-120.000,	1.331,	0.000	
'MN-DY2-C', 'A',	112.50,	32.30,	2,	1.108,	18.000,	219.100,	120.000,	1.331,	0.000	
'DY-RCR1-', 'A',	256.00,	94.30,	2,	1.108,	18.000,	219.100,	0.000,	1.331,	0.000	
'DY-RCR1-', 'A',	249.25,	63.30,	2,	1.108,	18.000,	219.100,	-120.000,	1.331,	0.000	
'DY-RCR1-', 'A',	255.50,	32.30,	2,	1.108,	18.000,	219.100,	120.000,	1.331,	0.000	
'DY-RCR2-', 'A',	287.00,	94.30,	2,	1.108,	18.000,	219.100,	0.000,	1.331,	0.000	
'DY-RCR2-', 'A',	292.25,	63.30,	2,	1.108,	18.000,	219.100,	-120.000,	1.331,	0.000	
'DY-RCR2-', 'A',	287.50,	32.30,	2,	1.108,	18.000,	219.100,	120.000,	1.331,	0.000	
'MN-DY1-1', 'A',	78.16,	131.30,	1,	0.530,	0.000,	0.000,	0.000,	0.000,	0.000	
'MN-DY2-1', 'A',	114.84,	131.30,	1,	0.530,	0.000,	0.000,	0.000,	0.000,	0.000	
'DY-RCR1-', 'A',	253.16,	131.30,	1,	0.530,	0.000,	0.000,	0.000,	0.000,	0.000	
'DY-RCR2-', 'A',	289.84,	131.30,	1,	0.530,	0.000,	0.000,	0.000,	0.000,	0.000	

100 -100.0 5.0

1COMBINED OUTPUT OF AUDIBLE NOISE, RADIO NOISE, TVI, OZONE CONCENTRATION, GROUND GRADIENT AND MAGNETIC FIELD

CROSS SECTION 9,,,,,,,,,

"VERTICAL MONOPOLE DOUBLE CIRCUIT, NYPA LINES TO DYSINGER ",,,,,,,,,,

	DIST. FROM CENTER OF TOWER (FEET)	HEIGHT (FEET)	MAXIMUM GRADIENT (KV/CM)	SUBCON DIAM. (IN)	NO. OF SUBCON	SUBCON SPACING (IN)	VOLTAGE L-N (KV)	PHASE ANGLE (DEGREES)	CURRENT (kAmps)	CORONA LOSSES (KW/MI)
MN-DY1-A	81.00	94.30	14.93	1.11	2	18.00	219.10	0.00	1.33	6.728
MN-DY1-B	74.25	63.30	17.19	1.11	2	18.00	219.10	-120.00	1.33	16.828
MN-DY1-C	80.50	32.30	16.52	1.11	2	18.00	219.10	120.00	1.33	13.006
MN-DY2-A	112.00	94.30	14.85	1.11	2	18.00	219.10	0.00	1.33	6.490
MN-DY2-B	117.25	63.30	17.25	1.11	2	18.00	219.10	-120.00	1.33	17.177
MN-DY2-C	112.50	32.30	16.54	1.11	2	18.00	219.10	120.00	1.33	13.079
DY-RCR1-	256.00	94.30	14.86	1.11	2	18.00	219.10	0.00	1.33	6.536
DY-RCR1-	249.25	63.30	17.16	1.11	2	18.00	219.10	-120.00	1.33	16.619
DY-RCR1-	255.50	32.30	16.55	1.11	2	18.00	219.10	120.00	1.33	13.146
DY-RCR2-	287.00	94.30	14.90	1.11	2	18.00	219.10	0.00	1.33	6.645
DY-RCR2-	292.25	63.30	17.29	1.11	2	18.00	219.10	-120.00	1.33	17.491
DY-RCR2-	287.50	32.30	16.50	1.11	2	18.00	219.10	120.00	1.33	12.910
MN-DY1-1	78.16	131.30	9.46	0.53	1	0.00	0.00	0.00	0.00	0.000
MN-DY2-1	114.84	131.30	9.85	0.53	1	0.00	0.00	0.00	0.00	0.000
DY-RCR1-	253.16	131.30	9.85	0.53	1	0.00	0.00	0.00	0.00	0.000
DY-RCR2-	289.84	131.30	9.48	0.53	1	0.00	0.00	0.00	0.00	0.000

AN MICROPHONE HT.= 5.0 FT, RI ANT. HT.= 6.6 FT, TV ANT. HT.= 9.8 FT, ALTITUDE= 0.0 FT

RI FREQ= 1.000 MHZ, TV FREQ= 75.000 MHZ, WIND VEL.(OZ)= 0.500 MPH, GROUND CONDUCTIVITY = 7.3 MMHOS/M

E-FIELD TRANSDUCER HT.= 3.3FT, B-FIELD TRANSDUCER HT.= 3.3FT

LATERAL DIST FROM REFERENCE (FEET)	AUDIBLE NOISE (RAIN) L50 DBA	NOISE (FAIR) L50 DBA	RADIO INTERFERENCE (RAIN) L50 DBUV/M	INTERFERENCE (FAIR) L50 DBUV/M	TVI TOTAL RAIN DBUV/M	OZONE FOR RAIN RATE OF 1.00 IN/HR AT 0. FT LEVEL PPB	ELECTRIC FIELD KV/M	MAGNETIC FIELD GAUSS
-100.0	44.5	19.5	48.4	31.4	12.2	0.000000	0.263	0.02855
-95.0	44.6	19.6	48.7	31.7	12.5	0.000000	0.271	0.02977
-90.0	44.7	19.7	49.0	32.0	12.7	0.000000	0.279	0.03107
-85.0	44.8	19.8	49.4	32.4	13.0	0.000000	0.287	0.03246
-80.0	44.9	19.9	49.8	32.8	13.2	0.000000	0.296	0.03394
-75.0	45.1	20.1	50.1	33.1	13.5	0.000000	0.304	0.03553
-70.0	45.2	20.2	50.5	33.5	13.7	0.000000	0.312	0.03723
-65.0	45.3	20.3	50.9	33.9	14.0	0.000000	0.321	0.03906

PROPOSED_CS9.txt

-60.0	45.4	20.4	51.3	34.3	14.3	0.000000	0.329	0.04102
-55.0	45.5	20.5	51.8	34.8	14.5	0.000000	0.337	0.04314
-50.0	45.7	20.7	52.2	35.2	14.8	0.000000	0.345	0.04542
-45.0	45.8	20.8	52.7	35.7	15.1	0.000000	0.351	0.04789
-40.0	45.9	20.9	53.2	36.2	15.4	0.000000	0.358	0.05056
-35.0	46.1	21.1	53.6	36.6	15.8	0.000000	0.363	0.05345
-30.0	46.2	21.2	54.2	37.2	16.1	0.000000	0.367	0.05660
-25.0	46.4	21.4	54.7	37.7	16.4	0.000000	0.369	0.06003
-20.0	46.5	21.5	55.3	38.3	16.8	0.000000	0.370	0.06378
-15.0	46.7	21.7	55.8	38.8	17.1	0.000000	0.369	0.06787
-10.0	46.8	21.8	56.4	39.4	17.5	0.000000	0.366	0.07236
-5.0	47.0	22.0	57.0	40.0	17.9	0.000000	0.362	0.07729
0.0	47.2	22.2	57.7	40.7	18.2	0.000000	0.359	0.08272
5.0	47.4	22.4	58.3	41.3	18.6	0.000000	0.361	0.08871
10.0	47.6	22.6	59.0	42.0	19.0	0.000000	0.375	0.09533
15.0	47.8	22.8	59.7	42.7	19.4	0.000000	0.414	0.10267
20.0	48.0	23.0	60.4	43.4	19.8	0.000000	0.491	0.11082
25.0	48.2	23.2	61.0	44.0	20.2	0.000000	0.621	0.11987
30.0	48.4	23.4	61.7	44.7	20.6	0.000000	0.815	0.12993
35.0	48.6	23.6	62.4	45.4	21.3	0.000000	1.086	0.14108
40.0	48.8	23.8	63.0	46.0	22.1	0.000000	1.451	0.15339
45.0	49.1	24.1	63.6	46.6	22.9	0.000000	1.930	0.16686
50.0	49.3	24.3	64.2	47.2	23.8	0.000000	2.544	0.18137
55.0	49.5	24.5	65.1	48.1	24.8	0.000000	3.309	0.19655
60.0	49.8	24.8	66.8	49.8	25.7	0.000000	4.222	0.21171
65.0	50.0	25.0	68.3	51.3	26.7	0.000000	5.249	0.22561
70.0	50.3	25.3	69.7	52.7	27.5	0.000000	6.306	0.23658
75.0	50.4	25.4	70.6	53.6	28.1	0.000000	7.265	0.24282
80.0	50.6	25.6	71.0	54.0	28.3	0.006599	8.001	0.24334
85.0	50.7	25.7	70.7	53.7	28.2	0.401195	8.451	0.23898
90.0	50.8	25.8	69.9	52.9	27.6	0.943751	8.655	0.23251
95.0	50.8	25.8	68.6	51.6	26.8	1.001272	8.715	0.22724
100.0	50.8	25.8	69.2	52.2	27.2	0.966222	8.699	0.22504
105.0	50.8	25.8	70.3	53.3	27.9	0.909304	8.588	0.22518
110.0	50.8	25.8	70.9	53.9	28.3	0.848017	8.291	0.22485
115.0	50.7	25.7	70.9	53.9	28.3	0.795642	7.721	0.22105
120.0	50.6	25.6	70.3	53.3	27.9	1.261942	6.876	0.21225
125.0	50.5	25.5	69.2	52.2	27.2	1.347092	5.854	0.19890
130.0	50.3	25.3	67.8	50.8	26.3	1.488453	4.789	0.18266
135.0	50.2	25.2	66.2	49.2	25.4	1.526503	3.794	0.16535
140.0	50.0	25.0	64.5	47.5	24.4	1.482303	2.935	0.14834

PROPOSED_CS9.txt

145.0	49.9	24.9	64.0	47.0	23.5	1.407638	2.234	0.13248
150.0	49.7	24.7	63.4	46.4	22.6	1.326522	1.687	0.11821
155.0	49.6	24.6	62.8	45.8	21.8	1.248207	1.282	0.10574
160.0	49.5	24.5	62.1	45.1	21.0	1.175821	1.001	0.09515
165.0	49.4	24.4	61.4	44.4	20.5	1.110058	0.826	0.08649
170.0	49.4	24.4	60.7	43.7	20.1	1.050671	0.734	0.07980
175.0	49.3	24.3	60.0	43.0	19.7	0.997091	0.696	0.07512
180.0	49.3	24.3	59.4	42.4	19.3	0.948670	0.686	0.07249
185.0	49.3	24.3	58.9	41.9	18.9	0.904791	0.689	0.07191
190.0	49.3	24.3	59.6	42.6	19.3	0.864894	0.702	0.07339
195.0	49.4	24.4	60.3	43.3	19.7	0.828491	0.731	0.07691
200.0	49.4	24.4	60.9	43.9	20.1	0.795158	0.794	0.08246
205.0	49.5	24.5	61.6	44.6	20.6	0.764532	0.917	0.08998
210.0	49.6	24.6	62.3	45.3	21.4	0.736302	1.127	0.09946
215.0	49.7	24.7	62.9	45.9	22.2	0.710199	1.447	0.11084
220.0	49.8	24.8	63.5	46.5	23.0	0.685991	1.897	0.12407
225.0	49.9	24.9	64.1	47.1	23.9	0.663480	2.496	0.13904
230.0	50.1	25.1	65.2	48.2	24.8	0.642492	3.254	0.15545
235.0	50.2	25.2	66.9	49.9	25.8	0.622877	4.167	0.17271
240.0	50.4	25.4	68.4	51.4	26.8	0.604503	5.198	0.18977
245.0	50.5	25.5	69.7	52.7	27.6	0.587255	6.262	0.20504
250.0	50.7	25.7	70.7	53.7	28.2	0.571030	7.231	0.21666
255.0	50.8	25.8	71.1	54.1	28.4	0.562231	7.975	0.22334
260.0	50.8	25.8	70.8	53.8	28.3	0.942433	8.434	0.22539
265.0	50.8	25.8	70.0	53.0	27.7	1.473792	8.647	0.22509
270.0	50.8	25.8	68.7	51.7	26.9	1.516426	8.714	0.22561
275.0	50.8	25.8	69.1	52.1	27.1	1.466955	8.706	0.22907
280.0	50.7	25.7	70.2	53.2	27.8	1.396960	8.604	0.23514
285.0	50.7	25.7	70.8	53.8	28.2	1.323801	8.315	0.24112
290.0	50.5	25.5	70.8	53.8	28.2	1.260375	7.754	0.24370
295.0	50.4	25.4	70.2	53.2	27.8	1.707707	6.919	0.24080
300.0	50.2	25.2	69.1	52.1	27.1	1.783891	5.905	0.23243
305.0	49.9	24.9	67.7	50.7	26.2	1.923402	4.847	0.22002
310.0	49.7	24.7	66.1	49.1	25.3	1.957543	3.856	0.20543
315.0	49.4	24.4	64.7	47.7	24.3	1.907195	2.994	0.19016
320.0	49.2	24.2	64.1	47.1	23.4	1.825410	2.282	0.17521
325.0	49.0	24.0	63.5	46.5	22.5	1.736884	1.714	0.16112
330.0	48.7	23.7	62.9	45.9	21.7	1.651175	1.271	0.14814
335.0	48.5	23.5	62.2	45.2	21.1	1.571550	0.932	0.13633
340.0	48.3	23.3	61.6	44.6	20.7	1.498760	0.680	0.12566
345.0	48.1	23.1	60.9	43.9	20.3	1.432580	0.500	0.11604

PROPOSED_CS9.txt

350.0	47.9	22.9	60.2	43.2	19.8	1.372443	0.383	0.10738
355.0	47.7	22.7	59.5	42.5	19.4	1.317699	0.320	0.09959
360.0	47.5	22.5	58.8	41.8	19.0	1.267722	0.299	0.09255
365.0	47.3	22.3	58.2	41.2	18.7	1.221943	0.302	0.08620
370.0	47.1	22.1	57.5	40.5	18.3	1.179862	0.314	0.08045
375.0	46.9	21.9	56.9	39.9	17.9	1.141046	0.327	0.07524
380.0	46.8	21.8	56.3	39.3	17.5	1.105122	0.338	0.07050
385.0	46.6	21.6	55.7	38.7	17.2	1.071769	0.346	0.06618
390.0	46.5	21.5	55.2	38.2	16.8	1.040709	0.351	0.06223
395.0	46.3	21.3	54.6	37.6	16.5	1.011704	0.354	0.05862

ROW Segment -10

17:14:08

17:14:08

TWO VERTICAL DEADEND SINGLE CIRCUIT WITH 2 345KV LINES,,,,,,,,,,

(ENGLISH UNITS OPTION)

(GRADIENTS ARE COMPUTED BY PROGRAM)

PHYSICAL SYSTEM CONSISTS OF 8 CONDUCTORS, OF WHICH 6 ARE ENERGIZED PHASES

5.000,	6.600,	9.800,	0.000,	1.000,	75.000,	3.280,	7.300,	3.280		
'STOLLE R',	'A',	385.00,	91.50,	2,	1.212,	18.000,	219.100,	0.000,	1.200,	0.000
'STOLLE R',	'A',	385.00,	65.50,	2,	1.212,	18.000,	219.100,	-120.000,	1.200,	0.000
'STOLLE R',	'A',	385.00,	39.50,	2,	1.212,	18.000,	219.100,	120.000,	1.200,	0.000
'FIVEMILE',	'A',	440.00,	91.50,	2,	1.212,	18.000,	219.100,	0.000,	1.200,	0.000
'FIVEMILE',	'A',	440.00,	65.50,	2,	1.212,	18.000,	219.100,	-120.000,	1.200,	0.000
'FIVEMILE',	'A',	440.00,	39.50,	2,	1.212,	18.000,	219.100,	120.000,	1.200,	0.000
'STOLLE-S',	'A',	385.00,	117.00,	1,	0.530,	0.000,	0.000,	0.000,	0.000,	0.000
'FIVEMILE',	'A',	440.00,	117.00,	1,	0.530,	0.000,	0.000,	0.000,	0.000,	0.000
84	0.0	10.0								
0	0.0	0.0								

1COMBINED OUTPUT OF AUDIBLE NOISE, RADIO NOISE, TVI, OZONE CONCENTRATION, GROUND GRADIENT AND MAGNETIC FIELD

CROSS SECTION 10,,,,,,,,,

TWO VERTICAL DEADEND SINGLE CIRCUIT WITH 2 345KV LINES,,,,,,,,,,,,,

DIST. FROM CENTER OF TOWER	HEIGHT	MAXIMUM GRADIENT	SUBCON DIAM.	NO. OF SUBCON	SUBCON SPACING	VOLTAGE L-N	PHASE ANGLE	CURRENT	CORONA LOSSES
-------------------------------	--------	---------------------	-----------------	------------------	-------------------	----------------	----------------	---------	------------------

	PROPOSED_CS10.txt									
	(FEET)	(FEET)	(KV/CM)	(IN)		(IN)	(KV)	(DEGREES)	(kAmps)	(KW/MI)
STOLLE R	385.00	91.50	15.40	1.21	2	18.00	219.10	0.00	1.20	11.803
STOLLE R	385.00	65.50	16.95	1.21	2	18.00	219.10	-120.00	1.20	22.018
STOLLE R	385.00	39.50	16.16	1.21	2	18.00	219.10	120.00	1.20	16.087
FIVEMILE	440.00	91.50	15.40	1.21	2	18.00	219.10	0.00	1.20	11.803
FIVEMILE	440.00	65.50	16.95	1.21	2	18.00	219.10	-120.00	1.20	22.018
FIVEMILE	440.00	39.50	16.16	1.21	2	18.00	219.10	120.00	1.20	16.087
STOLLE-S	385.00	117.00	9.89	0.53	1	0.00	0.00	0.00	0.00	0.000
FIVEMILE	440.00	117.00	9.89	0.53	1	0.00	0.00	0.00	0.00	0.000

AN MICROPHONE HT.= 5.0 FT, RI ANT. HT.= 6.6 FT, TV ANT. HT.= 9.8 FT, ALTITUDE= 0.0 FT

RI FREQ= 1.000 MHZ, TV FREQ= 75.000 MHZ, WIND VEL.(OZ)= 0.500 MPH, GROUND CONDUCTIVITY = 7.3 MMHOS/M

E-FIELD TRANSDUCER HT.= 3.3FT, B-FIELD TRANSDUCER HT.= 3.3FT

LATERAL DIST FROM REFERENCE (FEET)	AUDIBLE NOISE (RAIN) L50 DBA	(FAIR) L50 DBA	RADIO INTERFERENCE (RAIN) L50 DBUV/M	(FAIR) L50 DBUV/M	TVI TOTAL RAIN DBUV/M	OZONE FOR RAIN RATE OF 1.00 IN/HR AT 0. FT LEVEL PPB	ELECTRIC FIELD KV/M	MAGNETIC FIELD GAUSS
0.0	40.8	15.8	41.2	24.2	6.5	0.000000	0.066	0.00411
10.0	40.9	15.9	41.5	24.5	6.7	0.000000	0.069	0.00431
20.0	41.0	16.0	41.7	24.7	7.0	0.000000	0.072	0.00453
30.0	41.1	16.1	42.0	25.0	7.2	0.000000	0.076	0.00477
40.0	41.3	16.3	42.3	25.3	7.4	0.000000	0.079	0.00502
50.0	41.4	16.4	42.6	25.6	7.7	0.000000	0.083	0.00530
60.0	41.5	16.5	42.9	25.9	7.9	0.000000	0.087	0.00560
70.0	41.7	16.7	43.2	26.2	8.2	0.000000	0.092	0.00592
80.0	41.8	16.8	43.5	26.5	8.5	0.000000	0.097	0.00628
90.0	42.0	17.0	43.9	26.9	8.7	0.000000	0.102	0.00666
100.0	42.1	17.1	44.2	27.2	9.0	0.000000	0.107	0.00709
110.0	42.3	17.3	44.6	27.6	9.3	0.000000	0.113	0.00755
120.0	42.4	17.4	45.0	28.0	9.6	0.000000	0.120	0.00806
130.0	42.6	17.6	45.4	28.4	10.0	0.000000	0.127	0.00862
140.0	42.8	17.8	45.8	28.8	10.3	0.000000	0.134	0.00924
150.0	42.9	17.9	46.2	29.2	10.6	0.000000	0.142	0.00993
160.0	43.1	18.1	46.7	29.7	11.0	0.000000	0.151	0.01070
170.0	43.3	18.3	47.2	30.2	11.4	0.000000	0.160	0.01157
180.0	43.5	18.5	47.7	30.7	11.8	0.000000	0.169	0.01253
190.0	43.7	18.7	48.2	31.2	12.2	0.000000	0.179	0.01363
200.0	44.0	19.0	48.8	31.8	12.6	0.000000	0.190	0.01486
210.0	44.2	19.2	49.4	32.4	13.0	0.000000	0.200	0.01627
220.0	44.4	19.4	50.1	33.1	13.5	0.000000	0.211	0.01788

PROPOSED_CS10.txt

230.0	44.7	19.7	50.8	33.8	14.0	0.000000	0.220	0.01973
240.0	44.9	19.9	51.5	34.5	14.5	0.000000	0.229	0.02187
250.0	45.2	20.2	52.3	35.3	15.0	0.000000	0.235	0.02437
260.0	45.5	20.5	53.2	36.2	15.6	0.000000	0.236	0.02728
270.0	45.8	20.8	54.1	37.1	16.2	0.000000	0.230	0.03072
280.0	46.1	21.1	55.1	38.1	16.8	0.000000	0.212	0.03480
290.0	46.5	21.5	56.2	39.2	17.5	0.000000	0.176	0.03966
300.0	46.8	21.8	57.3	40.3	18.2	0.000000	0.113	0.04550
310.0	47.2	22.2	58.5	41.5	18.9	0.000000	0.056	0.05253
320.0	47.6	22.6	59.8	42.8	19.6	0.000000	0.227	0.06103
330.0	48.0	23.0	61.1	44.1	20.4	0.000000	0.533	0.07125
340.0	48.5	23.5	62.4	45.4	21.2	0.000000	1.015	0.08337
350.0	48.9	23.9	63.6	46.6	22.5	0.000000	1.735	0.09720
360.0	49.4	24.4	65.0	48.0	24.0	0.000000	2.725	0.11157
370.0	49.8	24.8	67.3	50.3	25.3	0.000000	3.874	0.12340
380.0	50.1	25.1	68.7	51.7	26.2	0.000000	4.829	0.12760
390.0	50.3	25.3	68.7	51.7	26.2	0.129442	5.188	0.12085
400.0	50.3	25.3	67.3	50.3	25.3	1.025301	5.011	0.10757
410.0	50.3	25.3	65.0	48.0	24.0	1.140610	4.791	0.09866
420.0	50.3	25.3	66.2	49.2	24.7	1.039067	4.875	0.10188
430.0	50.3	25.3	68.1	51.1	25.9	0.918197	5.139	0.11441
440.0	50.2	25.2	68.9	51.9	26.3	0.813220	5.094	0.12554
450.0	49.9	24.9	68.1	51.1	25.9	1.422965	4.406	0.12678
460.0	49.6	24.6	66.2	49.2	24.7	1.794051	3.296	0.11809
470.0	49.1	24.1	64.2	47.2	23.3	1.695620	2.198	0.10445
480.0	48.7	23.7	63.0	46.0	21.8	1.526546	1.341	0.09011
490.0	48.2	23.2	61.7	44.7	20.8	1.371122	0.748	0.07707
500.0	47.8	22.8	60.4	43.4	20.0	1.240389	0.362	0.06591
510.0	47.4	22.4	59.1	42.1	19.3	1.131773	0.125	0.05658
520.0	47.0	22.0	57.9	40.9	18.5	1.040963	0.073	0.04885
530.0	46.6	21.6	56.7	39.7	17.8	0.964200	0.148	0.04245
540.0	46.3	21.3	55.6	38.6	17.1	0.898553	0.197	0.03712
550.0	46.0	21.0	54.6	37.6	16.5	0.841794	0.223	0.03267
560.0	45.6	20.6	53.6	36.6	15.9	0.792232	0.234	0.02893
570.0	45.3	20.3	52.7	35.7	15.3	0.748569	0.236	0.02577
580.0	45.1	20.1	51.9	34.9	14.7	0.709798	0.232	0.02307
590.0	44.8	19.8	51.1	34.1	14.2	0.675128	0.225	0.02076
600.0	44.5	19.5	50.4	33.4	13.7	0.643929	0.216	0.01877
610.0	44.3	19.3	49.7	32.7	13.2	0.615696	0.205	0.01705
620.0	44.1	19.1	49.1	32.1	12.8	0.590015	0.195	0.01554
630.0	43.8	18.8	48.5	31.5	12.4	0.566549	0.184	0.01422

PROPOSED_CS10.txt

640.0	43.6	18.6	48.0	31.0	12.0	0.545017	0.174	0.01306
650.0	43.4	18.4	47.4	30.4	11.6	0.525184	0.164	0.01204
660.0	43.2	18.2	46.9	29.9	11.2	0.506851	0.155	0.01112
670.0	43.0	18.0	46.5	29.5	10.8	0.489851	0.146	0.01031
680.0	42.9	17.9	46.0	29.0	10.5	0.474041	0.138	0.00958
690.0	42.7	17.7	45.6	28.6	10.1	0.459296	0.130	0.00892
700.0	42.5	17.5	45.2	28.2	9.8	0.445511	0.123	0.00833
710.0	42.3	17.3	44.8	27.8	9.5	0.432591	0.117	0.00780
720.0	42.2	17.2	44.4	27.4	9.2	0.420457	0.110	0.00731
730.0	42.0	17.0	44.0	27.0	8.9	0.409037	0.105	0.00687
740.0	41.9	16.9	43.7	26.7	8.6	0.398268	0.099	0.00647
750.0	41.7	16.7	43.4	26.4	8.3	0.388095	0.094	0.00610
760.0	41.6	16.6	43.0	26.0	8.1	0.378469	0.090	0.00576
770.0	41.5	16.5	42.7	25.7	7.8	0.369345	0.085	0.00545
780.0	41.3	16.3	42.4	25.4	7.6	0.360684	0.081	0.00516
790.0	41.2	16.2	42.2	25.2	7.3	0.352451	0.077	0.00489
800.0	41.1	16.1	41.9	24.9	7.1	0.344615	0.074	0.00465
810.0	40.9	15.9	41.6	24.6	6.8	0.337147	0.071	0.00442
820.0	40.8	15.8	41.3	24.3	6.6	0.330020	0.067	0.00421
830.0	40.7	15.7	41.1	24.1	6.4	0.323211	0.065	0.00401

ROW Segment -11

MAGNETIC FLUX DENSITY [mG]

=====

Study : 345 kV and 700 MW Cable Sizing Calculations

Execution: 5000 KCMIL OX 345 kV AC EMF

Report created on: 02/13/20 1:43:27 PM

X Y=3.28
(feet) (feet)

Cable Magnetic Field		Existing lines magnetic field		Commulative Magnetic Field (mG)
Lateral distance (ft)	B(mG)	Lateral Distance (ft)	MAGNETIC FIELD mGAUSS	
-312.5	0.3386	0	16.647	16.9856
-307.5	0.3495	5	17.698	18.0475
-302.5	0.3609	10	18.859	19.2199
-297.5	0.3728	15	20.147	20.5198
-292.5	0.3854	20	21.58	21.9654
-287.5	0.3985	25	23.184	23.5825
-282.5	0.4124	30	24.986	25.3984
-277.5	0.427	35	27.024	27.451
-272.5	0.4424	40	29.342	29.7844
-267.5	0.4586	45	31.995	32.4536
-262.5	0.4757	50	35.056	35.5317
-257.5	0.4937	55	38.616	39.1097
-252.5	0.5128	60	42.794	43.3068
-247.5	0.533	65	47.749	48.282
-242.5	0.5545	70	53.691	54.2455
-237.5	0.5772	75	60.908	61.4852
-232.5	0.6013	80	69.79	70.3913
-227.5	0.6269	85	80.876	81.5029
-222.5	0.6542	90	94.895	95.5492
-217.5	0.6833	95	112.773	113.4563
-212.5	0.7143	100	135.48	136.1943
-207.5	0.7475	105	163.319	164.0665
-202.5	0.7829	110	193.903	194.6859
-197.5	0.8209	115	219.083	219.9039
-192.5	0.8616	120	226.631	227.4926
-187.5	0.9054	125	212.505	213.4104
-182.5	0.9525	130	185.888	186.8405
-177.5	1.0033	135	150.256	151.2593

-172.5	1.0582	140	104.98	106.0382
-167.5	1.1175	145	84.614	85.7315
-162.5	1.1818	150	130.143	131.3248
-157.5	1.2516	155	206.082	207.3336
-152.5	1.3275	160	289.671	290.9985
-147.5	1.4102	165	373.907	375.3172
-142.5	1.5006	170	446.577	448.0776
-137.5	1.5994	175	493.881	495.4804
-132.5	1.7079	180	512.232	513.9399
-127.5	1.827	185	510.189	512.016
-122.5	1.9583	190	507.376	509.3343
-117.5	2.1031	195	519.138	521.2411
-112.5	2.2634	200	528.722	530.9854
-107.5	2.441	205	516.494	518.935
-102.5	2.6382	210	473.447	476.0852
-97.5	2.8575	215	403.736	406.5935
-92.5	3.1017	220	323.825	326.9267
-87.5	3.374	225	249.717	253.091
-82.5	3.6776	230	189.275	192.9526
-77.5	4.016	235	145.051	149.067
-72.5	4.3924	240	118.829	123.2214
-67.5	4.81	245	112.176	116.986
-62.5	5.2706	250	123.865	129.1356
-57.5	5.7749	255	149.498	155.2729
-52.5	6.3207	260	183.848	190.1687
-47.5	6.9023	265	221.99	228.8923
-42.5	7.5091	270	257.726	265.2351
-37.5	8.1246	275	282.806	290.9306
-32.5	8.7267	280	290.241	298.9677
-27.5	9.2892	285	279.582	288.8712
-22.5	9.7855	290	256.903	266.6885
-17.5	10.1933	295	229.514	239.7073
-12.5	10.4993	300	202.303	212.8023
-7.5	10.6999	305	177.53	188.2299
-2.5	10.7979	310	155.861	166.6589
2.5	10.7965	315	137.231	148.0275
7.5	10.6949	320	121.306	132.0009
12.5	10.4883	325	107.697	118.1853
17.5	10.1737	330	96.038	106.2117
22.5	9.7561	335	86.012	95.7681
27.5	9.2503	340	77.354	86.6043
32.5	8.6802	345	69.844	78.5242
37.5	8.073	350	63.302	71.375
42.5	7.455	355	57.58	65.035
47.5	6.8481	360	52.553	59.4011
52.5	6.2681	365	48.121	54.3891
57.5	5.7251	370	44.197	49.9221



62.5	5.2243	375	40.712	45.9363
67.5	4.7674	380	37.605	42.3724
72.5	4.3537	385	34.826	39.1797
77.5	3.9809	390	32.333	36.3139
82.5	3.646	395	30.089	33.735
87.5	3.3455	400	28.064	31.4095
92.5	3.0761	405	26.23	29.3061
97.5	2.8344	410	24.566	27.4004
102.5	2.6174	415	23.052	25.6694
107.5	2.4223	420	21.671	24.0933
112.5	2.2465	425	20.408	22.6545
117.5	2.0879	430	19.251	21.3389
122.5	1.9445	435	18.187	20.1315
127.5	1.8145	440	17.209	19.0235
132.5	1.6965	445	16.306	18.0025
137.5	1.589	450	15.472	17.061
142.5	1.4911	455	14.7	16.1911
147.5	1.4015	460	13.984	15.3855
152.5	1.3195	465	13.318	14.6375
157.5	1.2443	470	12.699	13.9433
162.5	1.1751	475	12.122	13.2971
167.5	1.1113	480	11.583	12.6943
172.5	1.0525	485	11.08	12.1325
177.5	0.998	490	10.608	11.606
182.5	0.9476	495	10.166	11.1136
187.5	0.9009			

Peak value found at:


X Y=3.28
(feet) (feet)

B(mG)
-2.5 10.7979


Fq=60.0 Hz R= IEC-228 Ambient temp.= 20.0°C

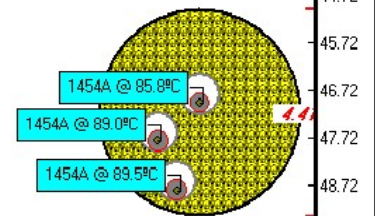

Native soil= 1.200°C.m/W

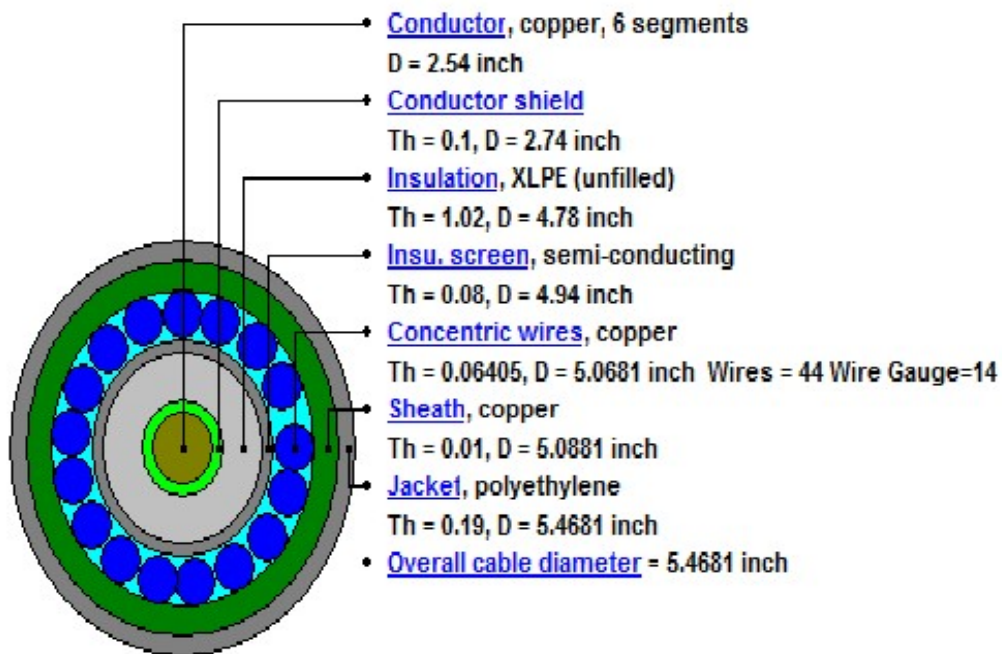

Voltage = 345.0 kV Cond. area = 3.92724 inch² (5000 kcmil)

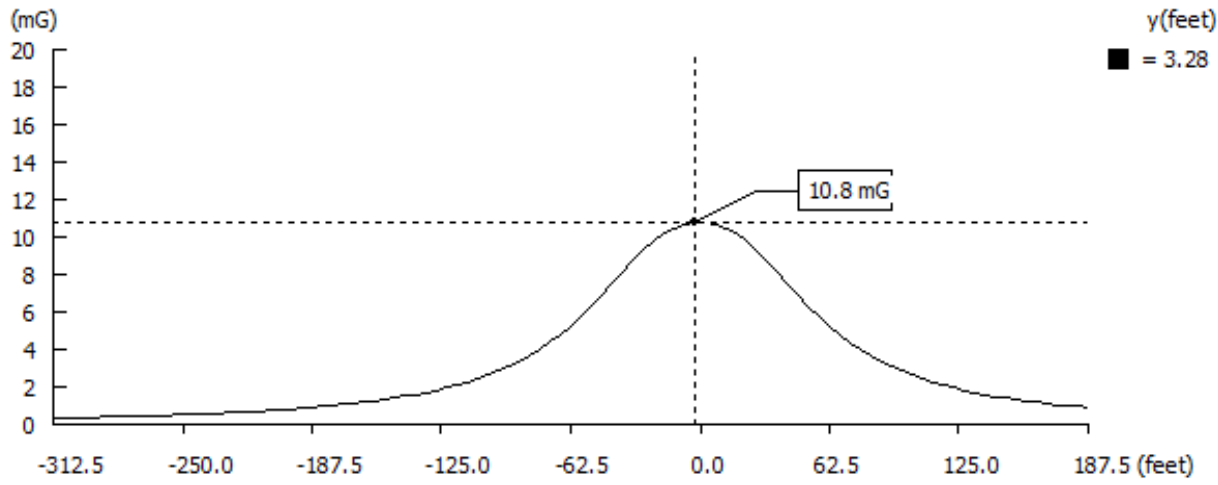

Input data:

Circuit No.	Phase	X (feet)	Y (feet)	Ampacity	Angle
1	A	12.5	47.0	1453.7	0.0
1	B	11.6	47.8	1453.7	-120.0
1	C	12.0	48.85	1453.7	120.0
2	A	-12.5	47.0	1453.7	0.0
2	B	-13.3	47.8	1453.7	-120.0
2	C	-13.0	48.85	1453.7	120.0

X Min: -312.5 X Max: 187.5 Step X: 5 feet

- ☐ Add a range of Y values
☒ Add a single Y value

Y Value: 3.28 feet

0.0
1.0
3.28

<<



Save...

Default

Ok

Cancel