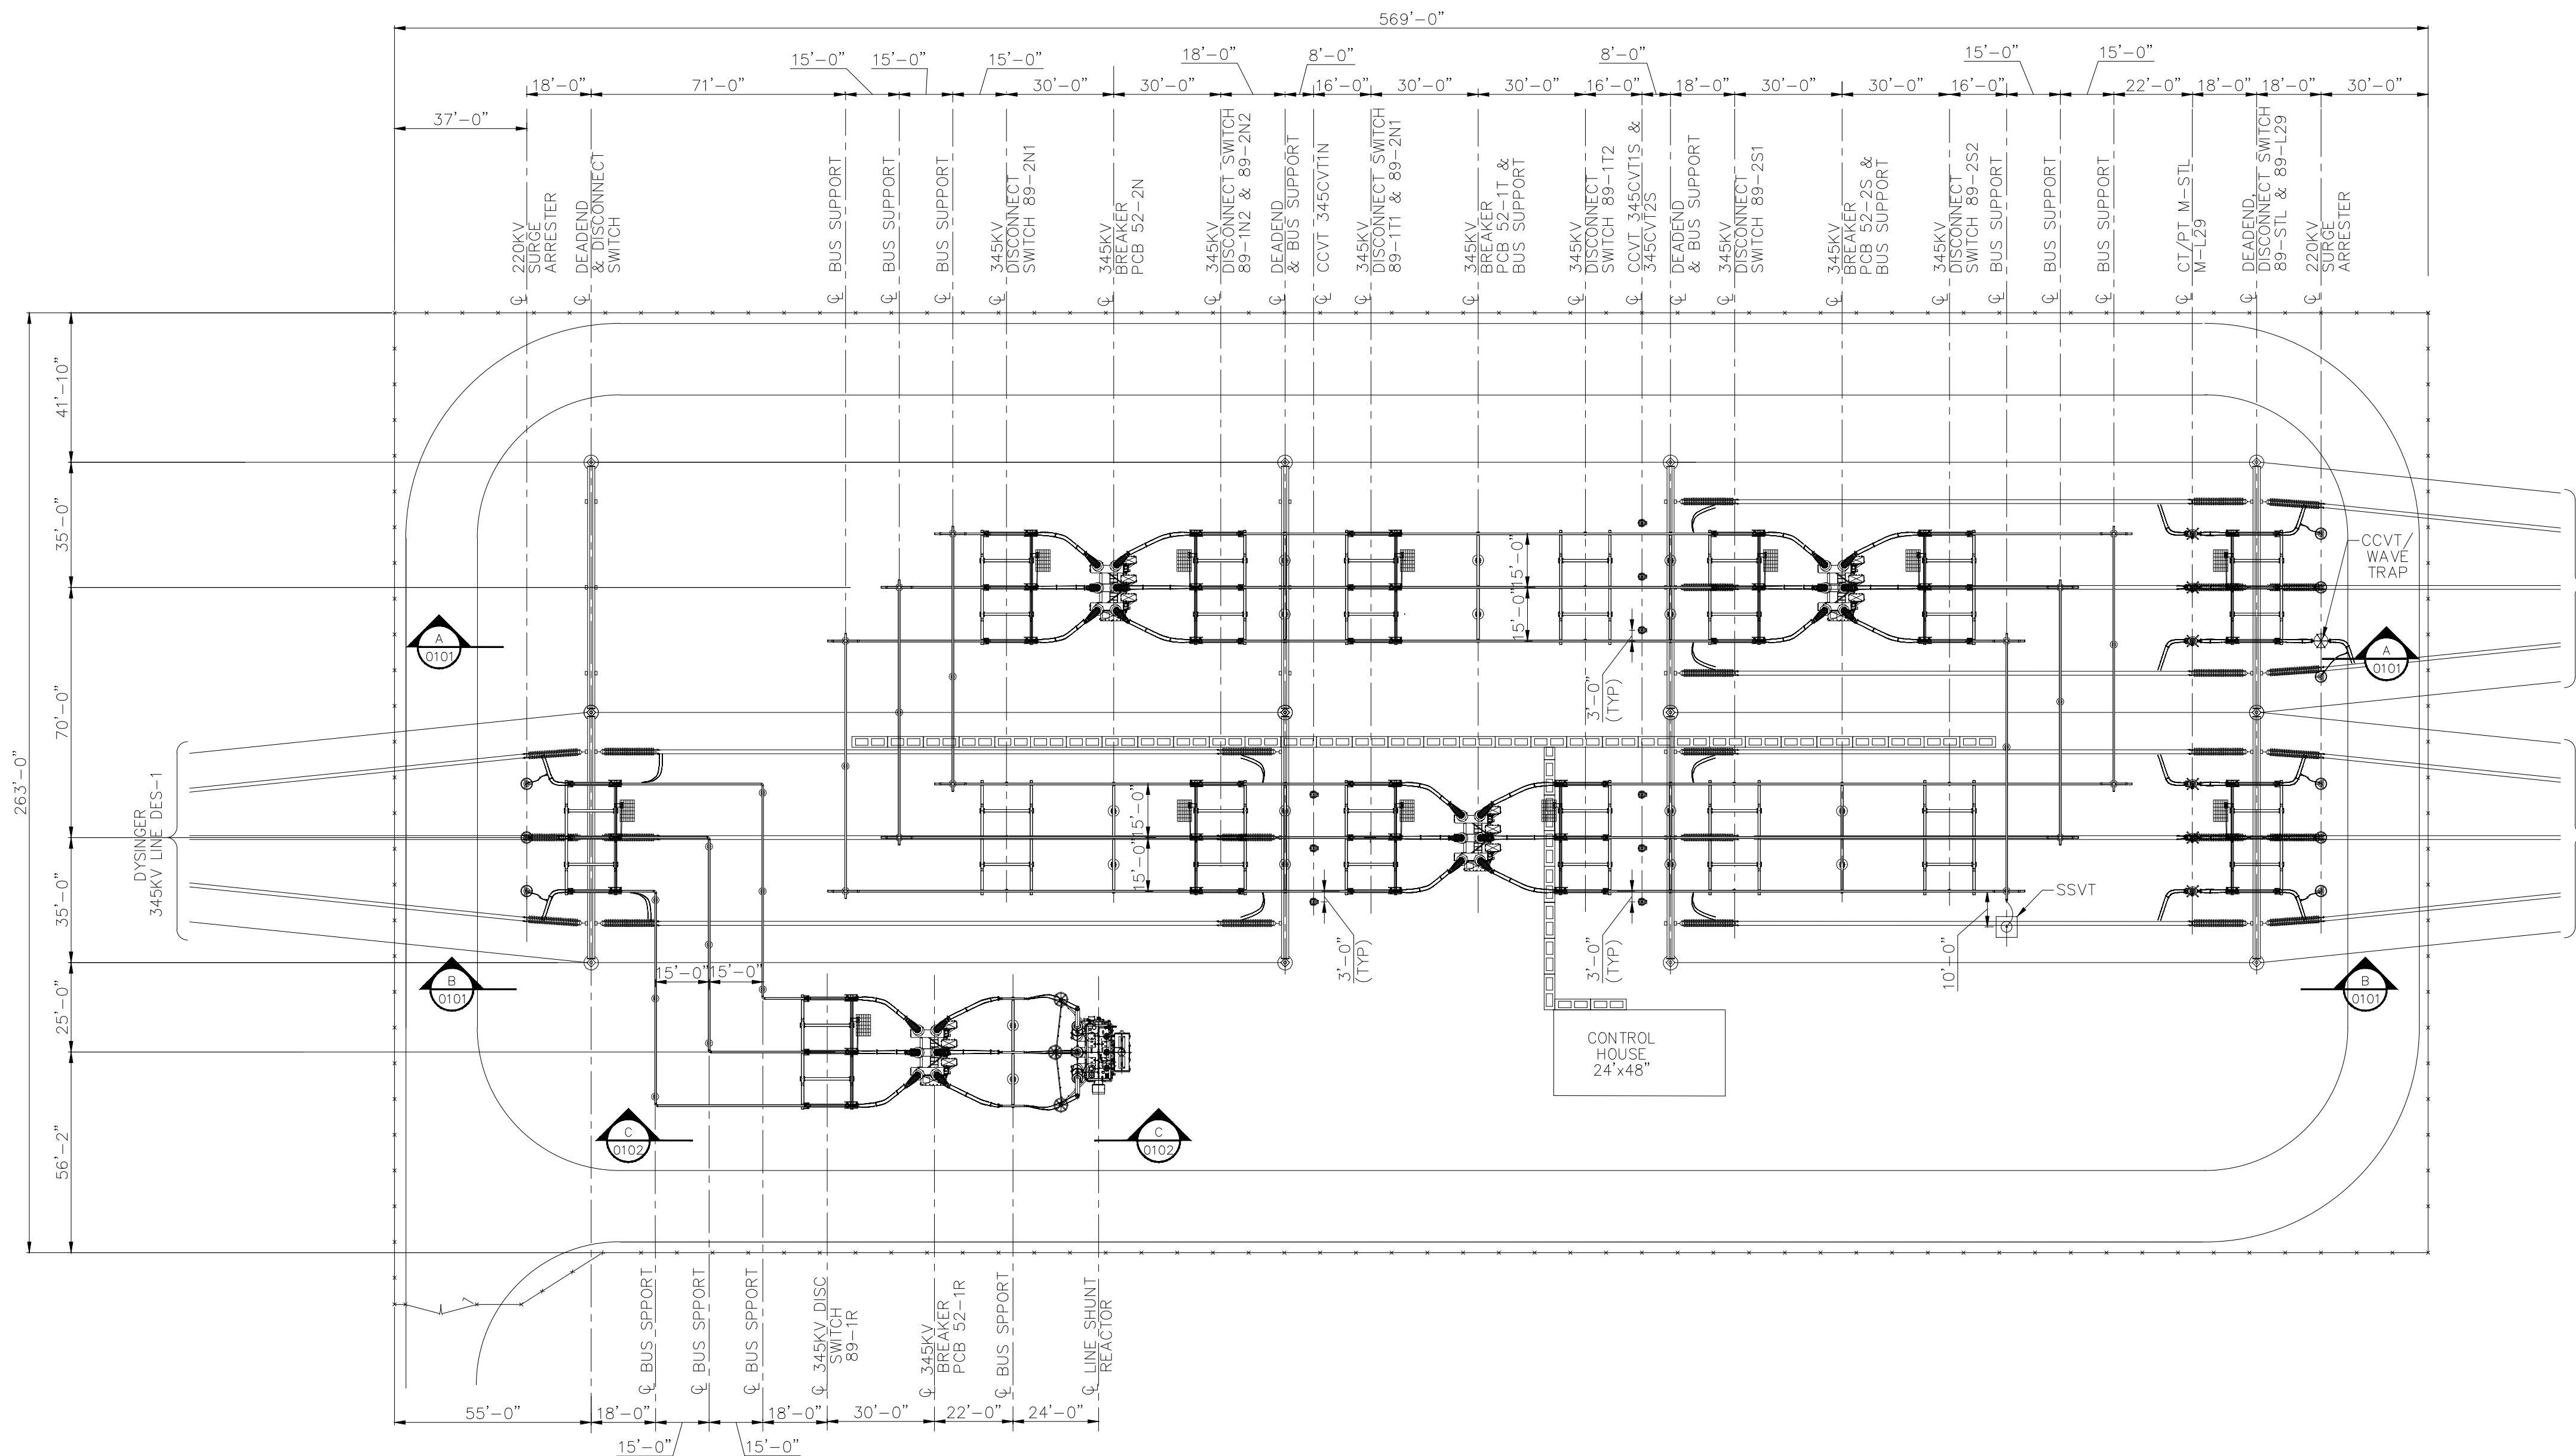


ELECTRICAL CLEARANCES	
DESCRIPTION	VOLTAGE CLASS SYSTEM
OPERATING VOLTAGE	345 kV
BIL	1300 kV
CENTERLINE TO CENTERLINE FOR ϕ TO ϕ^* FOR RIGID BUS*	14'-6"
MINIMUM ϕ TO GROUND**	8'-1"
BOTTOM OF INSULATOR OR BUSHING PORCELAIN TO FDN. TOP***	8'-6"
VERTICAL CLEARANCE OF UNGUARDED LIVE PARTS TO FDN. TOP ***	17'-9"
CLEARANCE FROM PERIMETER FENCE TO LIVE PARTS****	19'-0"
HIGH BUS HEIGHT, BUS CENTERLINE ABOVE FDN. **	32'-0"
LOW BUS HEIGHT, BUS CENTERLINE ABOVE FDN. **	20'-0"

*PER ANSI C37.32-2002, TABLE 5
 **PER IEEE 1427-2006, TABLE 3
 *** PER NESC, ANSI C-2, RULE 124
 **** PER NESC, ANSI C-2, RULE 110

PRELIMINARY
FOR PERMIT ONLY

- ## LEGEND
- | | |
|---|---------------------------------|
| o | GATE CATCH |
| F | FIXED BUS FITTING |
| S | SLIP BUS FITTING |
| ▼ | SWITCH OPERATOR |
|  | STRUCTURE MOUNTED YARD LIGHTING |
| —X—X—X— | SUBSTATION FENCE |
| — · — · — · — · — | OPGW |
| — — — — — | SHIELD WIRE |

REFERENCE DRAWINGS:

STL-E1-1000	SWITCHING DIAGRAM
STL-E1-XXXX	DRAWING LIST
STL-E1-0101	SECTIONS A-A AND B-B
STL-E1-0102	SECTIONS C-C AND D-D

[illegible]

SCALE: 1/32"=1'-0"

CONTRACTOR/INSTALLER SHALL TAKE ALL APPROPRIATE PRECAUTIONS TO ENSURE THE SAFETY OF ALL PEOPLE LOCATED ON THE WORK SITE, INCLUDING CONTRACTOR'S /INSTALLER'S PERSONNEL (OR THAT OF ITS SUB-CONTRACTOR(S)) PERFORMING THE WORK.

ANY MODIFICATION OR ADDITION TO THIS
DRAWING BY ANY ORGANIZATION OTHER
THAN SARGENT & LUNDY IS NOT THE
RESPONSIBILITY OF SARGENT & LUNDY



Sargent & Lundy
55 EAST MONROE ST., CHICAGO, ILL.

NEXtera
ENERGY 
TRANSMISSION
NEW YORK

NEXTERA ENERGY TRANSMISSION NEW YORK, INC
EAST STOLLE RD SWITCHYARD
GENERAL ARRANGEMENT

STL-E1-0100

CONCRETE GENERAL NOTES SHEET 1									
--------------------------------	--	--	--	--	--	--	--	--	--

1.0

GENERAL

1.1

ABBREVIATIONS AND DEFINITIONS

1.2

SYMBOLS

SLOPE

= INDICATES DIRECTION OF DOWNWARD SLOPE.

= INDICATES DIRECTION OF BAR GRATING SPAN.

= INDICATES CHECKERED PLATE.

1.3

DESIGNATIONS

1.3.1

NOT USED

1.4

STRUCTURAL DESIGN DATA

1.4.1

STRUCTURAL DESIGN IS BASED ON THE APPLICABLE REQUIREMENTS OF THE PROJECT DESIGN CRITERIA AND LATEST EDITION OF ACI 318 & 350.

1.4.2

SOILS ARE CLASSIFIED AS INDICATED IN THE GEOTECHNICAL REPORT PER ASTM D2487.

1.4.3

FOUNDATION DESIGNS ARE BASED ON THE FINAL GEOTECHNICAL REPORT DATED 03/2019 PERFORMED BY EMPIRE GEOTECHNICAL ENGINEERING SERVICES PROJECT NO. WB-18-115 SS. CONTRACTOR IS TO FOLLOW ALL REQUIREMENTS SPECIFIED IN THE GEOTECHNICAL REPORT.

1.5

CONSTRUCTION NOTES:

1.5.1

UNDERGROUND OR EMBEDDED UTILITIES ARE [MAY BE] LOCATED WITHIN OR ADJACENT TO THE AREA IN WHICH EXCAVATION, DEMOLITION, FOUNDATION OR MODIFICATION WORK IS TO BE PERFORMED.

1.5.2

REFERENCES RELATING TO THE UNDERGROUND OR EMBEDDED UTILITIES ARE PROVIDED TO ASSIST THE CONTRACTOR/INSTALLER IN THE FIELD LOCATING THOSE UTILITIES AND OTHER POSSIBLE UNDERGROUND OR EMBEDDED INTERFERENCES WITH THE WORK.

1.5.3

THE CONTRACTOR/INSTALLER SHALL EXERCISE DUE CAUTION DURING ALL EXCAVATION/ FOUNDATION/ DEMOLITION WORK.

1.5.4

CONTRACTOR/INSTALLER SHALL TAKE ALL APPROPRIATE PRECAUTIONS TO ENSURE THE SAFETY OF ALL PEOPLE LOCATED ON THE WORK SITE, INCLUDING CONTRACTOR'S/INSTALLER'S PERSONNEL (OR THAT OF ITS SUBCONTRACTOR(S)) PERFORMING THE WORK.

2.0

CONCRETE WORK

2.1

CONCRETE COVER REQUIREMENTS

REINFORCING BARS ADJACENT TO THE FACE OF CONCRETE SHALL HAVE THE FOLLOWING MINIMUM CONCRETE COVER UNLESS NOTED ON DESIGN DRAWINGS:

2.1.1

CONCRETE CAST AGAINST EARTH OR OTHER SURFACE NOT FORMED3"

2.1.2

FORMED CONCRETE SURFACES PERMANENTLY IN CONTACT WITH SOIL OR EXPOSED TO WEATHER2"

2.1.3

TOP BARS OF CONCRETE MATS AT GRADE2"

2.1.4

ALL OTHER CONDITIONS 1 1/2"

2.2

REINFORCING LAP SPLICE, DEVELOPMENT LENGTH AND STANDARD HOOK REQUIREMENTS

FOR STANDARD HOOKS SEE NOTE 2.2.3. FOR STRAIGHT BARS, LAP SPLICE AND DEVELOPMENT LENGTH REQUIREMENTS ARE GIVEN IN THE TABLES FOR NOTE 2.2.4 AND ARE BASED ON THE FOLLOWING PARAMETERS:

– REINFORCING STEEL STRENGTH Fy=60,000 PSI

– BARS NOT BUNDLED

– UNCOATED BARS

– NORMAL WEIGHT CONCRETE

– CLASS B SPLICES (LST=1.3xELT AND LSO=1.3xELO)

– CONCRETE STRENGTH (f'c) AS NOTED IN THE TABLES

– REINFORCING CLEAR COVER AND CENTER TO CENTER SPACING EQUAL TO, OR GREATER THAN, MINIMUM VALUES IN TABLES. THE CLEAR COVER SHALL BE THE SMALLER OF THE COVER TO THE FACE OR EDGE OF THE CONCRETE INDICATED IN THE SKETCH

CENTER TO CENTER SPACING

EDGE COVER

COVER

FACE OF CONCRETE

FACE OF CONCRETE

REINFORCING BAR (TYP)

COVER

WHERE CONDITIONS LISTED ABOVE ARE NOT MET, LENGTHS IN THE TABLES SHALL BE ADJUSTED WITH THE APPROVAL OF THE CONSULTING ENGINEER.

2.2.1

WHERE REINFORCING BARS OF TWO DIFFERENT SIZES ARE SPLICED, THE SPLICE LENGTH SHALL BE THE REQUIRED LAP SPLICE LENGTH FOR THE SMALLER BAR, BUT NOT LESS THAN THE DEVELOPMENT LENGTH FOR THE LARGER BAR.

2.2.2

ANY HORIZONTAL REINFORCING BAR, OR BAR BENT LESS THAN 45° FROM HORIZONTAL REGARDLESS OF LOCATION, WITH MORE THAN 12" OF CONCRETE CAST BELOW THE BAR, SHALL BE CONSIDERED AS A "TOP BAR". VERTICAL BAR AND HORIZONTAL REINFORCING BAR WITH LESS THAN 12" OF CONCRETE CAST BELOW THE BAR SHALL BE CONSIDERED AS AN "OTHER BAR".

2.2.3

FOR A STANDARD HOOK, THE SCHEDULE BELOW IS BASED ON A SIDE COVER OF NOT LESS THAN 2 1/2" AND THE COVER OVER THE BAR EXTENSION BEYOND THE HOOK OF NOT LESS THAN 2". IF THESE COVER REQUIREMENTS ARE NOT MET, THE VALUES FOR Ldh SHALL BE MULTIPLIED BY 1.43.

CRITICAL SECTION WHERE DEVELOPMENT OF BAR IS REQUIRED.

Ldh (MIN.)

PSI

H

STANDARD HOOK LENGTHS REINFORCING STEEL Fy=60,000 PSI LENGTHS GIVEN IN INCHES

BAR SIZE	CONCRETE STRENGTH f'c = 4,500 PSI	
	H	Ldh
3	6	6
4	8	7
5	10	8
6	12	10
7	14	11
8	16	13
9	20	15
10	22	16
11	24	18

2.2.4

LAP AND DEVELOPMENT LENGTHS FOR CONCRETE STRENGTH f'c = 4,500 PSI

CONCRETE STRENGTH: f'c = 4,500 PSI

REINFORCING STEEL CLEAR COVER: 1 1/2" MINIMUM

REINFORCING STEEL STRENGTH: Fy = 60,000 PSI

LENGTHS GIVEN IN INCHES

BAR SIZE	LAP SPLICE LENGTH			DEVELOPMENT LENGTH		
	TOP BARS LST	OTHER BARS LSO	MIN. BAR SPAC	TOP BARS ELT	OTHER BARS ELO	MIN. BAR SPAC
3	16	16	2.3	12	12	1.9
4	19	16	3.0	14	12	2.5
5	24	19	3.8	18	14	3.2
6	28	23	4.5	21	17	3.8
7	46	36	4.8	35	27	3.9
8	58	45	5.0	44	34	4.0
9	71	55	5.3	54	42	4.2
10	86	67	5.6	66	51	4.3
11	103	80	5.9	79	61	4.5

CONCRETE STRENGTH: f'c = 4,500 PSI

REINFORCING STEEL CLEAR COVER: 2" MINIMUM

REINFORCING STEEL STRENGTH: Fy = 60,000 PSI

LENGTHS GIVEN IN INCHES

BAR SIZE	LAP SPLICE LENGTH			DEVELOPMENT LENGTH		
	TOP BARS LST	OTHER BARS LSO	MIN. BAR SPAC	TOP BARS ELT	OTHER BARS ELO	MIN. BAR SPAC
3	16	16	2.3	12	12	1.9
4	19	16	3.0	14	12	2.5
5	24	19	3.8	18	14	3.2
6	28	23	4.5	21	17	3.8
7	41	32	5.3	31	24	4.4
8	46	36	6.0	35	27	5.0
9	58	45	6.3	44	34	5.2
10	71	55	6.6	54	42	5.3
11	85	65	6.9	65	50	5.5

CONCRETE STRENGTH: f'c = 4,500 PSI

REINFORCING STEEL CLEAR COVER: 3" MINIMUM

REINFORCING STEEL STRENGTH: Fy = 60,000 PSI

LENGTHS GIVEN IN INCHES

BAR SIZE	LAP SPLICE LENGTH			DEVELOPMENT LENGTH		
	TOP BARS LST	OTHER BARS LSO	MIN. BAR SPAC	TOP BARS ELT	OTHER BARS ELO	MIN. BAR SPAC
3	16	16	2.3	12	12	1.9
4	19	16	3.0	14	12	2.5
5	24	19	3.8	18	14	3.2
6	28	23	4.5	21	17	3.8
7	41	32	5.3	31	24	4.4
8	46	36	6.0	35	27	5.0
9	52	41	6.8	40	31	5.7
10	59	46	7.7	45	35	6.4
11	65	50	8.5	50	38	7.1

HOLD FOR FINAL DESIGN

PRELIMINARY NOT FOR CONSTRUCTION

[illegible]

CONCRETE GENERAL NOTES SHEET 2

CONCRETE WORK (CONTINUED)			CONCRETE WORK (CONTINUED)			CONCRETE WORK (CONTINUED)			3.0	DRILLED PIER GENERAL NOTES	
A	2.3	<u>DETAILING, FABRICATION & CONSTRUCTION REQUIREMENTS</u>	2.3.16	FOR MULTIPLE LAYERS OF PARALLEL REINFORCING BARS, THE CONTRACTOR SHALL FURNISH SPACER BARS AS REQUIRED TO SATISFY THE REQUIREMENTS OF NOTES 2.3.14 AND 2.3.15. REINFORCING BARS SHALL NOT BE BUNDLED UNLESS SPECIFICALLY NOTED ON THE DESIGN DRAWINGS.	2.3.27	SLEEVE PENETRATIONS OR EMBEDDED PIPES SHALL BE ROTATED TO PROVIDE MAXIMUM SPACE BETWEEN THE FIN LUGS OF ADJACENT SLEEVES.	3.1	FOUNDATION INSTALLATION SHALL BE IN ACCORDANCE WITH THE DRILLED PIER GENERAL NOTES AND THE AMERICAN CONCRETE INSTITUTE (ACI) STANDARDS 315, 318, LATEST EDITION.			
	2.3.1	ALL CONCRETE AND CONCRETE WORK SHALL CONFORM TO THE LATEST REVISION OF ACI STANDARDS 301, 304, 306, 311, AND 318 & 350.			2.3.28	COLD JOINTS SHALL NOT BE PERMITTED.	3.2	THE BOTTOM OF ALL EXCAVATIONS SHALL BE CLEANED OF ALL LOOSE MATERIAL.			
	2.3.2	THE MINIMUM SPECIFIED COMPRESSIVE STRENGTH OF CONCRETE SHALL BE 4500psi UNLESS NOTED OTHERWISE. MAXIMUM W/CM RATIO SHALL NOT EXCEED 0.45.	2.3.17	ALL EXPOSED REINFORCING DOWELS FOR FUTURE EXTENSION SHALL BE PROTECTED FROM CORROSION. WHERE MECHANICAL SPLICES ARE TO BE USED, THE DOWELS SHALL EXTEND FROM THE FACE OF THE CONCRETE AN ADEQUATE LENGTH TO INSTALL THE MECHANICAL SPLICES PER THE MANUFACTURER'S GUIDELINES.	2.3.29	ALL REINFORCING BARS SHALL BE CONTINUOUS ON OUTSIDE CORNERS OF WALLS OR CORNER BARS SHALL BE PROVIDED.	3.3	CONCRETE SHALL BE PLACED THE SAME DAY PIER HOLES ARE DRILLED.			
B	2.3.3	CONCRETE: READY MIX CONCRETE SHALL CONFORM TO ASTM C94. AIR SHALL BE ADDED PER ASTM C260 TO PRODUCE FROM 6% ± 1.5% ENTRAINED AIR.			2.3.30	DOWELS FOR EQUIPMENT FOUNDATIONS AND CURBS SHALL BE A615 GRADE 60, UNLESS NOTED OTHERWISE.	3.4	CONCRETE SHALL BE PLACED IN SUCH A MANNER SO THAT IT DOES NOT STRIKE THE SIDES OF THE EXCAVATION OR REBAR AS IT IS PLACED.			
	2.3.4	CEMENT: CEMENT SHALL CONFORM TO ASTM C150, LATEST VERSION, TYPE II.	2.3.18	ALL EXPOSED PROJECTING CORNERS OF CONCRETE WORK SHALL BE BEVELED 1" UNLESS NOTED.	2.3.31	ALL WATERSTOPS SHALL BE SPLICED TO FORM A CONTINUOUS WATERTIGHT SEAL. ALL WATERSTOPS SHALL BE SIKA GREENSTREAK PVC OR APPROVED EQUIVALENT.	3.5	ANY CASING USED SHALL BE REMOVED WHILE PLACING CONCRETE.			
	2.3.5	AGGREGATE: THE NORMAL MAXIMUM SIZE FOR CONCRETE AGGREGATES SHALL BE THREE-QUARTERS (.75) INCHES.	2.3.19	DRAWINGS INDICATING LOCATION OF CONSTRUCTION JOINTS REQUIRED IN ADDITION TO OR DIFFERENT FROM THOSE INDICATED ON THE DESIGN DRAWINGS SHALL BE SUBMITTED TO THE CONSULTING ENGINEER FOR REVIEW. THESE DRAWINGS SHALL BE SUBMITTED AND ACCEPTED BY THE CONSULTING ENGINEER BEFORE REBAR DETAILS ARE SUBMITTED FOR REVIEW. ALL CHANGES INCLUDING REQUIRED WATERSTOP, IF ANY, SHALL BE AT CONTRACTOR'S EXPENSE.	2.3.32	NAIL HOLES SHALL BE PROVIDED FOR ALL EMBEDDED PLATES TO SECURE THEM TO FORMWORK. ALL NAIL HOLES SHALL BE INDICATED ON SHOP DRAWINGS.	3.6	TOP SURFACE OF DRILLED FOUNDATION SHALL BE HAND STEEL TROWEL FINISHED AND SLOPED SLIGHTLY TO SHED WATER.			
C	2.3.6	ADMIXTURES: ADMIXTURES SHALL CONTAIN NO CHLORIDES, FLUORIDES OR NITRATES AND SHALL BE FORMULATED BY THE MANUFACTURER FOR THE JOB AREA WEATHER CONDITIONS TO CONTROL SETTING TIME. WATER REDUCING AND RETARDING ADMIXTURES, IF APPROVED BY THE CONSULTING ENGINEER OR CONSTRUCTION COORDINATOR, SHALL CONFORM TO ASTM C494, TYPE A OR D EXCEPT THAT CALCIUM CHLORIDE SHALL NOT BE USED.	2.3.20	ALL CONSTRUCTION JOINTS SHALL BE ROUGHENED TO A MINIMUM AMPLITUDE OF 1/4" UNLESS NOTED OTHERWISE.	2.3.33	CONTRACTOR SHALL NOT INSTALL CONCRETE EXPANSION ANCHORS OTHER THAN THOSE SPECIFICALLY INDICATED ON THE DESIGN DRAWINGS, WITHOUT THE APPROVAL OF THE CONSULTING ENGINEER.	3.7	SET TIES SO THAT ENDS ARE DIRECTED INTO CONCRETE AND NOT TOWARD EXPOSED CONCRETE SURFACE.			
	2.3.7	NO WATER SHALL BE ADDED TO THE MIX AFTER INITIAL BATCHING WITHOUT THE WRITTEN APPROVAL OF THE CONSULTING ENGINEER OR CONSTRUCTION COORDINATOR.	2.3.21	ALL CONSTRUCTION JOINTS SHALL BE THOROUGHLY CLEANED AND MOISTENED BEFORE PLACING FRESH CONCRETE.	2.3.34	ALL ALUMINUM SURFACES EMBEDDED IN OR IN CONTACT WITH CONCRETE SHALL BE COATED IN ACCORDANCE WITH ACI REQUIREMENTS.	3.8	PIERS THAT ARE LOCATED LESS THAN 3 PIER DIAMETERS APART, CENTER TO CENTER, SHALL NOT BE CONSTRUCTED ON THE SAME DAY. FOR PIERS OF DIFFERENT SIZES, THE LARGER PIER SHALL BE CONSTRUCTED FIRST.			
	2.3.8	ALL REINFORCING BARS SHALL CONFORM TO ASTM A615 GRADE 60 DEFORMED BARS UNLESS NOTED OTHERWISE.	2.3.22	AT ALL HORIZONTAL CONSTRUCTION JOINTS A 1" MINIMUM TO 3" MAXIMUM LAYER OF MORTAR OF THE SAME STRENGTH OR GREATER AS THAT OF THE ADJACENT CONCRETE SHALL BE PLACED ON THE JOINT SURFACE IMMEDIATELY PRIOR TO PLACEMENT OF FRESH CONCRETE.	2.3.35	WHERE CONCRETE SLAB IS INDICATED AS SLOPED (TO DRAIN) SPECIFIED CONCRETE THICKNESS SHALL BE MEASURED AT THE HIGH POINT. REINFORCING COVER REQUIREMENTS SHALL BE MAINTAINED AT THE LOW POINT OF CONCRETE.	3.9	WET SETTING OF ANCHORS IS NOT ALLOWED.			
D	2.3.9	ALL WELDED WIRE FABRIC SHALL CONFORM TO ASTM A185. ALL WELDED WIRE FABRIC SHALL BE LAPPED TWO PANELS AT EDGES AND ENDS AND TIED SECURELY.	2.3.23	IT IS NOT A REQUIREMENT THAT THE WATERSTOP BE PLACED AT THE CENTERLINE OF THE STRUCTURAL ELEMENT. AT THE CONTRACTOR'S OPTION THE WATERSTOP MAY BE PLACED ANYWHERE BETWEEN THE CENTERLINE OF THE STRUCTURAL ELEMENT AND A POINT LOCATED A MINIMUM OF 2" FROM THE FACE OF THE REINFORCING BARS ON THE WATER SIDE OF THE JOINT.	2.3.36	PROVIDE SADDLES ON SLOPED FLOORS AT ALL EQUIPMENT PADS TO PREVENT WATER ACCUMULATION.	3.10	DRILLED PIER INSTALLATION/EXCAVATION SHALL BE MONITORED BY A REPRESENTATIVE OF EMPIRE GEOTECHNICAL ENGINEERING SERVICES (OR QUALIFIED EQUAL).			
	2.3.10	ALL WELDING STUD ANCHORS SHALL BE COLD DRAWN STEEL CONFORMING TO ASTM A108 WITH A MINIMUM YIELD STRENGTH OF 50 ksi AND SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S GUIDELINES.			2.3.37	ANCHOR BOLTS WILL BE ASTM F1554 GRADE 36 UNLESS NOTED. AFTER FABRICATION HOT-DIP GALVANIZE, PER ASTM A153, THE PROJECTION PLUS 3" OF EACH ANCHOR	4.0	<u>CONC. INSPECTION & TESTING NOTES</u>			
	2.3.11	ALL LAP SPLICES FOR REINFORCING BARS #11 AND SMALLER SHALL BE AS INDICATED IN NOTE 2.2 AND SHALL BE STAGGERED UNLESS OTHERWISE APPROVED BY THE ENGINEER.	2.3.24	DIMENSIONS OF EXISTING WORK SHALL BE FIELD VERIFIED BY THE CONTRACTOR PRIOR TO THE START OF WORK. DIMENSIONS NOTED FOR REFERENCE (REF) INDICATE NOMINAL DIMENSIONS FOR THE EXISTING STRUCTURE. THEY ARE SHOWN FOR INFORMATION ONLY.	2.3.38	HORIZONTAL TOLERANCE FOR ANCHOR BOLT LOCATION TO BE ± 1/8".	4.1	CONCRETE SHALL BE INSPECTED AND TESTED BY A CERTIFIED TECHNICIAN.			
E	2.3.12	LAP SPLICES SHALL BE USED ONLY WHERE IT IS NOT PRACTICAL TO USE CONTINUOUS BARS.			2.3.39	HEATING AND WELDING OF REINFORCING STEEL IS NOT PERMITTED.	4.2	CONCRETE SHALL BE SAMPLED AND TESTED AT LEAST ONCE EVERY 100 CUBIC YARDS, BUT NOT LESS THAN ONCE PER DAY.			
	2.3.13	PROVIDE A STANDARD 90° HOOK LENGTH AS INDICATED IN NOTE 2.2.3 WHEN STRAIGHT BAR DEVELOPMENT LENGTH IS NOT OBTAINABLE. THE Ldh DIMENSION SHALL BE ADJUSTED AS SHOWN ON DESIGN DRAWINGS SO THAT THE HOOK CAN BE TIED TO THE FAR FACE BARS UNLESS NOTED OTHERWISE.	2.3.25	THE FOLLOWING TYPES OF CONCRETE FINISH SHALL BE PROVIDED FOR THE SURFACES INDICATED UNLESS NOTED OTHERWISE. SEE ACI 301 AND THE APPLICABLE CONSTRUCTION SPECIFICATIONS FOR A DESCRIPTION OF THE SURFACE FINISH TYPES. A. SCRATCHED FINISH – INTENTIONALLY ROUGHENED TO A FULL AMPLITUDE OF 1/4" – TOP OF AN INTERMEDIATE LIFT IN MULTILIFT POURS OF SLABS, WALLS, OR MATS (E.G., CONSTRUCTION JOINTS). B. TROWELLED FINISH – FOR FLOORS AND THE TOP SURFACES OF CURBS, PIERS, AND PEDESTALS. C. BROOM OR BELT FINISH – EQUIPMENT SLABS OR APRONS AT ENTRANCES TO BUILDINGS			4.3	CONCRETE SHALL BE TESTED FOR TEMPERATURE, SLUMP, AIR CONTENT AND STRENGTH IN ACCORDANCE WITH THE APPLICABLE ACI AND ASTM STANDARDS.			
	2.3.14	THE MINIMUM CLEAR DISTANCE BETWEEN TWO PARALLEL BARS OR BETWEEN A PARALLEL BAR AND AN EMBEDDED CONDUIT OR PIPE SHALL NOT BE LESS THAN ONE BAR DIAMETER OR 1 1/3 TIMES THE MAXIMUM SIZE OF COARSE AGGREGATE OR 1" WHICHEVER IS THE GREATER.	2.3.26	SPECIAL CONCRETE FINISHES OTHER THAN THOSE SPECIFIED IN NOTE 2.3.25 ARE SPECIFIED ON THE PLAN DRAWINGS.			4.4	SIX (6) CYLINDERS SHALL BE TAKEN AT EACH SAMPLE. TWO (2) SPECIMENS SHALL BE TESTED FOR STRENGTH AT 7 DAYS AND 28 DAYS. THE TWO (2) SPARE CYLINDERS SHALL BE USED ONLY WHEN AUTHORIZED BY THE OWNER OR OWNER'S REPRESENTATIVE.			
F	2.3.15	WHERE PARALLEL REINFORCING BAR IS PLACED IN TWO OR MORE LAYERS, THE BARS IN THE UPPER LAYERS SHALL BE PLACED DIRECTLY ABOVE THOSE IN THE BOTTOM LAYER WITH CLEAR DISTANCE BETWEEN BARS NOT LESS THAN 1".					5.0	<u>SUBMITTAL NOTES</u>			
							5.1	CONCRETE MIX DESIGNS SHALL BE PREPARED AND SUBMITTED FOR REVIEW IN ACCORDANCE WITH ACI STANDARDS.			
							5.2	SHOP DRAWINGS FOR REINFORCING STEEL SHALL BE PREPARED IN ACCORDANCE WITH ACI AND CRSI STANDARDS AND SUBMITTED FOR REVIEW.			
							5.3	SUBMITTALS SHALL BE SUBMITTED FOR REVIEW AT LEAST TWO (2) WEEKS PRIOR TO COMMENCEMENT OF THE WORK.			

--										SCALE:					
--															
--															
--															
--															
--															
--															
A	02/28/2020	PRELIMINARY - ISSUED FOR BID						JB	NPR	-	S&L	PREP:	MJD	CHKD:	NPR
NO	DATE	REVISIONS AND RECORD OF ISSUE						DRWN	REV'D	APPR	COMP	APPD:	-	DATE:	02/28/2020

CONTRACTOR/INSTALLER SHALL TAKE ALL APPROPRIATE PRECAUTIONS TO ENSURE THE SAFETY OF ALL PEOPLE LOCATED ON THE WORK SITE; INCLUDING CONTRACTOR'S /INSTALLER'S PERSONNEL (OR THAT OF ITS SUB-CONTRACTOR(S)) PERFORMING THE WORK.

ANY MODIFICATION OR ADDITION TO THIS DRAWING BY ANY ORGANIZATION OTHER THAN SARGENT & LUNDY IS NOT THE RESPONSIBILITY OF SARGENT & LUNDY.




55 EAST MONROE ST., CHICAGO, ILL.




NEXTERA ENERGY TRANSMISSION NEW YORK, INC.
STOLLE 345kV SWITCHYARD
CONCRETE GENERAL NOTES SH. 2

STL-S1-0102



FOUNDATION IDENTIFICATION & REFERENCES			
IDENTIFICATION	TOTAL QUANTITY	DESCRIPTION	REFERENCE DRAWING
P1	12	345KV DEADEND	STL-S1-0104
P2	9	345KV CCVT STAND	STL-S1-0104
P3	64	345KV SWITCH STAND	STL-S1-0104
P4	16	345KV BUS SUPPORT	STL-S1-0104
P5	27	φ1 BUS SUPPORT	STL-S1-0104
P6	9	SURGE ARRESTER	STL-S1-0104
P7	6	345KV CT/PT	STL-S1-0104
P8	1	345KV CCVT & WAVE TRAP STAND	STL-S1-0104
P9	1	345KV SSVT	STL-S1-0104
F1	1	REACTOR FOUNDATION AND OIL CONTAINMENT	STL-S1-0105
F2	4	345KV CIRCUIT BREAKER	STL-S1-0106
F3	1	CONTROL BUILDING	STL-S1-0107

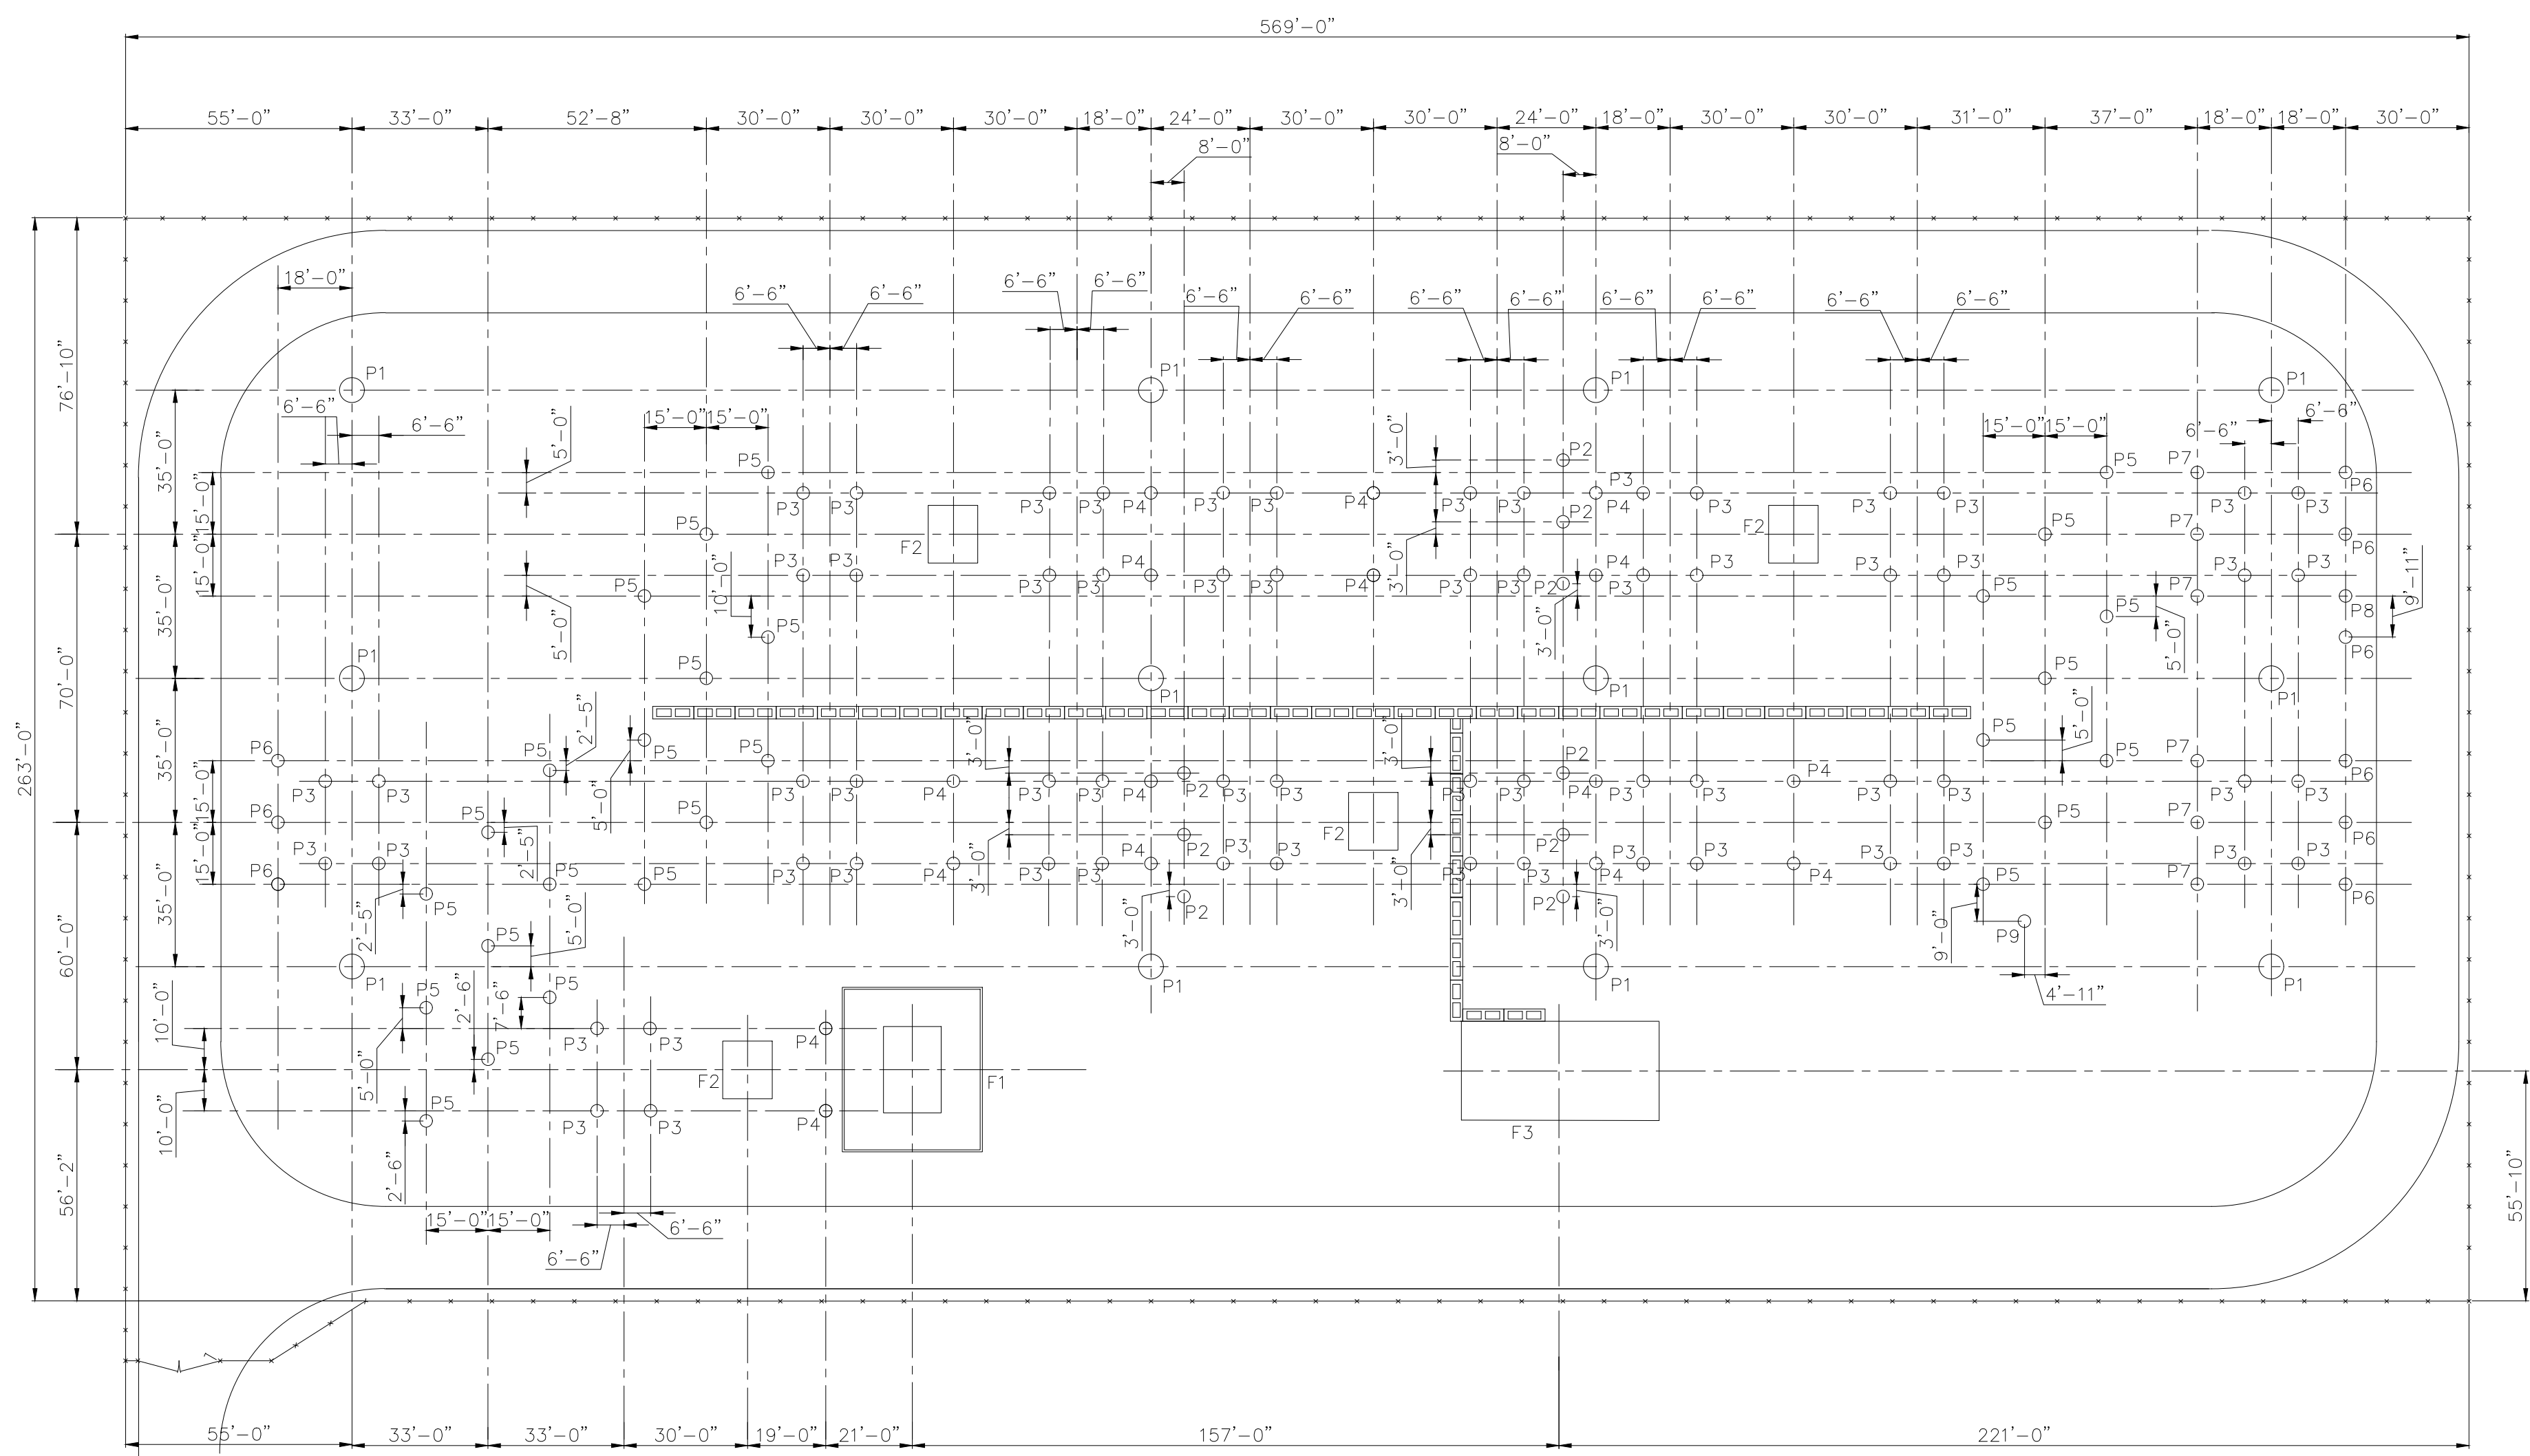


PRELIMINARY
FOR PERMIT ONLY

FOR PERMIT ONLY


LEGEND

F000

FOUNDATION IDENTIFICATION



ABOVE GRADE FOUNDATION



SUBSTATION FENCE

NOTES:

1. T/C EL. SHALL BE XXX UNLESS NOTED OTHERWISE.

REFERENCE DRAWING

STL-E1-0100

ULTIMATE ELECTRICAL PLAN

STL-E1-0145

GROUNDING PLAN

STL-E1-0155

CONDUIT PLAN

--								SCALE: </
----	--	--	--	--	--	--	--	--

CONTRACTOR/INSTALLER SHALL TAKE ALL APPROPRIATE PRECAUTIONS TO ENSURE THE SAFETY OF ALL PEOPLE LOCATED ON THE WORK SITE; INCLUDING CONTRACTOR'S /INSTALLER'S PERSONNEL (OR THAT OF ITS SUB-CONTRACTOR(S)) PERFORMING THE WORK.

ANY MODIFICATION OR ADDITION TO THIS
DRAWING BY ANY ORGANIZATION OTHER
THAN SARGENT & LUNDY IS NOT THE
RESPONSIBILITY OF SARGENT & LUNDY.



Sargent & Lundy
55 EAST MONROE ST., CHICAGO, ILL.



NEXTERA
ENERGY


TRANSMISSION
NEW YORK

NEXTERA ENERGY TRANSMISSION NEW YORK, INC
EAST STOLLE RD SWITCHYARD
FOUNDATION PLAN


STL-S1-0103

DRILLED PIER FOUNDATION SCHEDULE


FDN MARK NO.	STRUCTURE	CONCRETE		REINFORCING BARS				ANCHOR RODS							REMARKS
				VERTICAL		TIES									
		DIAMETER	LENGTH	QTY. PER FDN	SIZE "A"	QTY. PER FDN	SIZE "B"	SPACING		QTY. PER FDN	DIAMETER OR SIZE	LENGTH	PROJ.	DETAIL	
		"D"	"L"					"X"	"Y"						
P1	345kV DEADEND	7'-0"	30'-0"	18	#8	18	#4	ANCHOR RODS PROVIDED BY xxxxx – SEE VENDOR DWG							
P2	345kV CCVT STAND	3'-0"	15'-0"	8	#8	13	#4	6"	6"	4	1 1/4"	51"	6"	1	
P3	345kV SWITCH STAND	3'-0"	15'-0"	8	#8	13	#4	6"	6"	4	1 1/4"	51"	6"	1	
P4	345kV THREE PHASE BUS SUPPORT (HIGH OR LOW)	3'-0"	15'-0"	8	#8	13	#4	7"	7"	4	1 1/4"	51"	6"	1	
P5	345kV SINGLE PHASE BUS SUPPORT	3'-0"	15'-0"	8	#8	13	#4	6"	6"	4	1 1/4"	51"	6"	1	
P6	345kV SURGE ARRESTOR STAND	3'-0"	15'-0"	8	#8	13	#4	7"	7"	4	1 1/4"	51"	6"	1	
P7	345kV CT/PT STAND	3'-0"	15'-0"	8	#8	13	#4	7"	7"	4	1 1/4"	51"	6"	1	
P8	345kV CCVT & WAVE TRAP STAND	3'-0"	15'-0"	8	#8	13	#4	6"	6"	4	1 1/4"	51"	6"	1	
P9	345kV SSVT STAND	3'-0"	15'-0"	8	#8	13	#4	6"	6"	4	1 1/4"	51"	6"	1	

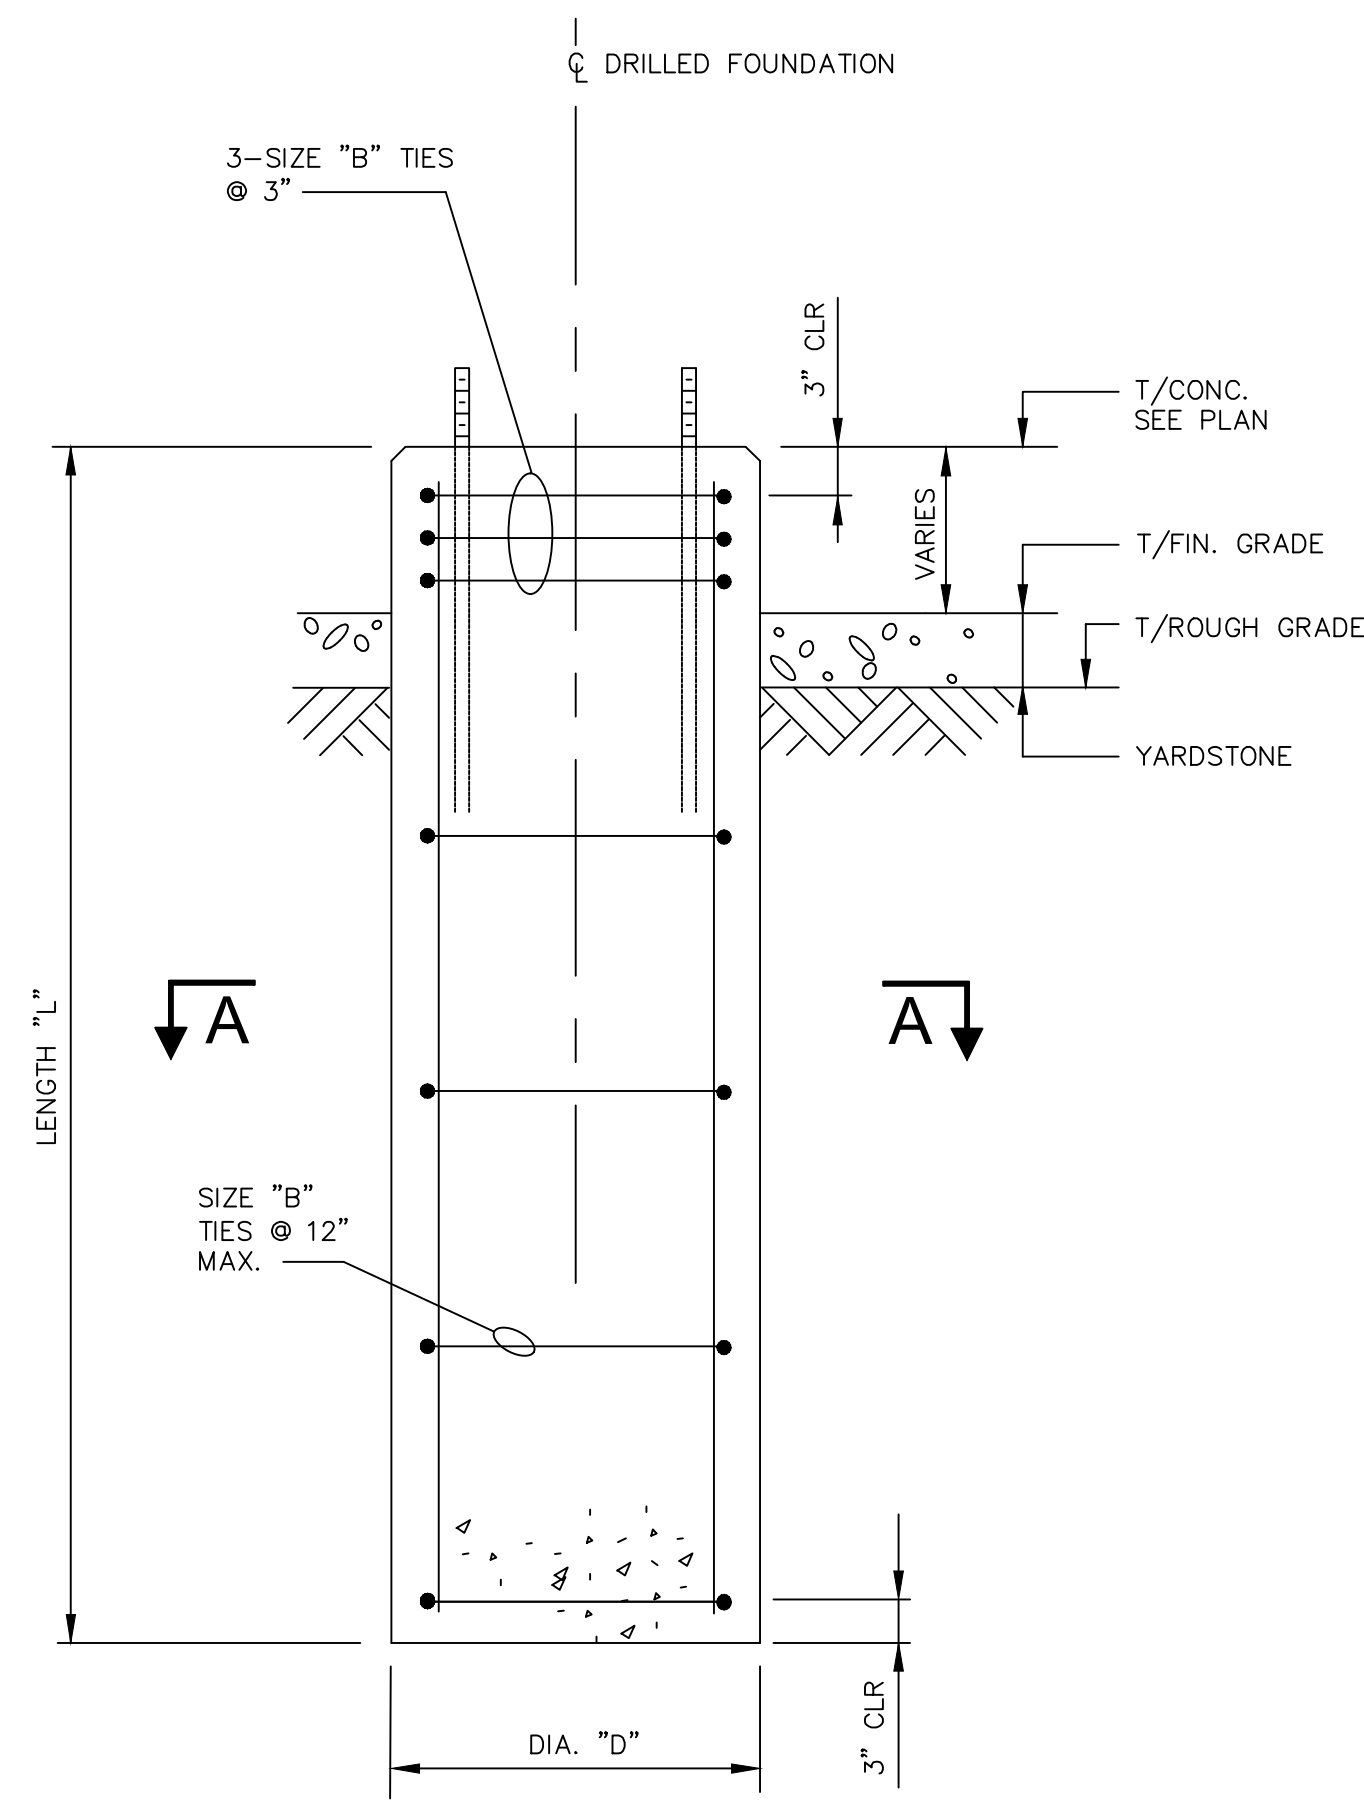


ELEVATION VIEW
TYPICAL DRILLED FOUNDATION
(SEE SCHEDULE)

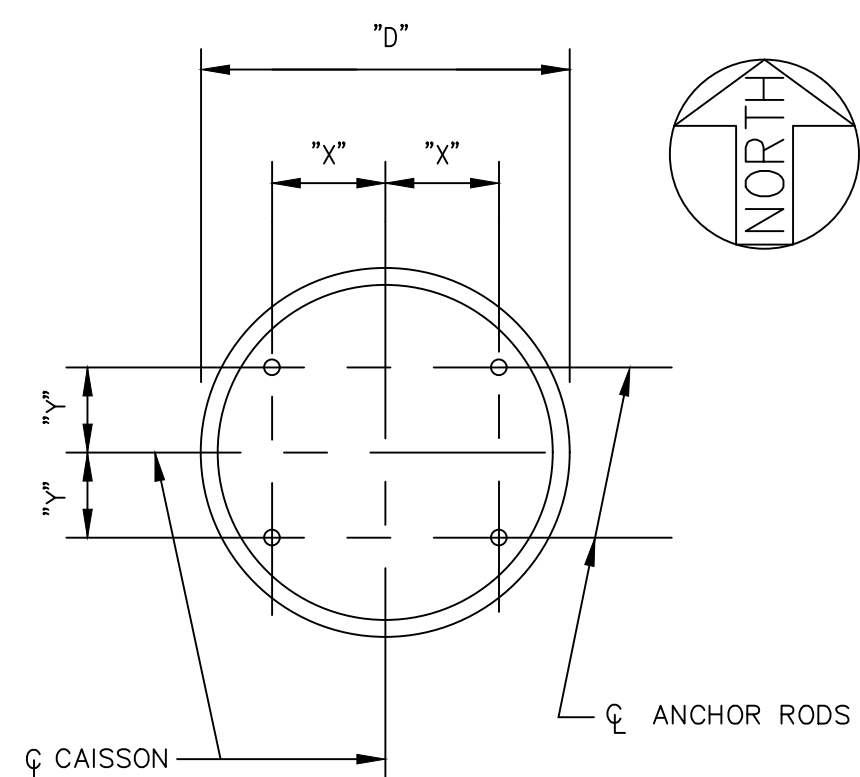

PLAN 1
TYPICAL DRILLED PIER FOUNDATION
(EXCEPT P1)

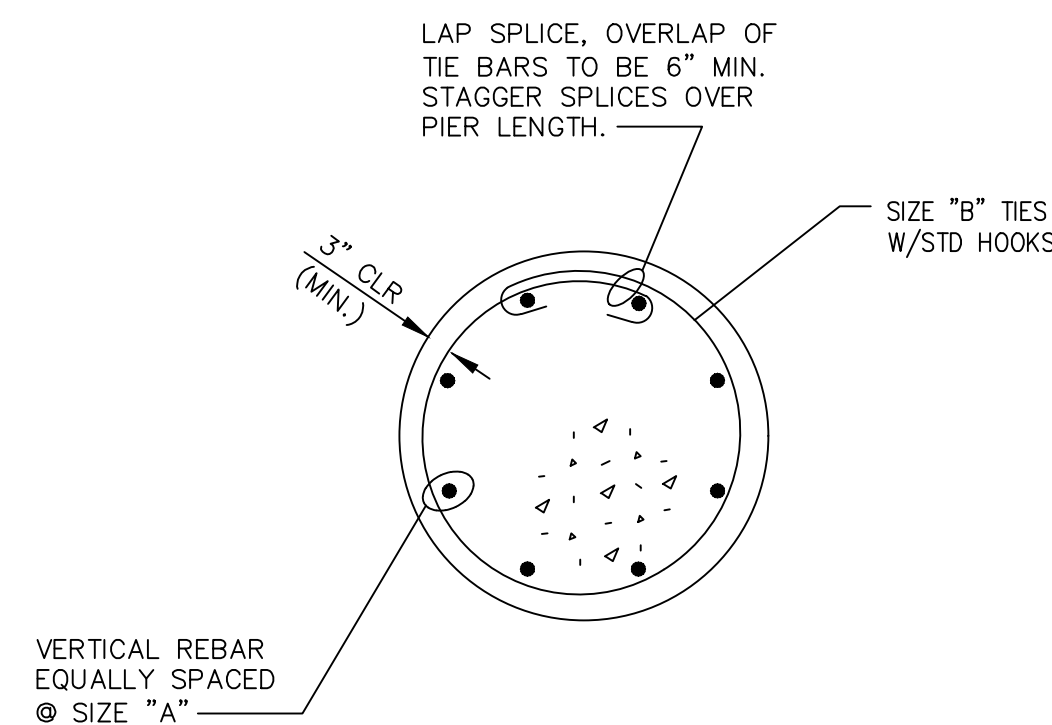

SECTION A-A

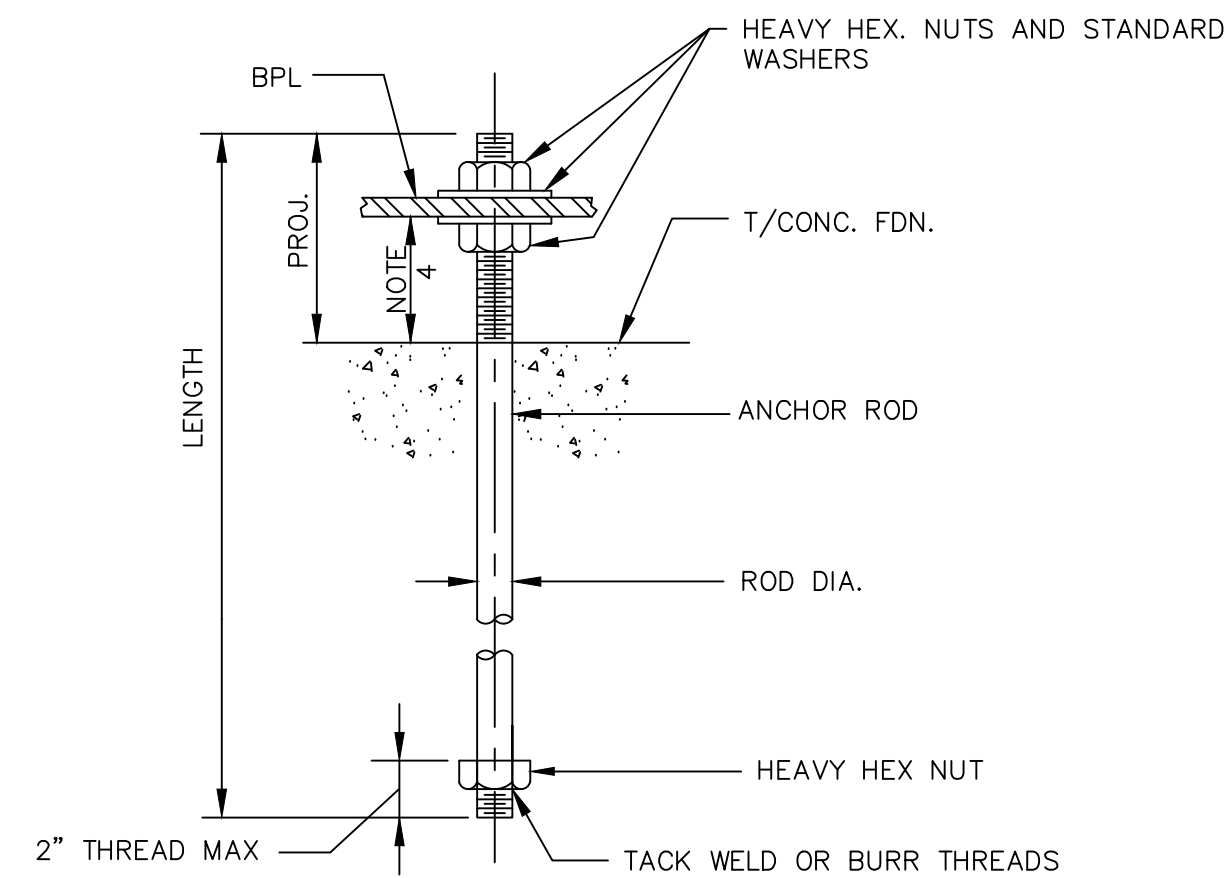

ANCHOR ROD DETAIL 1
F1554 GR 36 ANCHOR RODS

HOLD FOR
FINAL DESIGN

PRELIMINARY
NOT FOR CONSTRUCTION

NOTES

- | | |
|----|--|
| 1. | ALL WORK ON THIS DRAWING SHALL BE FURNISHED AND INSTALLED IN ACCORDANCE WITH THE SCOPE OF WORK SPECIFICATION UNLESS NOTED. |
| 2. | FOR CONCRETE GENERAL NOTES AND DRILLED PIER NOTES SEE DRAWINGS STL-51-0101 AND STL-51-0102. |
| 3. | FOR FOUNDATION LOCATIONS AND TOP OF CONCRETE ELEVATIONS SEE DRAWING STL-51-0103. |
| 4. | THE STRUCTURE BASE PLATE SHALL BE PLACED AS CLOSE AS POSSIBLE TO THE TOP OF FOUNDATION. THE DISTANCE BETWEEN THE BOTTOM OF BASE PLATE AND TO OF CONCRETE SHALL NOT EXCEED TWO TIMES THE ANCHOR ROD DIAMETER. |
| 5. | INSTALL ANCHORS PER MANUFACTURER'S INSTRUCTIONS. SEE BUILDING MANUFACTURER DRAWINGS FOR ANCHOR CLIP AND AND INSTALLATION DETAILS. |

--								SCALE: NONE
--								
--								
--								
--								
--								
A	02/28/2020	PRELIMINARY - ISSUED FOR BID	JB	NPR	-	S&L	PREP: MJD	CHKD: NPR
NO	DATE	REVISIONS AND RECORD OF ISSUE	DRWN	REV'D	APPR	COMP	APPD: -	DATE: 02/28/2020

CONTRACTOR/INSTALLER SHALL TAKE ALL APPROPRIATE PRECAUTIONS TO ENSURE THE SAFETY OF ALL PEOPLE LOCATED ON THE WORK SITE; INCLUDING CONTRACTOR'S /INSTALLER'S PERSONNEL (OR THAT OF IT'S SUB-CONTRACTOR(S)) PERFORMING THE WORK.

ANY MODIFICATION OR ADDITION TO THIS
DRAWING BY ANY ORGANIZATION OTHER
THAN SARGENT & LUNDY IS NOT THE
RESPONSIBILITY OF SARGENT & LUNDY.




Sargent & Lundy
55 EAST MONROE ST., CHICAGO, ILL.





NEXTERA
ENERGY
TRANSMISSION
NEW YORK

NEXTERA ENERGY TRANSMISSION NEW YORK, INC.
STOLLE 345KV SWITCHYARD
DRILLED PIER FOUNDATIONS

STL-S1-0104



STL-S1-0106

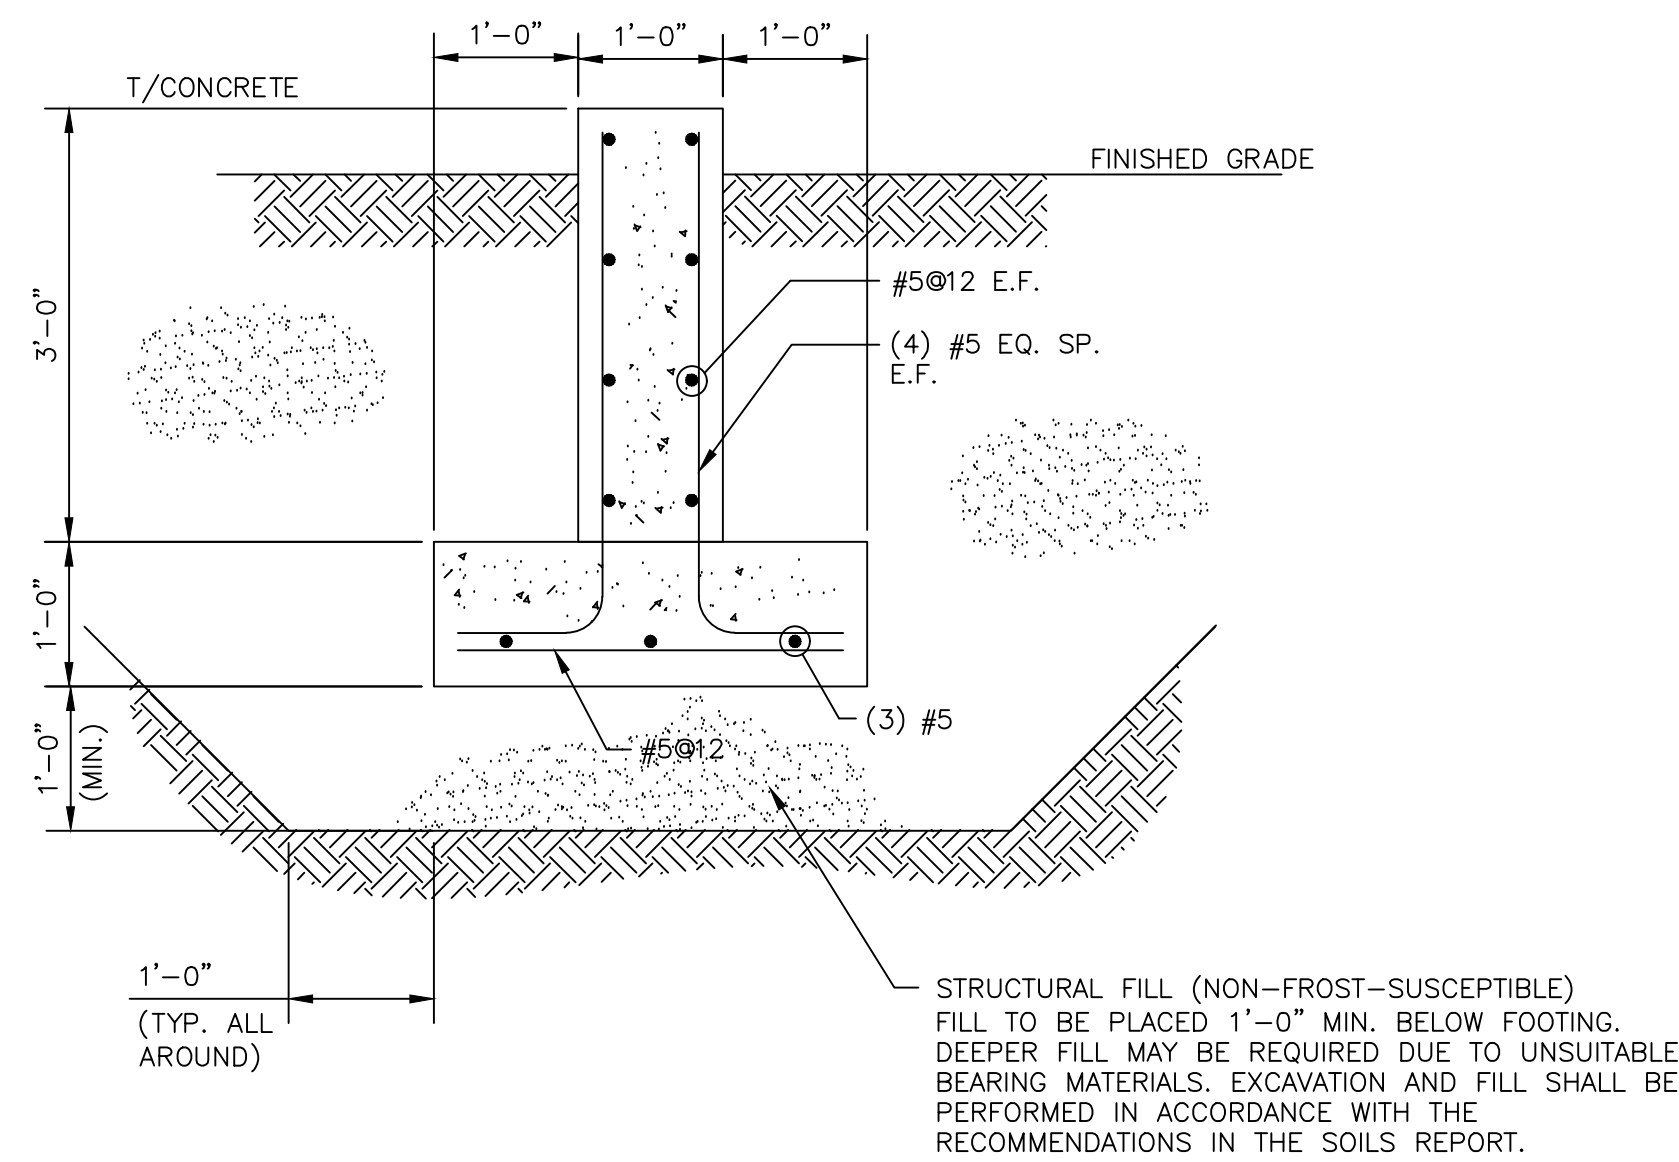

SECTION A-A
SCALE: NONE



GROUNDING PLAN	STL-E1-0145
GROUNDING DETAILS	STL-E1-0150/015
CONDUIT PLAN	STL-E1-0155
CONDUIT DETAILS	STL-E1-0160/016

NOTES	
1.	ALL WORK ON THIS DRAWING SHALL BE FURNISHED AND INSTALLED IN ACCORDANCE WITH THE SCOPE OF WORK SPECIFICATION UNLESS NOTED.
2.	FOR CONCRETE GENERAL NOTES SEE DRAWINGS STL-S1-0101 AND STL-S1-0102.
3.	FOR FOUNDATION LOCATIONS SEE DRAWING STL-S1-0103.
4.	LOCKSTOP WATERSTOP W/PRIMER AS SUPPLIED BY GREENSTREAK (OR APPROVED EQUIVALENT).
5.	FOUNDATION AND CONTAINMENT BASIN SHALL BE PLACED ON COMPACTED STRUCTURAL FILL (NON-FROST-SUSCEPTIBLE). INSTALL FILL IN LIFTS OF 8" (MAX) AND COMPACT TO 95% MODIFIED PROCTOR PER ASTM D1557. ALTERNATIVELY LEAN CONCRETE (1000 PSI MIN.) MAY BE USED STRUCTURAL FILL.

HOLD FOR
FINAL DESIGN

PRELIMINARY
NOT FOR CONSTRUCTION

--								SCALE: AS NOTED		
--										
--										
--										
--										
--										
--										
A	02/28/2020	PRELIMINARY - ISSUED FOR BID	JB	NPR	-	S&L	PREP:	MJD	CHKD:	NPR
NO	DATE	REVISIONS AND RECORD OF ISSUE	DRWN	REV'D	APPR	COMP	APPD:	-	DATE:	02/28/2020

CONTRACTOR/INSTALLER SHALL TAKE ALL APPROPRIATE PRECAUTIONS TO ENSURE THE SAFETY OF ALL PEOPLE LOCATED ON THE WORK SITE; INCLUDING CONTRACTOR'S /INSTALLER'S PERSONNEL (OR THAT OF IT'S SUB-CONTRACTOR(S)) PERFORMING THE WORK.

ANY MODIFICATION OR ADDITION TO THIS
DRAWING BY ANY ORGANIZATION OTHER
THAN SARGENT & LUNDY IS NOT THE
RESPONSIBILITY OF SARGENT & LUNDY



NEXTERA ENERGY TRANSMISSION NEW YORK, INC.
STOLLE 345KV SWITCHYARD
CONTROL BUILDING FOUNDATION

STL-S1-0107



C

E



NOTE:


EACH PART OR ASSEMBLY SHALL BE MARKED WITH THE PIECE OR ASSEMBLY MARK. THE MARKING SHALL BE MADE BEFORE GALVANIZING BY STAMPING WITH DIES (3/4" HIGH LETTERS)

STL-S1-0112


BILL OF MATERIALS					
MARK	QTY.	DESCRIPTION	LENGTH		WEIGHT
			FT.	INS.	
MK-h1	1	HSS 8x8x1/4	8	4 1/4	216
MK-p1	1	PL 1x16	1	4	73
MK-p2	2	PL 3/8x2 1/4	0	3 3/4	2
MK-p3	6	PL 3/8x2	0	2 1/4	3
MK-p4	1	PL 1/2x8	4	0	54
MK-p5	1	PL 3/4x18	2	0	92
MK-u1	2	P1000 UNISTRUT	0	6	2
TOTAL BLACK WEIGHT					443
TOTAL GALVANIZED WEIGHT					462

NOTE:


EACH PART OR ASSEMBLY SHALL BE MARKED WITH THE PIECE OR ASSEMBLY MARK. THE MARKING SHALL BE MADE BEFORE GALVANIZING BY STAMPING WITH DIES (3/4" HIGH LETTERS).

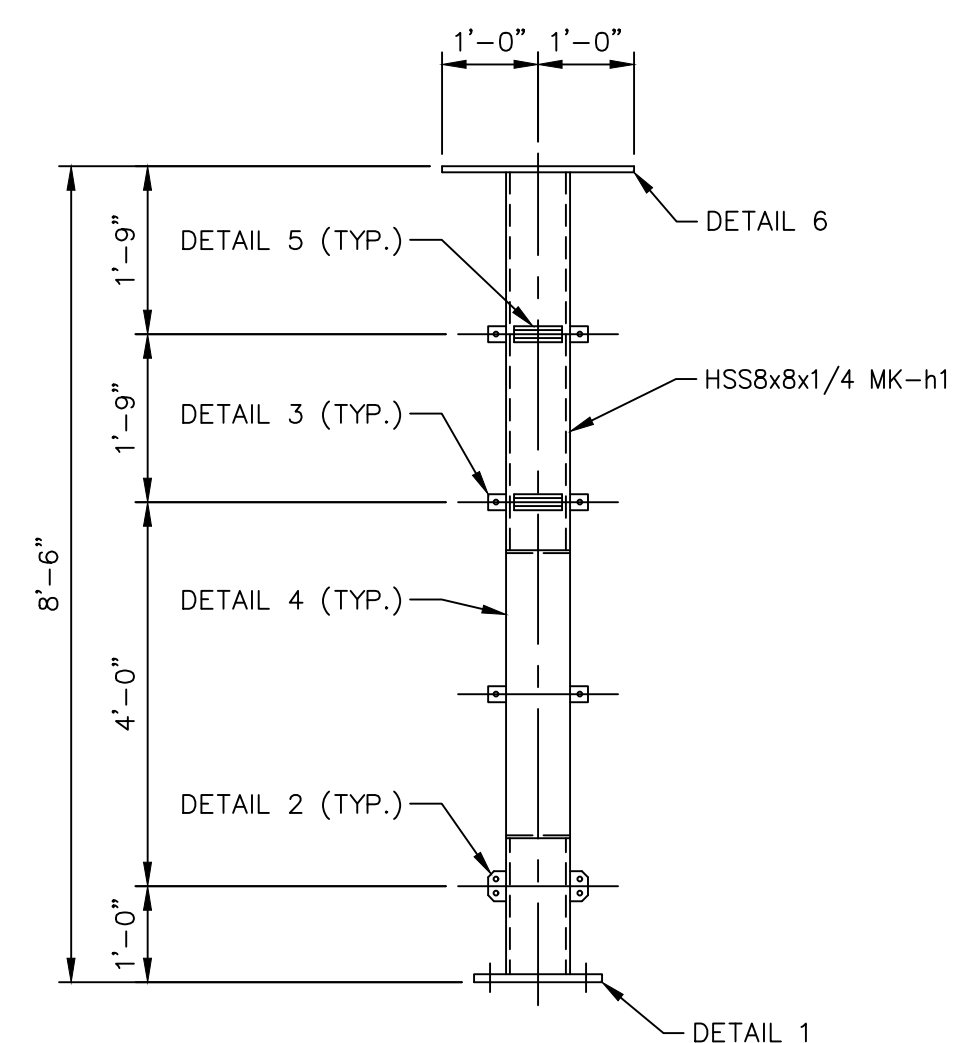


ELEVATION
SCALE: 1/2"=1'0"
(9 REQUIRED)

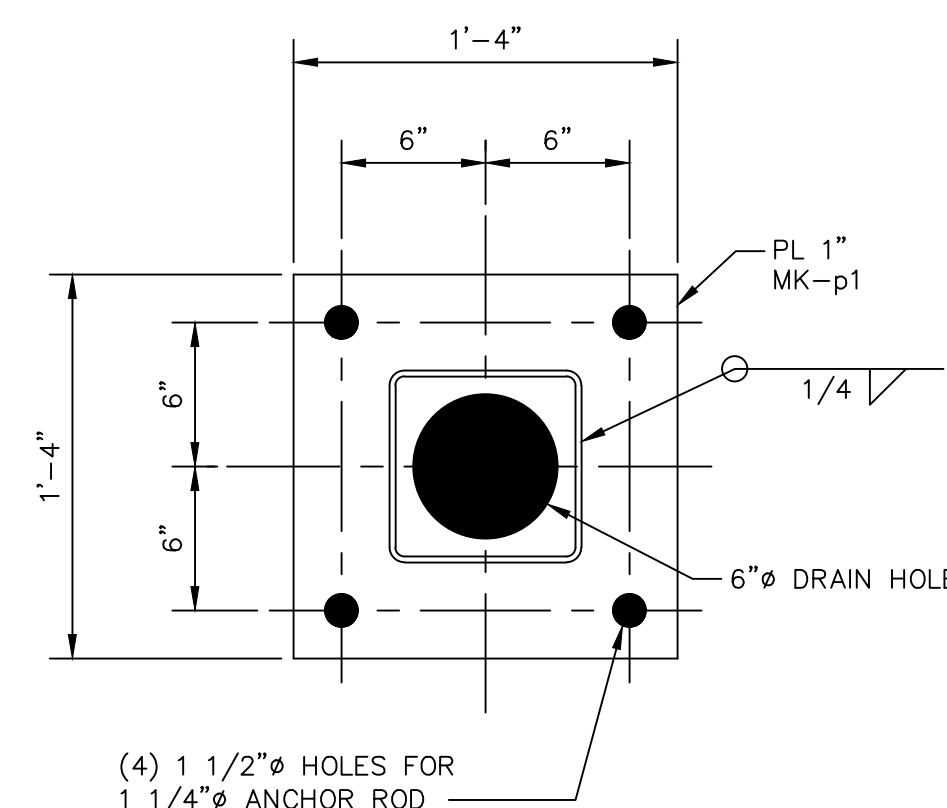


DETAIL 1
SCALE: NONE

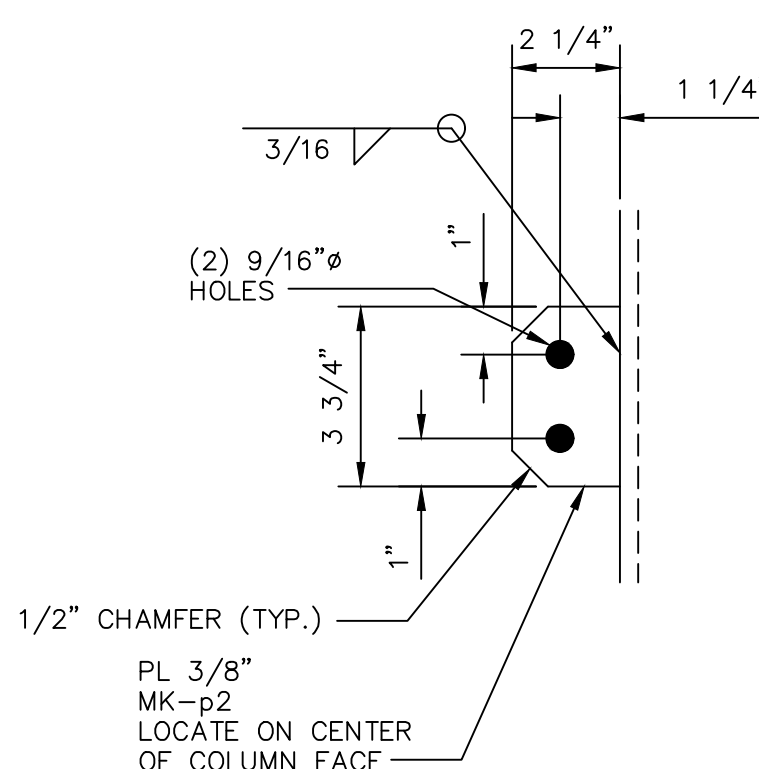

DETAIL 2
SCALE: 3"=1'-0"

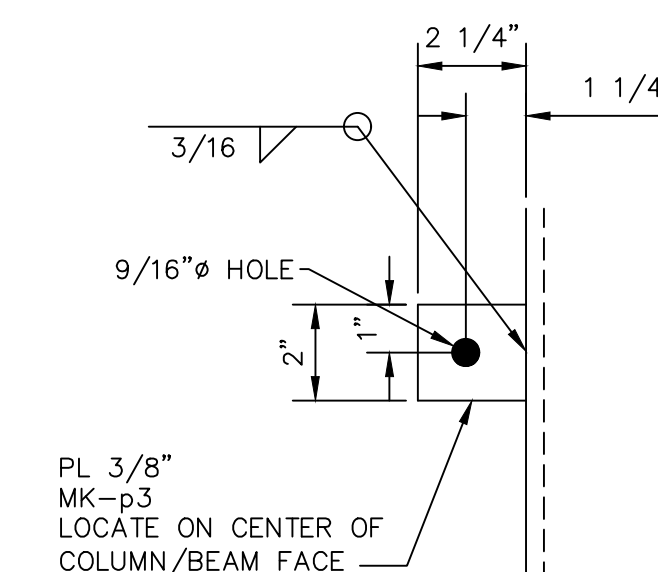


DETAIL 3
SCALE: 3"=1'-0"

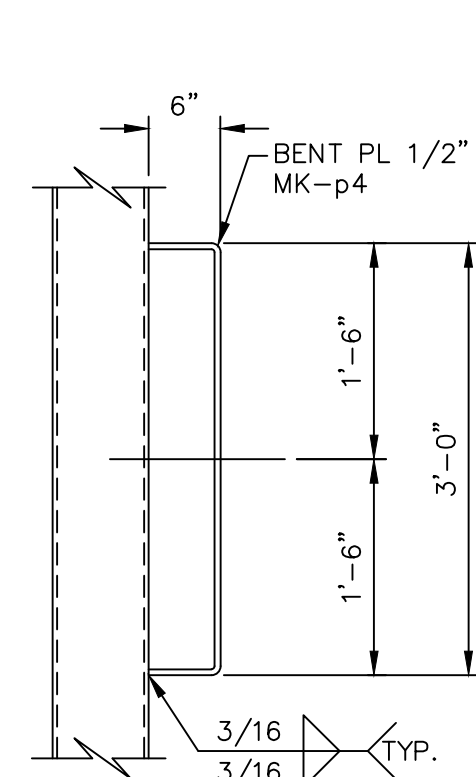


DETAIL 4

SCALE: NONE

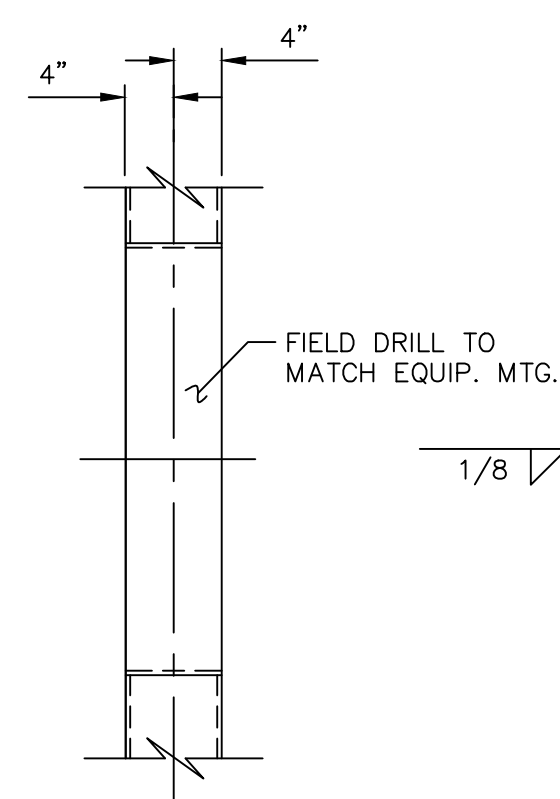

DETAIL 5
SCALE: 1 1/2"=1'-0"

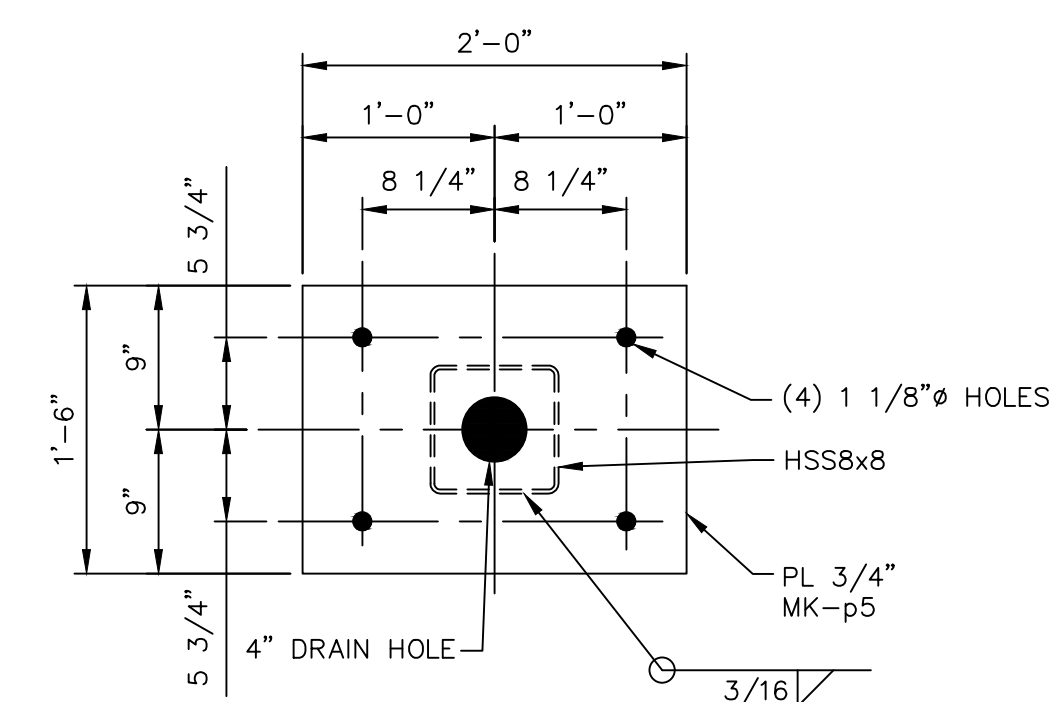

DETAIL 6
SCALE: 1"=1'-0"

HOLD FOR
FINAL DESIGN

PRELIMINARY
NOT FOR CONSTRUCTION

NOTES

- | | |
|----|--|
| 1. | ALL WORK ON THIS DRAWING SHALL BE FURNISHED AND
INSTALLED IN ACCORDANCE WITH THE SCOPE OF WORK SPECIFICATION
UNLESS NOTED. |
| 2. | FOR STRUCTURAL STEEL GENERAL NOTES SEE DRAWING
STL-S1-0110. |

--							SCALE: AS NOTED					
--												
--												
--												
--												
--												
--												
A	02/28/2020	PRELIMINARY - ISSUED FOR BID			JB	NPR	-	S&L	PREP:	MJD	CHKD:	NPR
NO	DATE	REVISIONS AND RECORD OF ISSUE			DRWN	REV'D	APPR	COMP	APPD:	-	DATE:	02/28/2020

CONTRACTOR/INSTALLER SHALL TAKE ALL APPROPRIATE PRECAUTIONS TO ENSURE THE SAFETY OF ALL PEOPLE LOCATED ON THE WORK SITE; INCLUDING CONTRACTOR'S /INSTALLER'S PERSONNEL (OR THAT OF IT'S SUB-CONTRACTOR(S)) PERFORMING THE WORK.

ANY MODIFICATION OR ADDITION TO THIS
DRAWING BY ANY ORGANIZATION OTHER
THAN SARGENT & LUNDY IS NOT THE
RESPONSIBILITY OF SARGENT & LUNDY.



Sargent & Lundy
55 EAST MONROE ST., CHICAGO, ILL.

NEXtera
ENERGY

TRANSMISSION
NEW YORK


NEXTERA ENERGY TRANSMISSION NEW YORK, INC.
STOLLE 345kV SWITCHYARD
345kV CCVT STAND

STL-S1-0114

BILL OF MATERIALS					
MARK	QTY.	DESCRIPTION	LENGTH		WEIGHT
			FT.	INS.	
MK-h1	1	HSS 10x10x1/4	14	10 1/4	600
MK-p1	1	PL 1x1x1	1	6	92
MK-p2	2	PL 3/8x2 1/4	0	3 3/4	2
MK-p3	8	PL 3/8x2	0	2 1/4	4
MK-p4	1	PL 1/2x8	4	0	54
MK-p5	1	PL 3/4x18	2	0	92
MK-u1	3	P1000 UNISTRUT	0	6	3
TOTAL BLACK WEIGHT					847
TOTAL GALVANIZED WEIGHT					877

NOTE:

EACH PART OR ASSEMBLY SHALL BE MARKED WITH THE PIECE OR ASSEMBLY MARK. THE MARKING SHALL BE MADE BEFORE GALVANIZING BY STAMPING WITH DIES (3/4" HIGH LETTERS).

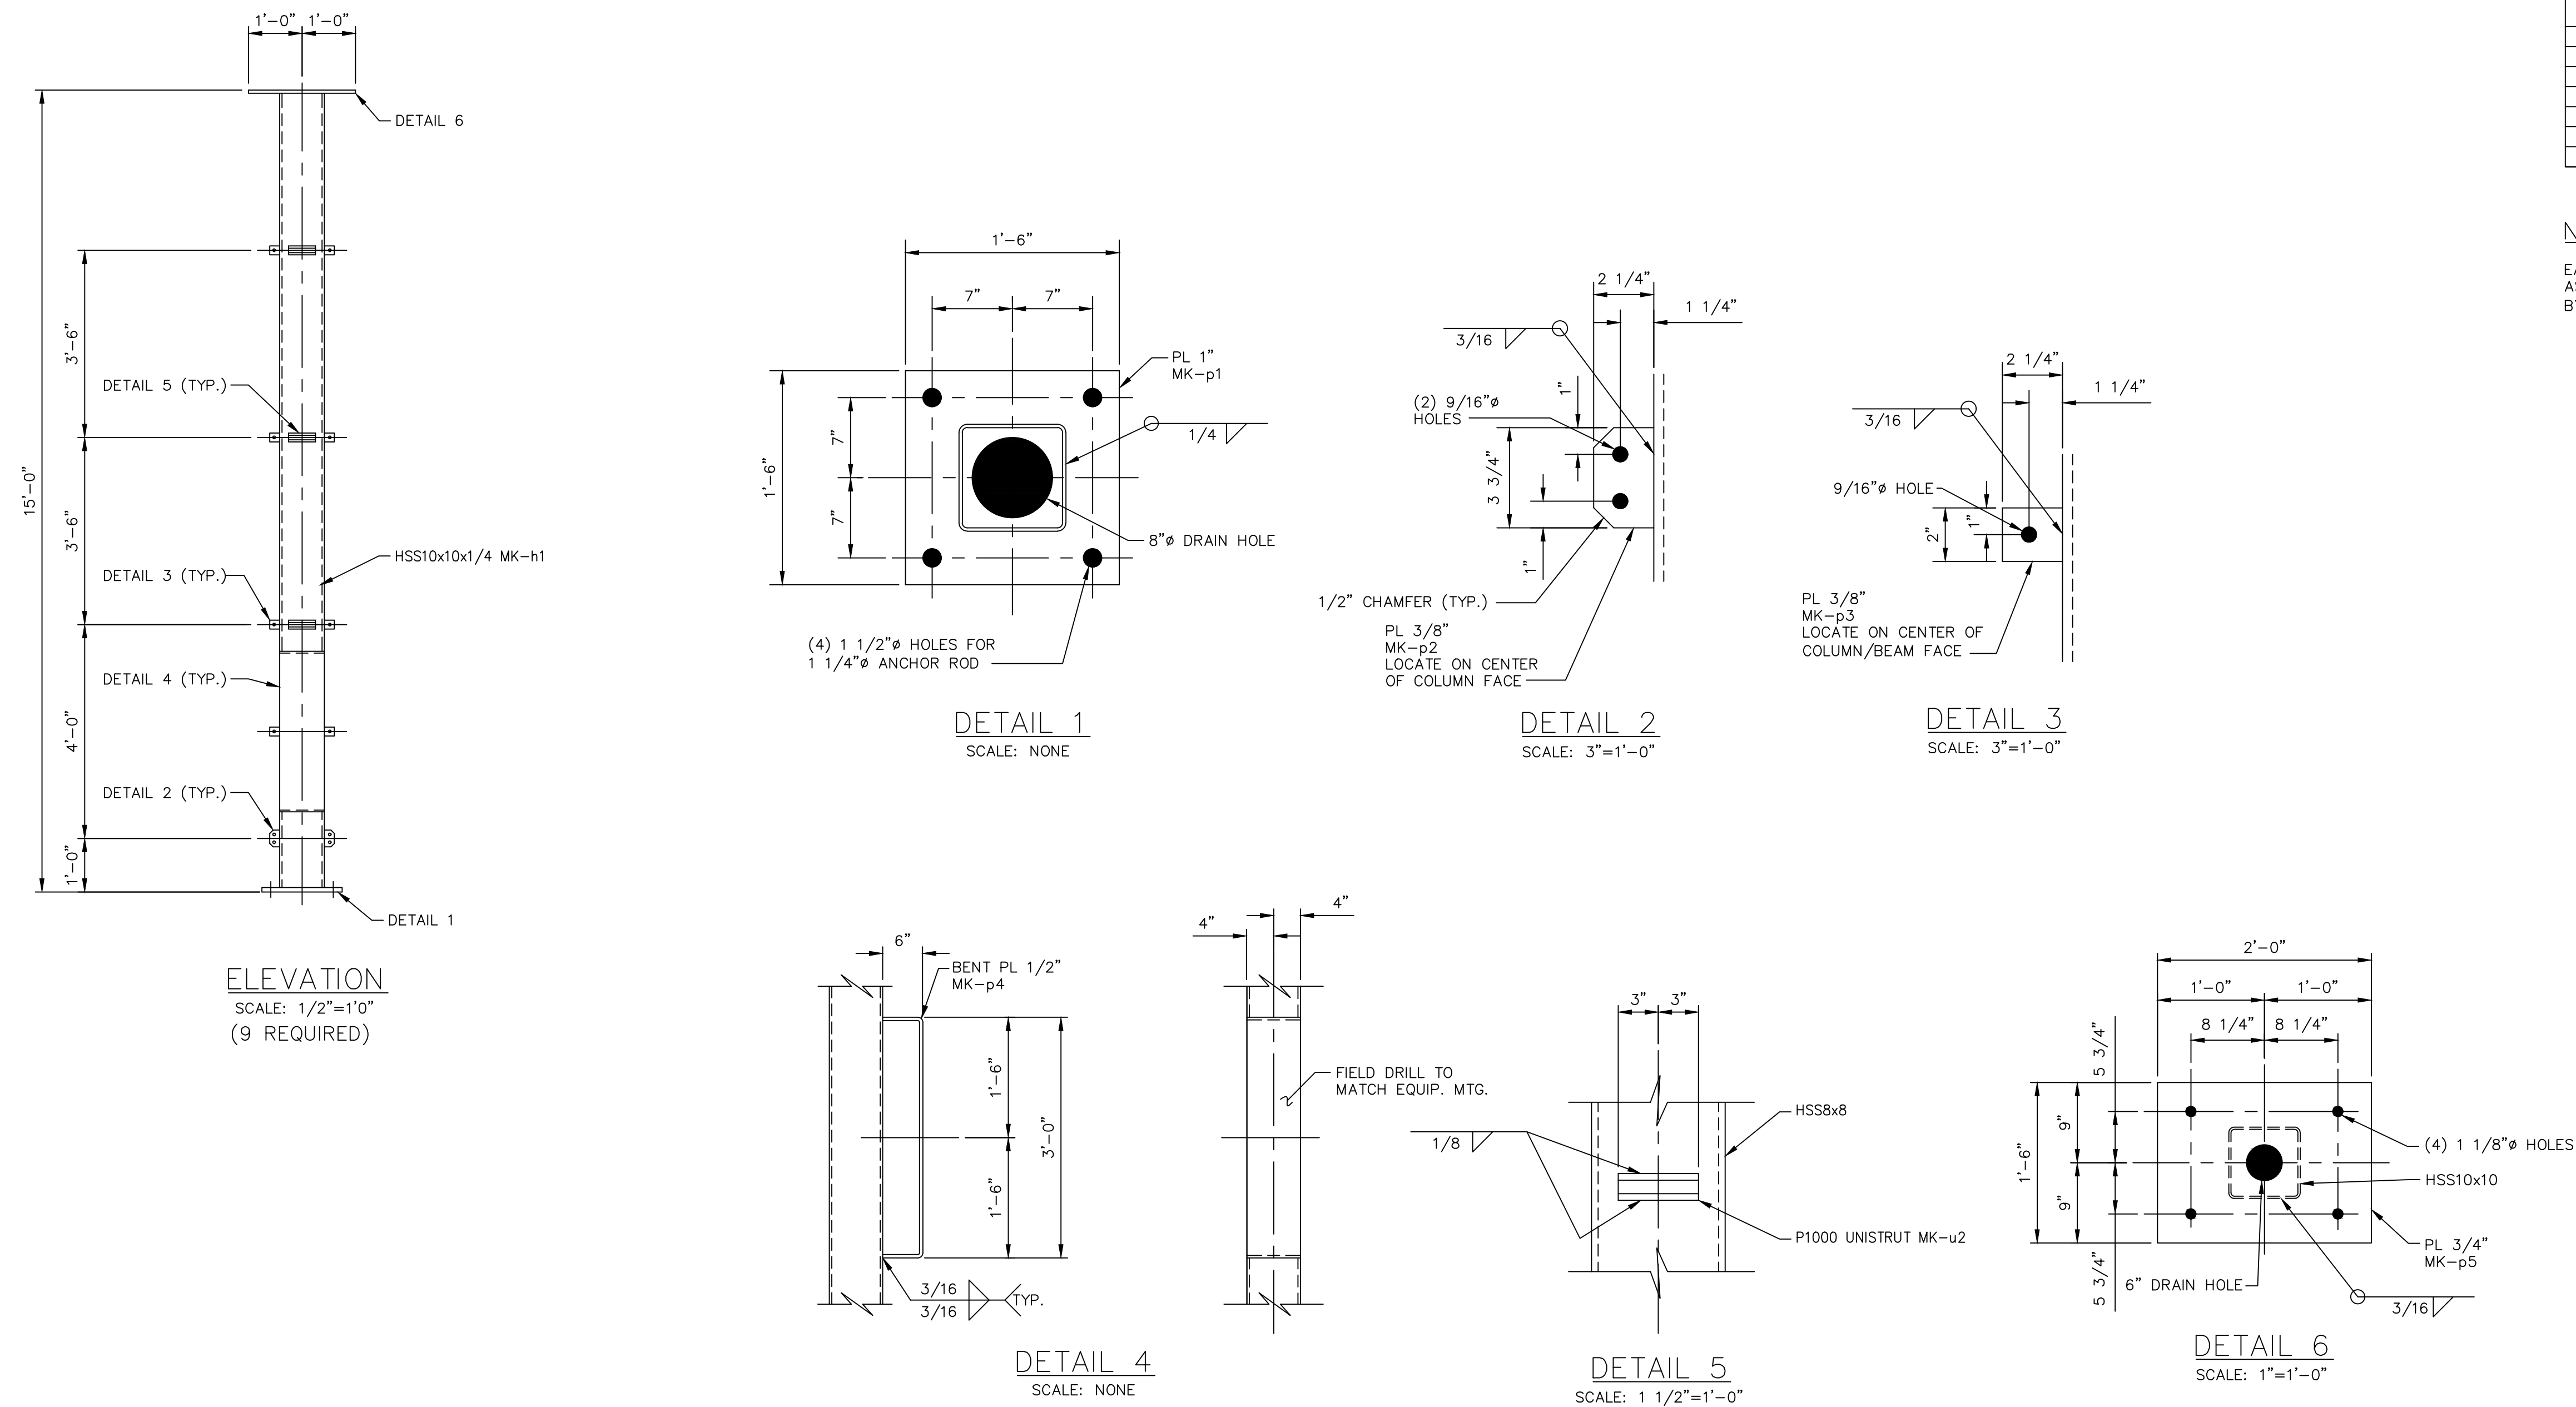

HOLD FOR
FINAL DESIGN

PRELIMINARY
NOT FOR CONSTRUCTION

NOTES

- | | |
|----|--|
| 1. | ALL WORK ON THIS DRAWING SHALL BE FURNISHED AND
INSTALLED IN ACCORDANCE WITH THE SCOPE OF WORK SPECIFICATION
UNLESS NOTED. |
| 2. | FOR STRUCTURAL STEEL GENERAL NOTES SEE DRAWING
STL-S1-0110. |

NEXTERA ENERGY TRANSMISSION NEW YORK, INC.
STOLLE 345kV SWITCHYARD
345kV CT/PT STAND


STL-S1-0117

--								SCALE: AS NOTED		
--										
--										
--										
--										
--										
A	02/28/2020	PRELIMINARY - ISSUED FOR BID	JB	NPR	-	S&L	PREP:	MJD	CHKD:	NPR
NO	DATE	REVISIONS AND RECORD OF ISSUE	DRWN	REVD	APPR	COMP	APPD:	-	DATE:	02/28/2020

BILL OF MATERIALS					
MARK	QTY.	DESCRIPTION	LENGTH		WEIGHT
			FT.	INS.	
MK-h1	1	HSS 8x8x1/4	8	4 1/4	216
MK-p1	1	PL 1x16	1	4	73
MK-p2	2	PL 3/8x2 1/4	0	3 3/4	2
MK-p3	6	PL 3/8x2	0	2 1/4	3
MK-p4	1	PL 1/2x8	4	0	54
MK-p5	1	PL 3/4x18	2	0	92
MK-u1	2	P1000 UNISTRUT	0	6	2
TOTAL BLACK WEIGHT					443
TOTAL GALVANIZED WEIGHT					462

NOTE:

EACH PART OR ASSEMBLY SHALL BE MARKED WITH THE PIECE OR ASSEMBLY MARK. THE MARKING SHALL BE MADE BEFORE GALVANIZING BY STAMPING WITH DIES (3/4" HIGH LETTERS).

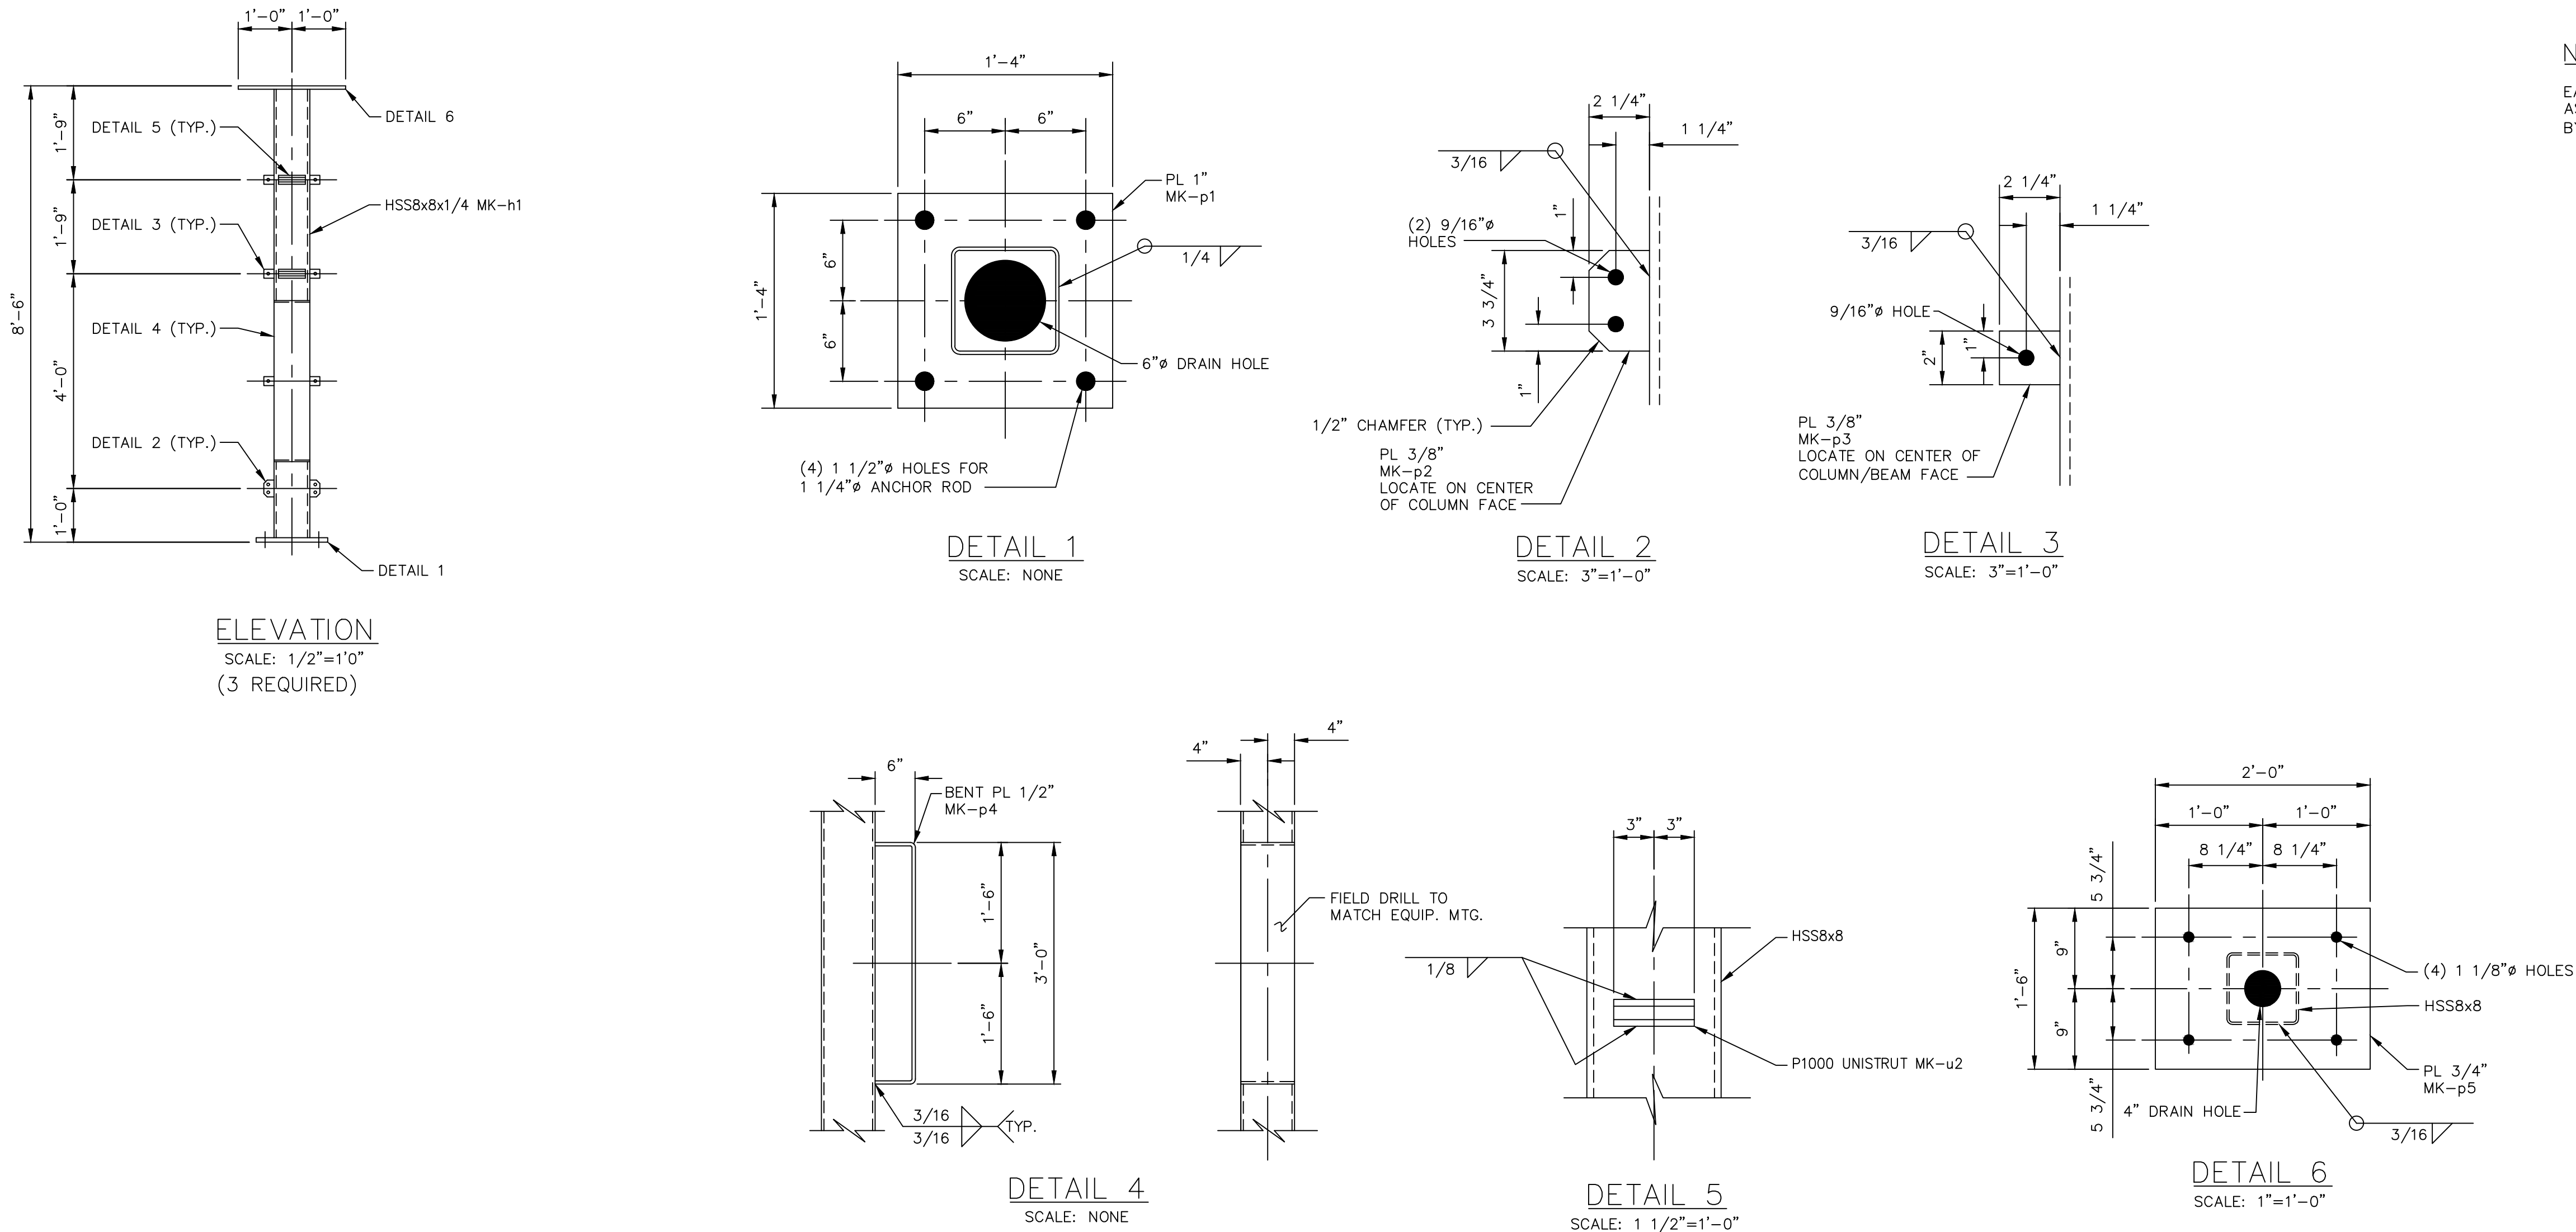

HOLD FOR
FINAL DESIGN

PRELIMINARY
NOT FOR CONSTRUCTION

NOTES	
1.	ALL WORK ON THIS DRAWING SHALL BE FURNISHED AND INSTALLED IN ACCORDANCE WITH THE SCOPE OF WORK SPECIFICATION UNLESS NOTED.
2.	FOR STRUCTURAL STEEL GENERAL NOTES SEE DRAWING STL-S1-0110.

[illegible]