


INTERSTATE I-90

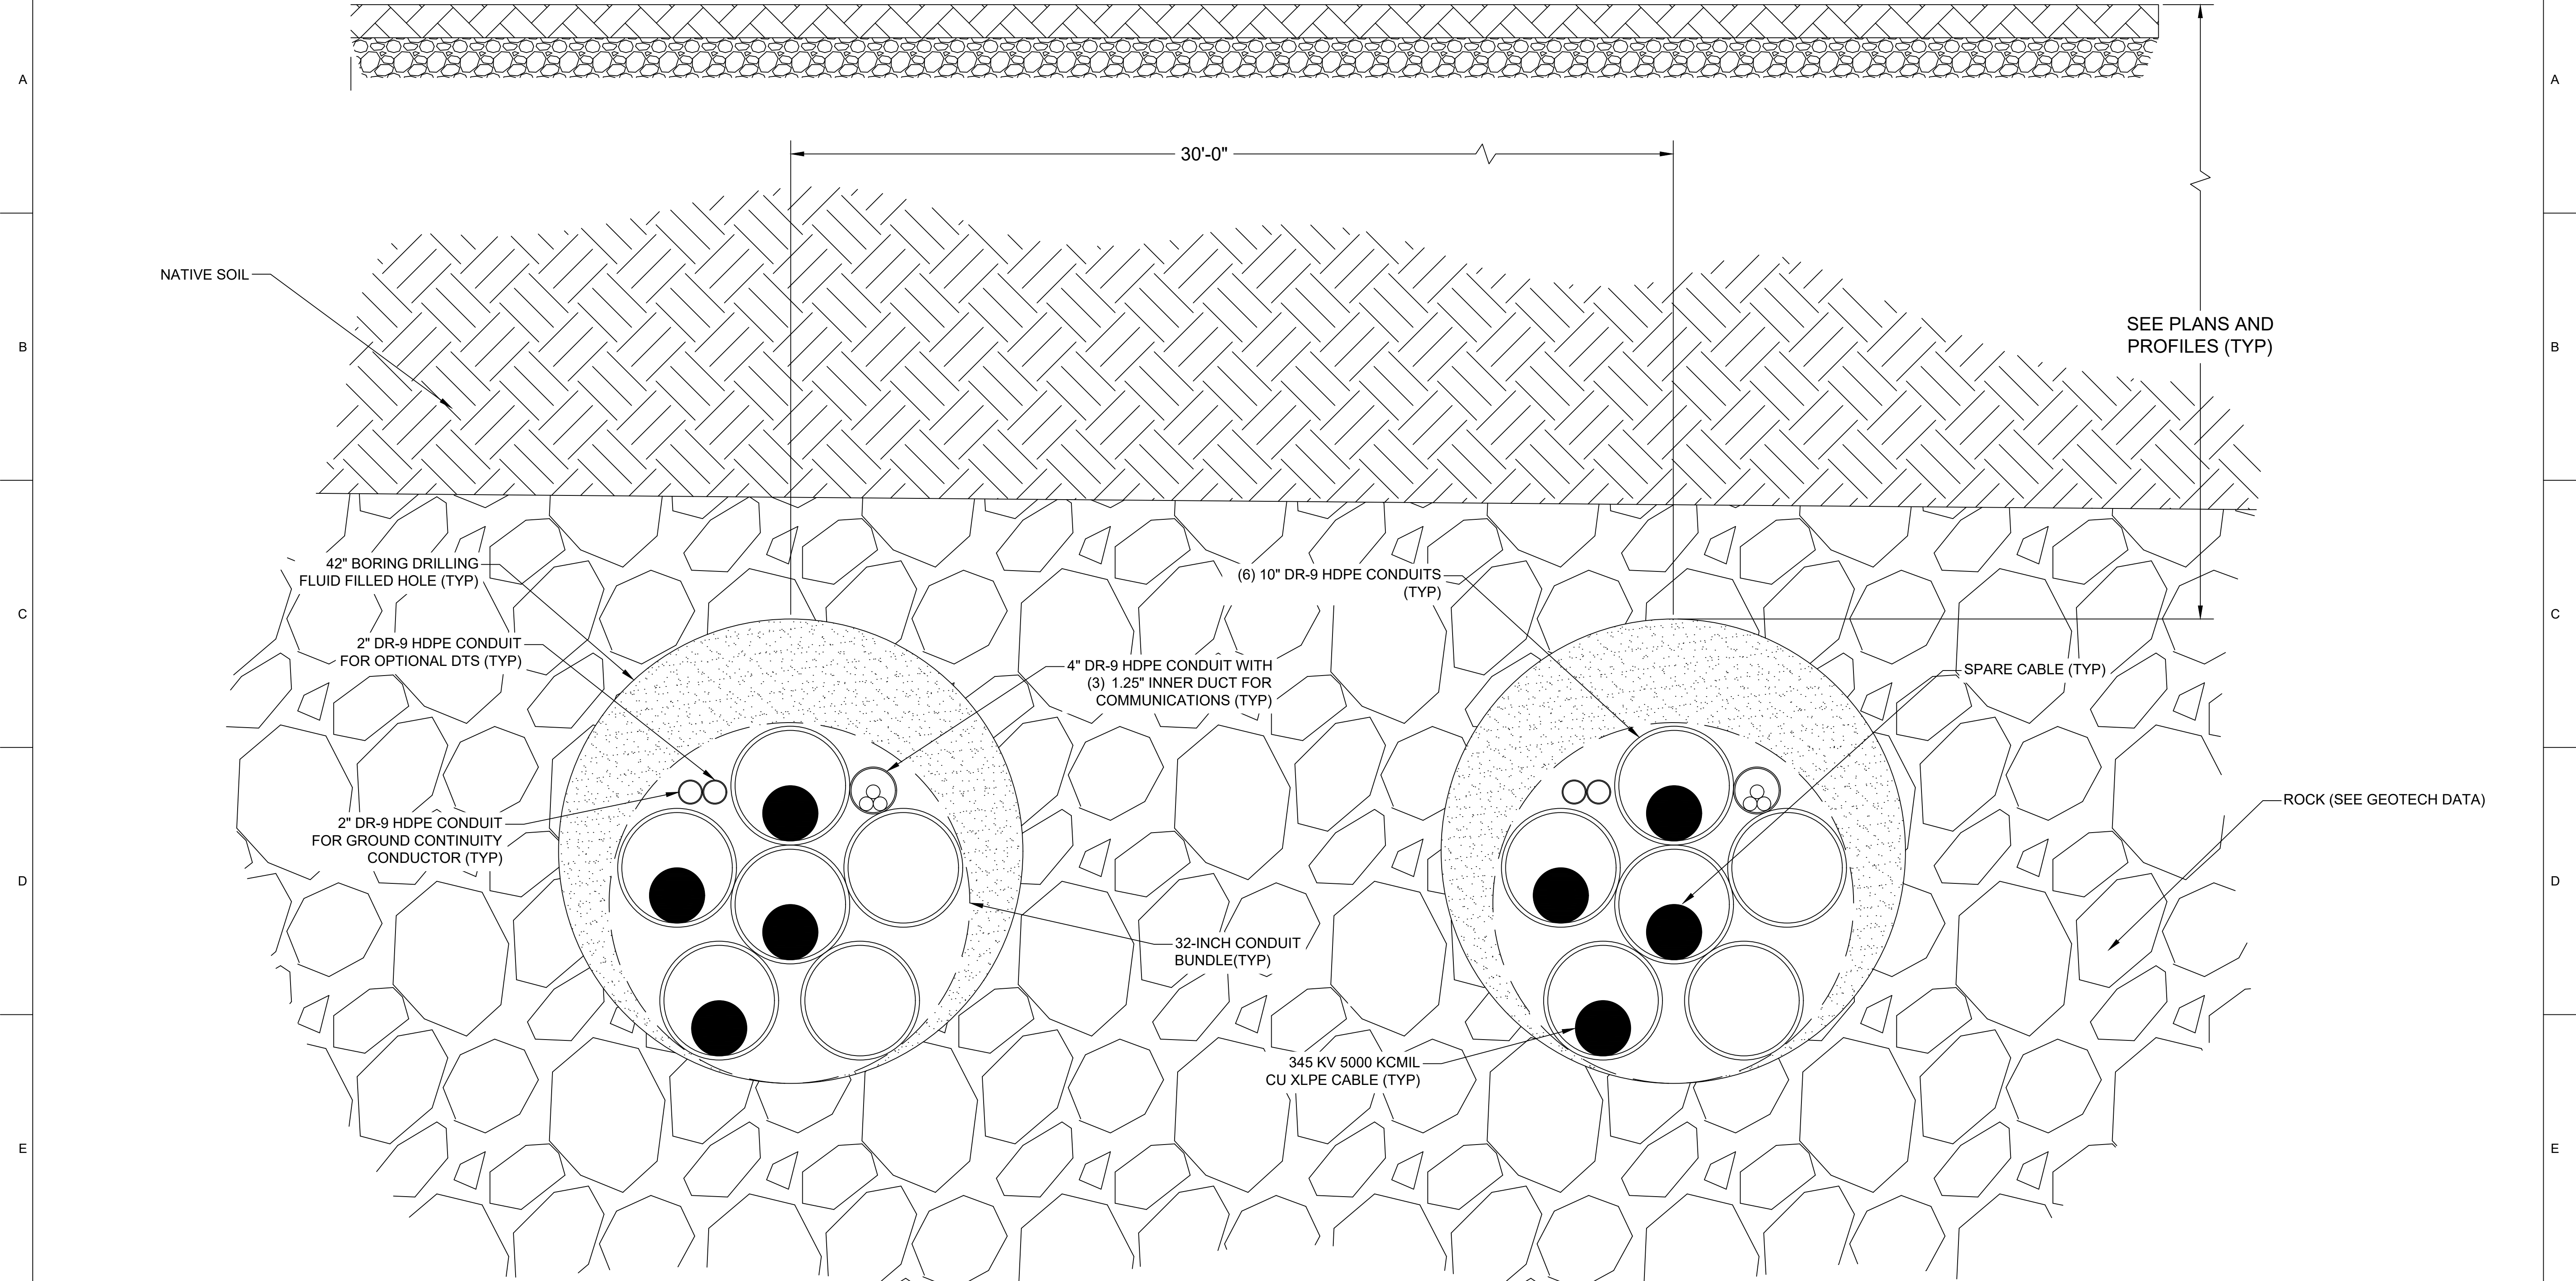

DETAIL
BOREHOLE
(N.T.S)

1

- NOTES:**
- CABLE SIZE ACCESSORIES, HARDWARE, AND EQUIPMENT PENDING FINAL VENDOR VERIFICATION.
 - UNDER NEW YORK STATE EDUCATION LAW ARTICLE 145 (ENGINEERING), SECTION 7209 (2), IT IS A VIOLATION OF THE LAW FOR ANY PERSON, UNLESS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.
 - DRAWING PREPARED UNDER KUNHAL PARIKH-LICENSED PROFESSIONAL ENGINEER IN THE STATE OF NEW YORK.

PRELIMINARY
FOR PERMIT ONLY

NO	DATE	REVISIONS AND RECORD OF ISSUE	DRWN	REVD	APPR	COMP	APPD:	KVP	DATE:
E	09/09/2020	ISSUED FOR PERMIT	DIV	JDJ	KVP	S&L			
D	8/24/2020	PRELIMINARY - ISSUED FOR REVIEW	DIV	JDJ	KVP	S&L			
C	06/21/2020	PRELIMINARY - ISSUED FOR REVIEW	DIV	JDJ	KVP	S&L			
B	02/27/2020	PRELIMINARY - ISSUED FOR BID	DIV	JDJ	KVP	S&L			
A	01/28/2020	PRELIMINARY - ISSUED FOR REVIEW	DIV	JDJ	KVP	S&L			


SCALE:
NONE

PREP: EE/NT CHKD: MR
APPD: KVP DATE: 04/24/2018



CONTRACTOR/INSTALLER SHALL TAKE ALL APPROPRIATE PRECAUTIONS TO ENSURE THE SAFETY OF ALL PEOPLE LOCATED ON THE WORK SITE, INCLUDING CONTRACTOR'S /INSTALLER'S PERSONNEL (OR THAT OF ITS SUB-CONTRACTOR(S)) PERFORMING THE WORK.

ANY MODIFICATION OR ADDITION TO THIS DRAWING BY ANY ORGANIZATION OTHER THAN SARGENT & LUNDY IS NOT THE RESPONSIBILITY OF SARGENT & LUNDY.

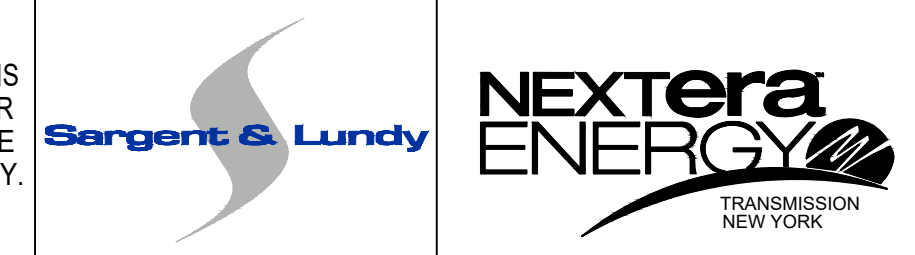

NEXTERA ENERGY TRANSMISSION NEW YORK, INC
EMPIRE STATE LINE
345 KV BOREHOLE
SINGLE CIRCUIT WITH INSTALLED SPARE CABLE
13666-003-T1-0610